

INGINERIA ILUMINATULUI

7

**Editura MEDIAMIRA
Cluj-Napoca
2001**



Universitatea Tehnică din Cluj-Napoca

Centrul de Ingineria Iluminatului UTC-N



ELECTRICA S.A.

Sucursala de Distribuție Cluj

Colegiul de Redacție

Dr. Florin POP, Profesor
Universitatea Tehnică din Cluj-Napoca
Centrul de Ingineria Iluminatului UTC-N
Gabriel RUGA, ing., Director
ELECTRICA S.A.
Sucursala de Distribuție Cluj
Dr. Dorin BEU, Șef lucrări
Universitatea Tehnică din Cluj-Napoca
Centrul de Ingineria Iluminatului UTC-N

Comisia de Referenți

Cornel BIANCHI, Profesor Dr.
Universitatea Tehnică de Construcții București
David CARTER, Profesor Dr.
University of Liverpool
Luciano DI FRAIA, Profesor Dr.
Università degli Studi "Federico II" Napoli
Liisa HALONEN, Profesor Dr.
Helsinki University of Technology
Florin POP, Profesor Dr.
Universitatea Tehnică din Cluj-Napoca
Ramon SAN MARTIN, Profesor Dr.
Universitat Politecnica de Catalunya

Tehnoredactare și traducere

Mihaela POP, ing.

Pentru manuscrise, informații suplimentare și abonamente, cititorii se pot adresa redacției la adresa:

Dr. Florin POP, Profesor
UTC-N - Universitatea Tehnică
Str. C. Daicoviciu Nr. 15
RO-3400 - Cluj-Napoca, România
Fax: (064)192055
(internațional: +40.64.192055)
e-Mail: Florin.Pop@insta.utcluj.ro

Copyright

În conformitate cu dispozițiile legale în vigoare, aceasta publicație nu poate fi reprodusă sau transmisă în nici o formă, electronică sau mecanică, inclusiv fotocopiere, înregistrare, memorare pe un sistem informatic sau traducere, în întregime sau parțial, fără acordul scris al Universității Tehnice din Cluj-Napoca, Centrul de Ingineria Iluminatului și al Editurii MEDIAMIRA S.R.L. Cluj-Napoca, România.

Revista INGINERIA ILUMINATULUI este o publicație semestrială, editată de Universitatea Tehnică din Cluj-Napoca prin Centrul de Ingineria Iluminatului UTC-N - Lighting Engineering Center LEC, ELECTRICA S.A. prin Sucursala de Distribuție Cluj și Editura MEDIAMIRA S.R.L. Cluj-Napoca.

INGINERIA ILUMINATULUI este o revista de informație tehnică, dedicată educației continue în domeniul iluminatului.

Obiectivele revistei constau în prezentarea rezultatelor activității de cercetare științifică, popularizarea unor realizări profesionale, încurajarea și educarea specialiștilor din construcții, administrație publică, proiectare, învățământ, studenților și a altor utilizatori.

Revista nu inserează anunțuri publicitare sau comerciale.

Opiniile exprimate de autori, referenți și colaboratori sunt personale și nu sunt în mod necesar acelea ale redacției.

Autorii sunt responsabili de calitatea materialelor grafice din cuprinsul articolelor proprii - diagrame, desene, fotografii, reproduceri.

Costul unui număr este de 5 Euro, la care se adaugă taxa poștală (0,12 Euro - România, 0,95 Euro - Europa). Se utilizează cursul BNR în prima zi a lunii în care se efectuează plata.



Editura MEDIAMIRA
Cluj-Napoca
C.P. 117, O.P. 1, Cluj
ISSN 1454-5837

Volumul 906

EDITORIAL

Găzdui în anul 2001, președintele ROMAVIT

INDUSTRIAL LIGHTING

Găzdui SMACRY Group în BURJOG

CONCEPTUAL DESIGN

OF LIGHTING SYSTEMS

în cadrul triajului de la

OUTLINE RATIONALE AND ACCURATE

TECHNIQUE METHODS

Sau DIVULGAREA

referință la tehnica eficientă

Alun Tully FOGBEERG

CETI IN THE WORLD

INTERVIEW WITH VIKTOR V. VIKHNOVSKIY, Roman SVA MARTIN

THE RESEARCH COSTS

Eduard TATRA

RESULTS OF DIMMING ON LAMP LIFE

Volumul 906

TESTS OF A LAMP LIFE

Găzduirea SUFOGARE

COLLEGIUM si Simpozionul

Conferinte si Intercalatorii ILUMINAT 2001

8-9 June 2001, Cluj-Napoca

tehnologia de integrare a rezistențelor

călciferelor, folosirea de media și combina-

ția cu elemente de control și reglaj

87 CENTRUL DE INGINERIA ILUMINATULUI - ETCN

Tehnologie iluminatului modern

în cadrul unui program național de

educație în domeniul tehnicii

88 LIGHTING RESEARCH & TECHNOLOGY

rezultatele în cadrul căreia sunt invita-

ți să participați la cinci proiecte de

89 Recomandări pentru dezvoltarea tehnologiilor

în cadrul unor proiecte naționale

postdoctorale sau loc de muncă în cadrul

universităților din România, unde se

didactic se realizează pe de fapt cunoaș-

5 EDITORIAL

Florin POP

7 INDUSTRIAL LIGHTING

productivity, health and well-being

Gerrit van den BELD, Wout van BOMMEL

32 CONCEPTION/DESIGN

OF LIGHTING SYSTEMS

for urban traffic roads

Cornel BIANCHI, Camelia BURLACU

44 QUICK, RATIONAL AND ACCURATE

LUMEN METHOD

using minimum available data

Paul DINCULESCU

59 CIE IN THE WORLD

Hans Allan LÖFBERG

67 THE BENEFIT/COST

IN URBAN LIGHTING

Eduardo R. MANZANO, Ramon SAN MARTIN

74 EFFECT OF DIMMING ON LAMP LIFE

results of a lamp life test

Eino TETRI

Conferințe și Simpozioane

83 Conferința internațională ILUMINAT 2001

28-30 Iunie 2001, Cluj-Napoca

Informații

87 CENTRUL DE INGINERIA ILUMINATULUI - UTC-N

Lighting Engineering Center - LEC

Florin POP

89 LIGHTING IN THE NEW WORLD

Cristian Viorel SUVAGAU

89 LIGHTING RESEARCH & TECHNOLOGY

relaunched journal

94 Recommendations for the printing form of your papers

Copyright

În conformitate cu dispozițiile legii privind protecția drepturilor de autor, este interzisă și proibită, fără acordul autorului sau al editorului, reproduse parțiale sau complete, în formă electronică sau printată, de către un utilizator final, sau transmisă în nici o formă, elecronică sau analogică, inclusiv prin intermediul unui sistem de memorare pe un sistem informatic sau a altor mijloace într-un "format de lucru", și, fără acordul autorului sau al editorului, să fie publicată, transmisă, prezentată sau difuzată, în sensul Universității Tehnice din Cluj-Napoca, Centrul de Informații Publizabile, și

Hans van den Berg

Wim van Beurden

The Netherlands

Distance learning in lighting education

Lighting education courses have always struggled to exist,

mainly due to the breadth of the subject, which means that it crosses a number of academic boundaries and therefore it is difficult for it to find a logical academic home...

[David L LOE, Distance learning

- A way forward in lighting education,
at 24th Session of the CIE- Warsaw '99]

Summary

Nowadays in many countries the human resources are considered as the major asset. For reasons of both economics and personal health and well-being, the safety, reduction of accidents and absenteeism are getting a lot of attention. Measures are taken and legislation on safety rules exist or are under preparation in many countries. Despite all the efforts the direct economic losses are about 2.8-3.5% of GDP in the EU member states. 10-20 million workers die annually. Moreover, apart from the personal tragedy, also the social and cultural policy are addressed. The societal cost of health care and costs of integration of disabled workers after illness. Another aspect is the ageing workforce with higher risk of absenteeism and related to a high rate of fatalities. There is also a shift towards a 24 hrs society especially in Japan. Intensive production processes and services require more global competitiveness and contributes to the increasing of the aging workforce. Consequently, there is a need to perform sports and more actively involve student in time of free time.

Good lighting in the workplace is very important place is required for optimal physical performance—especially work tasks. In account the ageing workforce. The effects of good lighting are even more important as (medical) science has shown in the last two decades the positive influence of light on


Inginerul de iluminat trebuie permanent să ia decizii referitoare la alegerea tehnologică, eficiență energetică, impactul asupra mediului și efectele acestora asupra ființei umane. Disponibilitatea multor surse luminoase eficiente, creșterea importanței contribuției luminii naturale în clădiri, impactul calculatoarelor asupra organizării locului de muncă și al relațiilor de muncă, la fel cu dezvoltarea metodelor de măsurare, calcul și proiectare, sunt doar câteva exemple privind schimbările curente care cer răspunsuri din partea inginerilor de iluminat care pot doar să reacționeze cu succes cu ajutorul mijloacelor oferite de cercetare și dezvoltare. Aceasta imagine este comună pentru diferite țări și regiuni ale globului. Este necesar să fie promovată generația cunoașterii, generație care se adaptează la tehnologia ce integrează o vizion regională, cu caracteristici culturale, de mediu și economice specifice.

Teoria educațională actuală sugerează că există moduri mai eficiente de prezentare a materialului didactic decât într-o carte. Cea mai nouă modalitate de educație în iluminat este un instrument educațional de tip hipermedia. Aceasta poate fi parte a unui program de învățământ la distanță în iluminat. Învățământul la distanță este instituit de către *Open University*, care oferă cursuri ce acoperă o gamă mare de domenii, unele dintre acestea până la nivel postuniversitar. El permite oamenilor să studieze în propriul lor oraș sau loc de muncă și în propriul lor ritm. Cum comunicația electronică devine din ce în ce mai larg disponibilă, comunicarea între cadrul didactic și student poate fi relativ simplă.


Studentii pot castiga cunoastinte in iluminat prin intermediul specializarilor universitare de Instalatii in Constructii si Inginerie Electrica, in care ponderea elementelor de iluminat este de pană la 50%. Nu exista un curs specific la Arhitectură. Noțiuni de tehnica iluminatului sunt cuprinse și în unele cursuri de la secții de profil Mecanic sau Constructii, în care elemente de iluminat se predau în 4 ore de curs. Anual, peste 700 de studenti/cursanți primesc un nivel bun de cunoastinte în domeniul iluminatului, 350 un nivel mediu și 300 un nivel scăzut. Este de menționat că de la începutul Facultății de Instalații în Constructii din București (1949) au fost instruiți peste 6.000 de studenti.

Este util să cuantificăm elementele de iluminat relativ la totalul cursului. Numărul de ore, având ca subiect elemente de iluminat la cursurile principale, este limitat la aproximativ 20 de ore de curs și 15-20 de ore practice. Aceasta înseamnă nu mai mult de 40% din totalul orelor de curs. Există câteva cursuri secundare, care includ parțial elemente de iluminat. Numărul de ore este foarte mic, de la 4 la 10 ore de curs și de la 2 la 8 ore practice, nu mai mult de 15-30% din totalul orelor de curs. Numărul studenților/participantilor variază mult, în funcție de profilul secției, de la un minim de 15-20 la un maxim de 90-180.

Educația în iluminat este sub semnul analizei în multe țări. Pregătirea suplimentară specifică este realizată în cadrul cursurilor postuniversitare, de master și doctorat.



Dr. Florin POP, Profesor

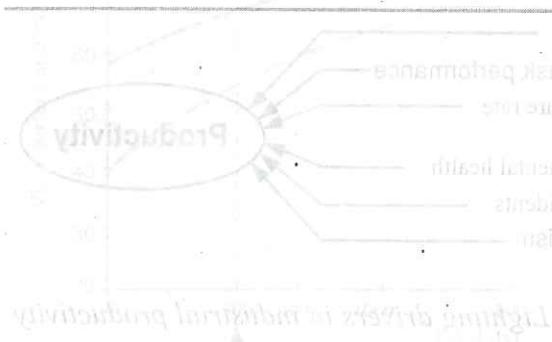

Summary

Nowadays in many companies the human resources are considered as the major asset. For reasons of both economics and people's health and well-being, the safety, reduction of accidents and absenteeism are getting a lot of attention. Measures are taken and legislation on safety rules exist or are under preparation in many countries. Despite all these efforts the direct economic losses are about 2,8-3,6% of GNP in the EU member states or 100-200 million working days annually. Moreover, apart from the personal tragedies, also EU and national policy are addressing the societal cost of healthcare and cost of re-integration of (disabled)workers after illness. Another aspect is the aging workforce with higher rate of absenteeism and relatively high rate of fatal accidents. There is also a shift towards a 24-hrs society especially in capital intensive production processes and service organizations. Global competitiveness also contributes to the increased 24 hrs operations in many businesses. Consequently workers have to perform more and more optimally independent of time of day.

Good lighting on the task and in the working place is required for optimal (visual) task performance, especially also taking into account the aging workforce. The effects of good lighting are even more important as (medical) science has shown in the last two decades the positive influence of light on



health and well-being as light is e.g. controlling largely the biological clock. This body clock regulates e.g. all daily rhythms of both physiological and psychological processes such as hormone secretion levels, alertness, mood, sleep-wake cycle, body temperature and many others. Both these aspects of good industrial lighting will become more important in 24-hour operations. Dedicated lighting solutions will be required.

At present industrial lighting standards are based on the lighting needs to carry out the (visual) task efficiently. The lighting requirements are fulfilled by general lighting for the work place eventually augmented by local task/machine lighting. It is striking that in general the lighting quality requirements for industry are lower than e.g. for offices. Moreover many existing industrial lighting systems are very old and economically as well as quality wise outdated. One would expect the opposite: The best lighting systems in the industrial working environment for enhanced productivity, safety and health reasons. A better lighting will positively contribute to speed and failure rate in performance, safety and accidents rate, absenteeism, health and well-being.

In this paper the importance of industrial lighting of high quality as a driving factor to improve productivity is discussed. The impact of light on vision, performance, alertness, well-being etc. as indicated in the model will be analyzed on basis of the present state of knowledge on light & vision and light & health.

Concluding, industrial lighting should be given the attention it deserves from the point of view of company's economics, worker's health and well-being and public health policy and costs.

WORKING ENVIRONMENT

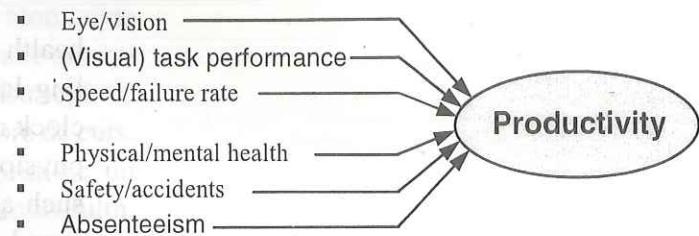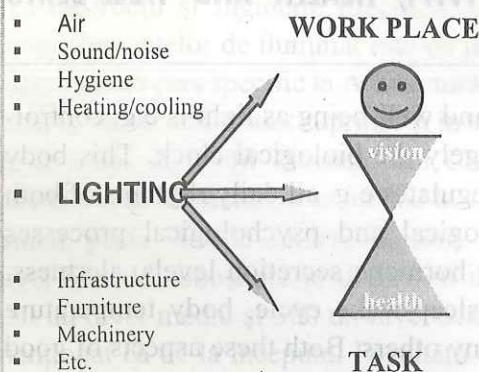

Lighting drivers in industrial productivity

1 INDUSTRIAL LIGHTING

Industrial lighting covers a wide range of different working interiors and work tasks: from small work shops to huge factory halls, and from fine precision work to heavy industrial tasks. In industrial environments we have often to rely for an important part on artificial lighting only. There where (glare-free) daylight can enter the industrial premises it can play an important role in obtaining satisfying lighting results at the moments it is available. Good linking with the artificial lighting is then essential. There are three systems of artificial lighting used in industrial interiors: general lighting, localised lighting and local task lighting. General lighting is designed to produce a relatively uniform illuminance on the working plane throughout the area. In those interiors where the arrangement of the work positions is permanent, the use of localised lighting, with concentration of the higher illuminances at the work positions, can lead to more cost effective installations. The lighting requirements for certain specific tasks can be so stringent that it is neither technically feasible nor economically viable to do the lighting with the general lighting alone. Local task lighting is then used to supplement the general lighting for these specific tasks.

1.1 Visual performance and lighting

The lighting quality should always be such as to guarantee sufficient visual performance for the tasks concerned. Research on the quantity and quality of lighting over the past decades has shown that improvement of lighting quality from a low or moderate level increases the speed and accuracy with which objects can be detected and recognised. The actual visual performance of a person is dependent upon the quality of the lighting and of his or her own „seeing abilities“. In this respect age is an important criterion. With increasing age, more and more light is necessary. Figure 1.1 gives the relative requirements of the amount of lighting for

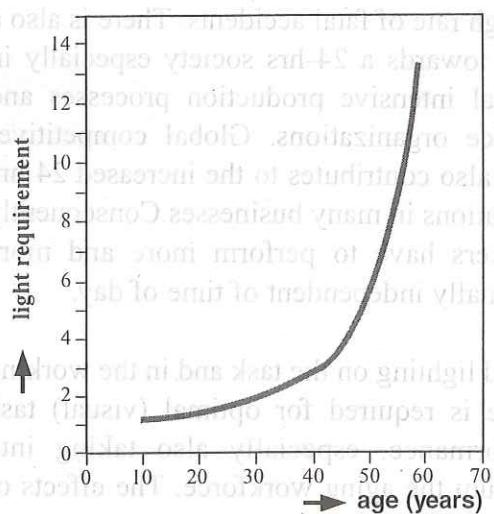


Figure 1.1 Relation between age and light required for reading good print. Source: Fortuin [1.1]

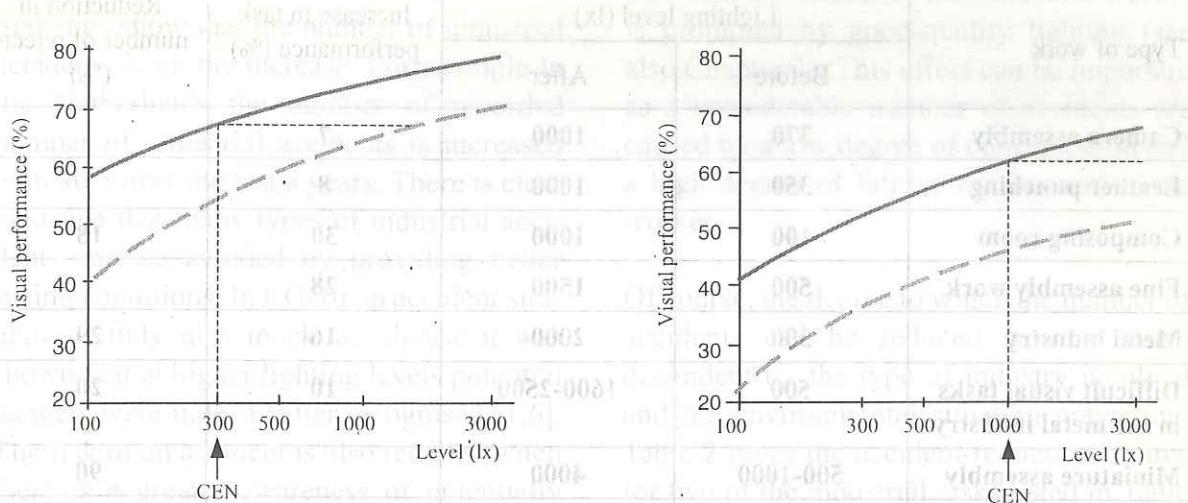


Figure 1.2 Relation between relative visual performance (in %) and lighting level (in lx) for a visually moderate difficult task (left) and a visually difficult task (right). Continuous line: young persons, broken line: older persons. Source: CIE [1.3]

reading a well printed book in dependence of age. If the requirement at the age of 10 is taken as 1, it follows that a person of 60 years old requires as an average 15 times more light! This effect of course becomes more and more important with the workforce becoming older.

Figure 1.2 serves as an illustration of the many research results pertaining to the influence of lighting quality on visual performance. It gives the relative visual performance as a function of the lighting level for different task difficulties. One for a visually moderate task (as, for example, relevant for general machine work) and another one for a difficult task (as, for example, fine assembly work or colour inspection work). For all tasks a clear increase in visual performance is shown if the quality of the lighting, in this example the lighting level, is increased. From the figure it again becomes evident that the effect of age on visual performance is very important. For the same level of visual performance the quality of the lighting must be much higher for older workers. But for visually-difficult tasks, lighting cannot completely compensate for the deteriorating effect of age. Given the increase in average age of the workforce in the coming years

(20% increase of the age group 50 - 65 in the coming 15 years) this means that with no changes in the illuminance levels worker performance will decrease. In the graph, the required lighting levels for the two tasks as specified in the European draft standard of CEN [1.2] are indicated. It shows that these CEN requirements are in fact conservative rather than overstated if we take the age effect into account.

An improvement in visual performance yields, in its turn, an improvement in task or work performance. The improvement is reflected in a higher output and in a lower number of errors.

To what extent good quality lighting enhances work performance is, of course, dependent on the visual component of the task. A task with an important visual component will benefit more from good seeing conditions than a task with a less important visual component.

As an example, Table 1 summarises from different publications for different industrial tasks the increase in task performance and the reduction in rejects brought about by an improvement of the lighting quality.

Type of work	Lighting level (lx)		Increase in task performance (%)	Reduction in number of rejects (%)
	Before	After		
Camera assembly	370	1000	7	
Leather punching	350	1000	8	
Composing room	100	1000	30	18
Fine assembly work	500	1500	28	
Metal industry	300	2000	16	29
Difficult visual tasks in the metal industry	500	1600-2500	10	20
Miniature assembly	500-1000	4000		90
Weaving mill	250	1000	7	

Table 1 Increase in task performance and reduction in number of rejections as a result of improvements in lighting level. Source: Handbuch für Beleuchtung [1.4]

different working conditions and work tasks, from small workshops to large factory halls.

Figures 1.3 and 1.4 summarise the general trends of improvement in task performance and the reduction of errors with increase in lighting level.

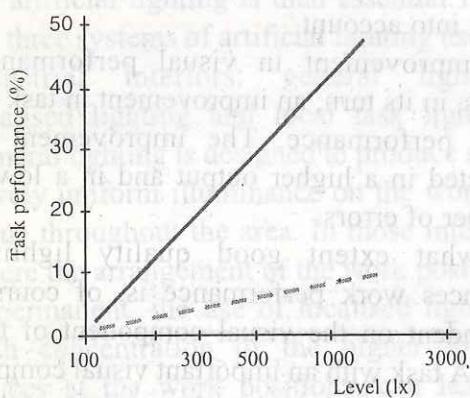


Figure 1.3 Relative task performance increase that may be expected to follow from improved lighting for a simple (broken line) and a difficult (continuous line) visual component task. Source: Fördergemeinschaft Gutes Licht [1.5]

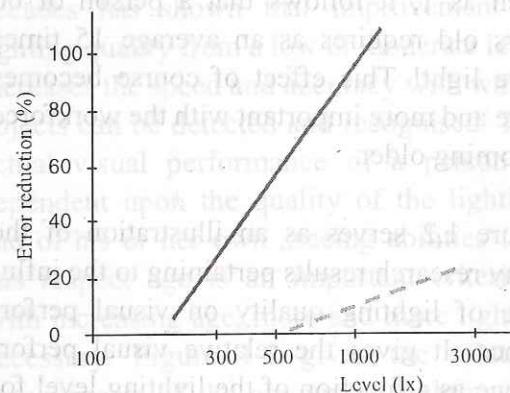


Figure 1.4 Relative reduction of errors resulting from improved lighting for a simple (broken line) and a difficult (continuous line) visual component task. Source: Fördergemeinschaft Gutes Licht [1.5]

1.2 Accident reduction and lighting

Accidents are often a concern in the industrial environment. The resulting physical injuries and mental anguish are sometimes responsible for considerable losses in pro-

duction.

Statistics show that the number of industrial accidents is on the increase. For example in the Netherlands the number of recorded number of industrial accidents is increased with 40.5 over the last 3 years. There is clear evidence that many types of industrial accidents can be avoided by providing better seeing conditions. In a German accident simulation study in a mock warehouse it was shown that at higher lighting levels potential dangers were indeed better recognised [1.6]. The risk of an accident is also reduced when there is a greater awareness of potentially dangerous situations and when the mood,

alertness and health of the industrial worker is promoted by good-quality lighting (see also Chapter 2). This effect can be important as a considerable number of accidents are caused by a low degree of concentration and a high degree of fatigue on the part of the worker.

Of course, the degree to which the number of accidents can be reduced is very much dependent on the type of industry involved and the environmental situation prevailing. Table 2 gives the accident-reduction figures for two of the industrial tasks listed in Table 1 above, where performance improvements

Table 2 Accident reductions as a result of improvements in lighting level

Type of work	Lighting level (lx)		Accident reduction (%)
	Before	After	
Metal industry	300	2000	52
Difficult visual tasks in the metal industry	500	1600-2500	50

and reject reductions were recorded.

Figure 1.5, resulting from another study, gives the number of accidents at the workplace as a function of the lighting level for

different types of injuries. Here, again, the trend is clearly a reduction in the number of accidents as the quality of the lighting is improved.

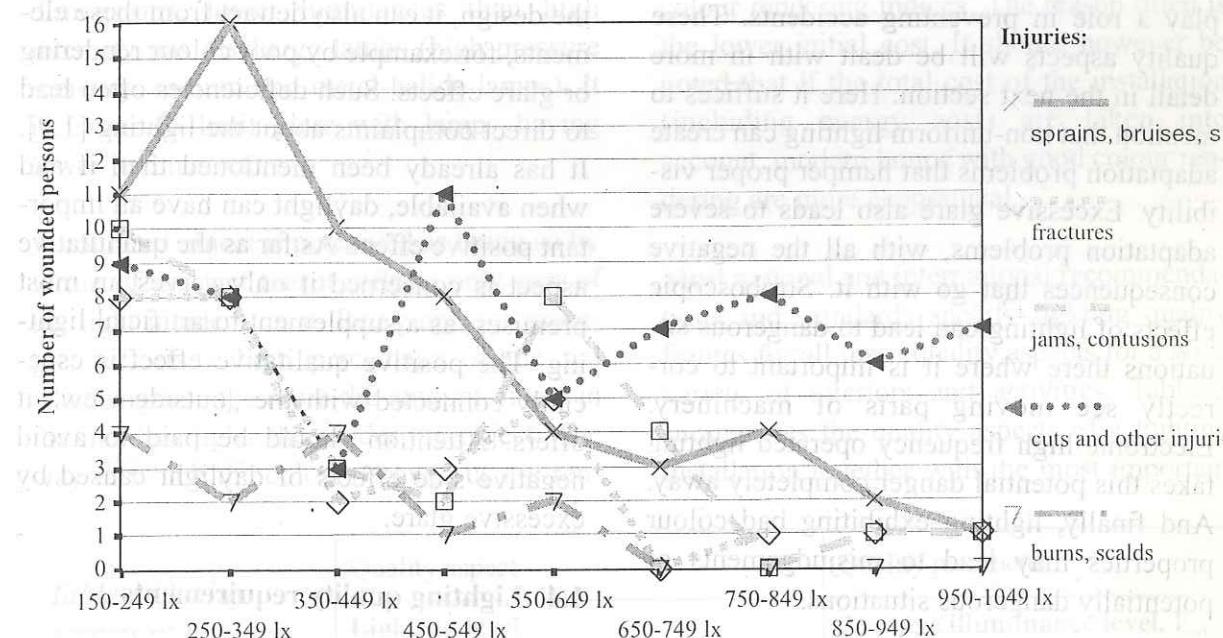


Figure 1.5 Number of accidents for different industrial tasks as a function of the lighting level (347 Accidents investigated in total). Source: Völker, Rüschen Schmidt and Gall [1.7]

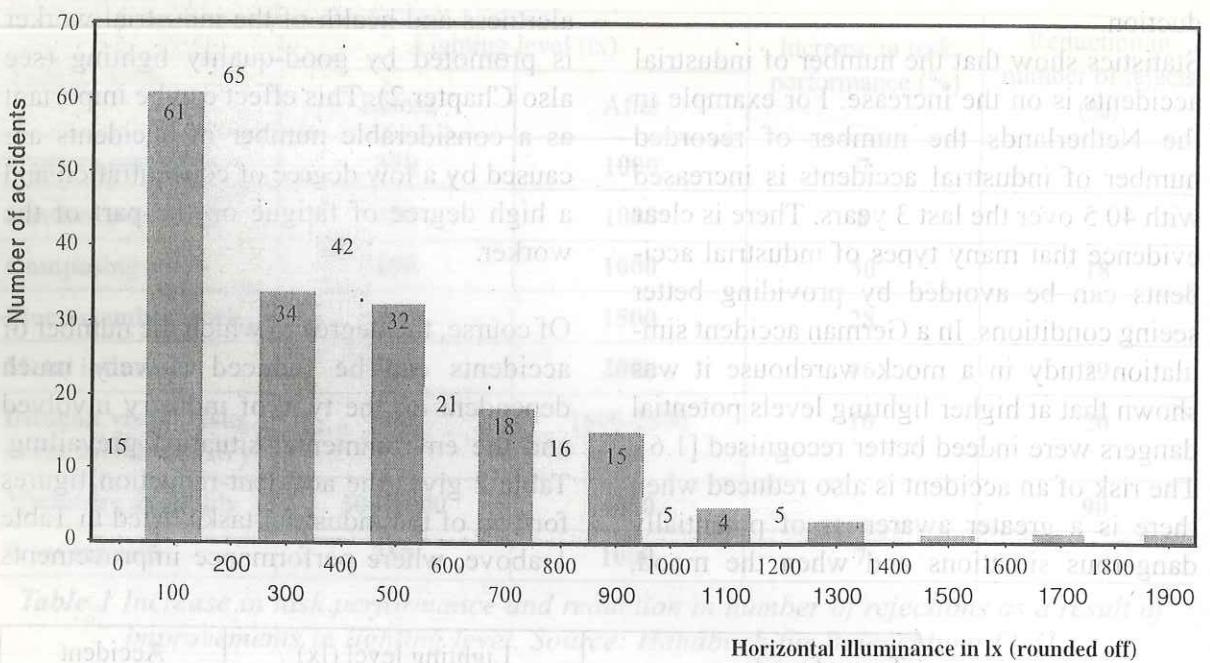


Figure 1.6 Number of accidents as a function of the lighting level. (A total of 347 accidents have been investigated). Source: Völker, Rüschen Schmidt and Gall [1.7]

In Figure 1.6, all accidents analysed in this study are combined. It makes very clear that work places with lighting levels between 50 and 250 lx are confronted with a relatively high number of accidents.

It is important to note that not only the lighting level but all aspects of lighting quality play a role in preventing accidents. These quality aspects will be dealt with in more detail in the next section. Here it suffices to mention that non-uniform lighting can create adaptation problems that hamper proper visibility. Excessive glare also leads to severe adaptation problems, with all the negative consequences that go with it. Stroboscopic effects of lighting can lead to dangerous situations there where it is important to correctly see moving parts of machinery. Electronic high frequency operated lighting takes this potential danger completely away. And finally, lighting exhibiting bad colour properties may lead to misjudgements of potentially dangerous situations.

1.3 Lighting and working environment

Apart from the influence lighting has on visual performance there is also the influ-

ence the lighting has on the working environment. The overall working environment, if properly designed, can have a stimulating effect on the people working there [1.8]. Today, much importance is placed on the layout and interior design of the work-place. The lighting can have an important role here: whilst it can emphasise positive elements of the design, it can also detract from these elements, for example by poor colour rendering or glare effects. Such deficiencies often lead to direct complaints about the lighting [1.9]. It has already been mentioned that, if and when available, daylight can have an important positive effect. As far as the quantitative aspect is concerned it only serves, in most premises, as a supplement to artificial lighting. The positive qualitative effect is especially connected with the „outside view“ it offers. Attention should be paid to avoid negative side effects of daylight caused by excessive glare.

1.4 Lighting quality requirements

To enable people to perform visual tasks efficiently, accurately and safely especially the lighting level has been shown to have an important influence. However, other quality

aspects of lighting, namely uniformity of the lighting pattern, glare restriction and colour rendering are also very important.

Non-uniform lighting with abrupt changes in illuminances around the task area may lead to visual stress and discomfort. This has to do with the adaptation properties of the eye. Sufficient uniformity of the general lighting will ensure sufficiently high lighting levels to give complete freedom in the placement of the machinery and work places.

Glare is the sensation produced by brightnesses within the visual field that are largely greater than the brightness to which the eyes are adapted. This can lead to a reduction of visual performance and to discomfort. Too much glare can even lead to complaints such as eye strain and headache. The same problem may occur if there are excessive differences in brightness between the surfaces in the interior. It is thus important to limit glare to avoid errors, fatigue and accidents. The degree of glare restriction obtained depends very much on the optical quality of the luminaires used in combination with the type of lamp used. Fluorescent lamps have, thanks to their larger dimensions, lower luminances than high intensity gas discharge lamps (high pressure mercury, sodium and metal-halide lamps). It is easier to limit glare with lamps having lower luminances.

A coloured object is perceived as being so by virtue of the fact that it reflects only part of the light incident on it. Red paint, for example, reflects a high percentage of the red wavelengths - the more the amount of red in the incident light, the redder the object. The way in which the colours around us are ren-

dered is thus strongly dependant upon the colour rendering qualities of the lighting. The colour rendering index, R_a , of a light source is the measure for this quality. R_a can have values ranging from zero (no colour rendering) to 100 (excellent colour rendering). The proper colour rendering of the human skin is especially important. Lighting that makes the skin look pale and unhealthy often leads to complaints. By a proper choice of the light source (colour rendering R_a at least 80), this problem is easily avoided. Lamps with a colour rendering index lower than 80 give unacceptable results in interiors where people work or live; unacceptable as far as task performance is concerned, but also unacceptable from a mood and well-being point of view. The requirement for an R_a of 80 or more is especially important when it comes to the choice of the right type of tubular fluorescent lamp, there being so many different types available. For working environments, only those tubular fluorescent lamps with a colour code of 830 or higher fulfil the requirement.

In today's practice however, still in around 80% of the industrial lighting installations use is made of light sources with much lower colour rendering indices. The reason often is the lower initial cost. It should however be noted that if the total cost of the installation (including energy cost) are taken into account, modern lamps with good colour rendering are more economical.

Most national and international recommendations and standards specify lighting quality figures for all these quality aspects for a wide variety of interiors and activities. Table 3 summarises the quality aspects of a lighting installation together with the most important

Table 3 Quality aspects of lighting installations with their quality parameters

Quality aspect	Quality parameter
Lighting level	Average illuminance level, E_{av}
Uniformity	E_{min} / E_{av}
Glare restriction	UGR
Colour rendering	R_a

parameter for each aspect.

As an illustration of what quality is required in different situations Tables 4 to 6 give the required values for three different types of industry: chemical industry, power stations and printing industry. These requirements are values given in a draft European standard (draft 1998) for work places, which meet the

needs of visual performance, comfort and safety. Of course the same standard specifies values for many other types of industry. (The values specified for the average illuminance are so-called „maintained illuminance values“: values below which the average illuminance on the specified surface is never allowed to fall).

2.5 Chemical, plastics and rubber industry

Ref. no. Type of interior, task or activity

Ref. no.	Type of interior, task or activity	C_m	UGR _L	R _a	Remarks
2.5.1	Remote-operated processing installations	50	-	20	Safety colours shall be recognisable
2.5.2	Processing installations with limited manual intervention	150	28	40	
2.5.3	Constantly manned work places in processing installations	300	25	80	
2.5.4	Precision measuring rooms, laboratories	500	19	80	
2.5.5	Pharmaceutical production	500	22	80	
2.5.6	Tyre production	500	22	80	
2.5.7	Colour inspection	1000	16	90	$T_{CP} \geq 4000$ K
2.5.8	Cutting, finishing, inspection	750	19	80	

Table 4 Lighting requirements for the chemical, plastic and rubber industry.

Source CEN [1.2]

2.15 Power stations

Ref. no. Type of interior, task or activity

Ref. no.	Type of interior, task or activity	C_m	UGR	R _a	Remarks
2.15.1	Fuel supply plant	50	-	20	Safety colours shall be recognisable.
2.15.2	Boiler house	100	28	40	
2.15.3	Machine halls	200	25	80	For high-bay: see clause 4.6.2.
2.15.4	Side rooms, e.g. pump rooms, condenser rooms etc.; switchboards (inside buildings)	200	25	60	
2.15.5	Control rooms	500	16	80	1. Control panels are often vertical. 2. Dimming may be required. 3. For DSE-work see clause 4.11.
2.15.6	Outdoor switch gear	20	-	20	Safety colours shall be recognisable.

Table 5 Lighting requirements for power stations. Source CEN [1.2]

2.16 Printers

Ref.	Type of interior, task or activity	C _m	UGR	R _a	Remarks
2.16.1	Cutting, gilding, embossing, block engraving, work on stones and platens, printing machines, matrix making	500	19	80	
2.16.2	Paper sorting and hand printing	500	19	80	
2.16.3	Type setting, retouching, lithography	1000	19	80	
2.16.4	Colour inspection in multicoloured printing	1500	16	90	T _{CP} ≥ 5000 K.
2.16.5	Steel and copper engraving	2000	16	80	For directionality see clause 4.5.2.

Table 6 Lighting requirements for the printing industry. Source CEN [1.2]

A quality criterion seldom mentioned in standards is the frequency at which lamps are operated. Some people experience headaches because of the flicker of fluorescent lamps operated on magnetic ballasts (50 Hz). Fluorescent lamps run on modern electronic ballasts operating at high frequency (around 30 000 Hz) do not exhibit this flicker phenomenon. In a comparison it has been found that the occurrence of headache is, indeed, significantly lower when electronic ballasts are used [1.10]. On the basis of its influence on the basic brainwave pattern (EEG), another study describes fluorescent light produced by lamps operated on conventional, non-electronic magnetic ballasts as a potential stress source [1.11]. Of course electronic high-frequency ballasts are also recommended because they are more efficient and do result in a longer lamp life than lamps on conventional ballasts.

2 LIGHTING AND BIOLOGICAL EFFECTS

2.1 Background

Until a couple of centuries ago human life was determined by the daily light-dark cycle

and the related wake-sleep rhythm. Since the industrial revolution and especially the invention of electric light, the society is gradually extending the active daily period and now moving towards a 24 hour society. Shift work, including nightshifts, is already for many years applied in production processes in e.g. metal and food industry and hospitals. Today with the globalisation of the activities of many companies, IT services and intense intercontinental travelling the number of people working in irregular work schedules is increasing rapidly. In many countries a substantial part - 15-25% - of the working population is working in one of another form of shift schedule whether it be in production, transport or services.

From the ancient times the beneficial effect of (day)light was well known and used in e.g. heliotherapy. Light therapy in solving health problems was popular until the 1930's, than through the invention of penicillin, pharmaceutics took the leading role. The importance of light in relation to health and well-being however revived in the last 20-30 years by various findings in biological and medical research.

We normally think of the eye as an organ for vision, but after the discovery of additional

nerve connections from the eye to the brain, it turns out that ocular light mediates and controls a large number of physiological and psychological processes in humans. The most important findings in the effects of ocular light are related to:

- Control of the biological clock
- Direct (stimulating) effects
- Influence on mood

2.2 Light and the biological clock

In the new science of chrono-photobiology, light is considered as the most important factor - often referred to as 'Zeitgeber' - in controlling our internal body clock, located in the supra chiasmatic nuclei in the hypothalamus in the brain [2.1]. Ocular light sends, via a separate nerve system, signals to our biological clock located in the brain which in turn regulates the circadian (daily) and circannual (seasonal) rhythms [2.2] of a large variety of body processes. In a natural setting ocular light, especially morning light, synchronises the internal body clock to the environmental time or the 24 hour light-dark cycle of the rotating earth. Without light, the internal clock would be free-running with a period of about 24 hrs and 15 minutes and consequently the internal clock-time will deviate day after day more and more from the environmental clock time [2.3]. The result is that one will get similar symptoms as when having jet-lag after travelling over some time-zones[2.4].

In figure 2.1 some typical rhythms in human beings are illustrated, it should be noted that these have been smoothed and masking effects are ignored (temporary effects of food, coffee etc). The figure shows only a few examples: body temperature, alertness and the hormone rhythms of cortisol (stress hormone) and melatonin (sleep hormone). Important other ones are e.g. sleep-wake cycle, sleepiness, fatigue, mood and performance.

The hormones cortisol and melatonin play an important role in alertness and sleep. Cortisol levels raise in the morning and prepare the body and mind for the coming day activity. At the same time melatonin level drops, reducing the sleepiness. Melatonin is popular known as sleep hormone and induces sleepiness e.g. melatonin is used as sleeping pill to cope with jet lag. The rise of melatonin levels in the evening prepares humans to start the sleep cycle and maintain a good quality sleep during the night, resulting in optimal start of the new day. Light has the capability of directly suppressing melatonin e.g. light during the night reduces melatonin levels within half an hour and also morning light helps to reduce the melatonin level and consequently wakes-up. From these simplified examples it is evident that both hormone rhythms are important to function well during the time we are awake and influence directly the degree of alertness

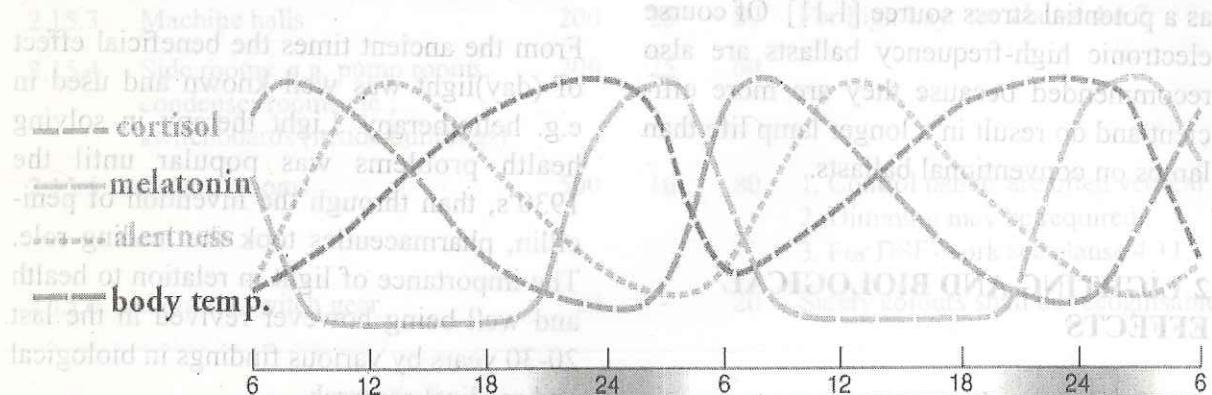


Figure 2.1 Double plot (2*24 hrs) of typical circadian rhythms of body temperature, melatonin, cortisol and alertness in humans for a natural 24 hour light/dark cycle. (Various sources, see text)

(see also chapter 2.4).

So the correct dose and timing of daily light is very important to keep the internal and external clocks in phase with each other especially because our internal clock regulates the circadian rhythm which are relevant in our daily activity such as alertness, sleepiness, fatigue, mood, performance.[2.2], [2.5].

2.3 Light and direct stimulating bodily effects

Direct stimulating effects of light are recognised by almost everybody, especially when comparing summer and winter, but also in the interior (working) environment [2.18]. This is partly a psychological effect, but also as illustrated above a physical component is contributing to this. Different light levels give changes in the EEG pattern and as a consequence influences the central nervous system resulting in effects on various body functions. Also through direct suppression by light of e.g. melatonin (see above) body processes are influenced.

Recent findings suggest moreover a direct effect of light e.g. heart rate, insulin level etc. [2.19], [2.20], [2.21]. Fundamentally these recent findings show an increasing number of neural pathways, directly or indirectly, from the eye to various glands in the body. Many of these effects could be related to the biological clock as well. Research has shown that light therapy is useful for various sleep disorders, Alzheimer disease and many others, which are subject of further research e.g. PMS, anorexia, bulimia, the immune system etc. [2.22], [2.23], [2.24], [2.25].

2.4 Light, mood and alertness

Mood is the reflection of the feelings of state of the person, physically the feeling good or bad, and mentally the feeling more or less alert [2.6]. Other factors known as influencing mood are for example weather/season [2.7] and in case of work the seeing condi-

tions and the (visual) environment.

In the industrial field alertness is of prime importance as it is a factor in not only mood but also in performance and avoiding accident. Alertness at a specific time of day is largely determined by an endogenous component, related to the circadian body clock, (raising in the morning, stable in the afternoon and declining in the late evening) and an exogenous component, declining over the period of wakefulness (the longer awake the lower). Subjective alertness at a time of the day is the combination of these two components, most probably not by simple addition but in a more complex relation. This leads also to the so-called lunch-dip with a relatively high sleep propensity and increased number of e.g. traffic accidents (principally the dip is not related to lunch, which at best deepens the dip).

Considering the alertness rhythm (Fig. 2.1) it is not remarkable that many investigations on the effects of light on alertness and arousal level have been carried out under (night) shift-work conditions because of the low level in e.g. arousal and the effects to be expected are the strongest. Figure 2.2 shows the effect of two lighting regimes on arousal as a function of time at work for shift-workers [2.8].

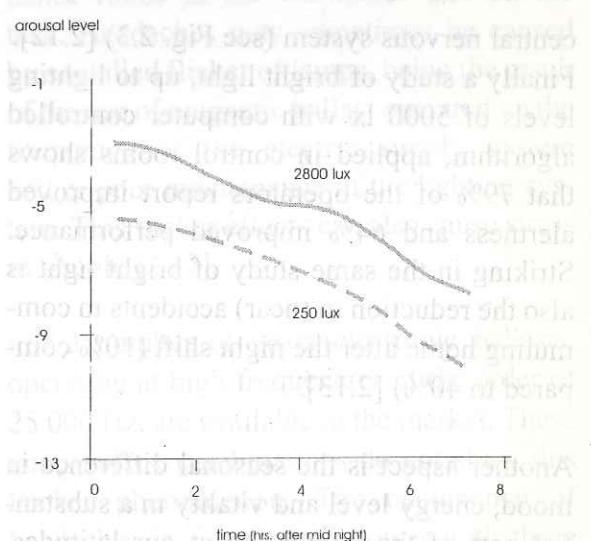


Figure 2.2 Mood expressed as arousal level for uniform lighting levels of 250 lux (o) and 2800 lux (●) as a function of number of working hours for night-shift workers (Boyce et al.)

A decline in arousal over the night occurs for both conditions, but the high-lighting regime results in a significantly increased arousal level.

Other studies show that the use of higher lighting levels to cope with fatigue results in staying longer alert [2.9], [2.10], [2.11]. This holds also for the composition of EEG's, containing less delta waves (which is an indicator for sleepiness) which means that bright light has an alerting influence on the

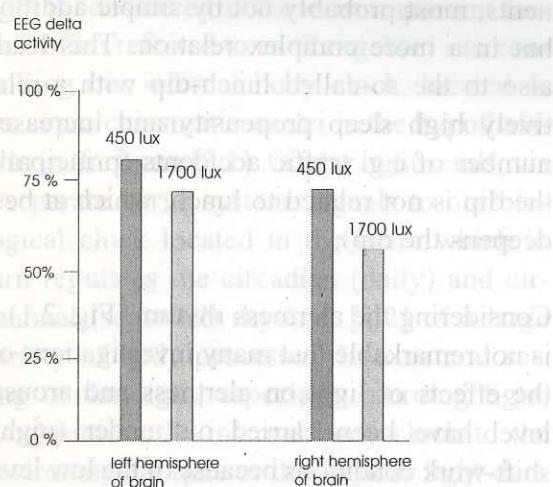


Figure 2.3 Delta activity in the EEG of office workers under lighting levels of 450 lx and 1700 lx (Kuller, Wetterberg)

central nervous system (see Fig. 2.3) [2.12]. Finally a study of bright light, up to lighting levels of 5000 lx with computer controlled algorithm, applied in control rooms shows that 79% of the operators report improved alertness and 64% improved performance. Striking in the same study of bright light is also the reduction in (near) accidents in commuting home after the night shift (10% compared to 40%) [2.13].

Another aspect is the seasonal difference in mood, energy level and vitality in a substantial part of the population at our latitudes. Studies with 145 (healthy) office workers (day shift, using for at least one hour/day a bright light desk luminaire providing 2500 lx) show 62% of the people reporting lesser

negative seasonal effects (on a VAS: Visual Analogue Scale), resulting in improved well-being, mood and energy level [2.14]. In other research studies stimulating effects of bright light have been found during daytime and night time aiming towards elevated levels in alertness and performance [2.11], [2.15], [2.16]. In wintertime the suppression of melatonin by electric light in the morning (so called dawn simulation) could play an important role, especially in the dark winter morning hours, as it will help people to overcome morning sleepiness. Direct stimulation could play a role in the dark afternoon hours to improve concentration and alertness.

Stress levels and complaints were studied in people working indoors under electric lighting only in comparison to people working under a combination of electric light and daylight. With artificial light only (same lighting level), hardly any difference is found in stress complaints between winter and summer [2.17]. However the stress in the group with the combined lighting was in summer substantially lower than in winter

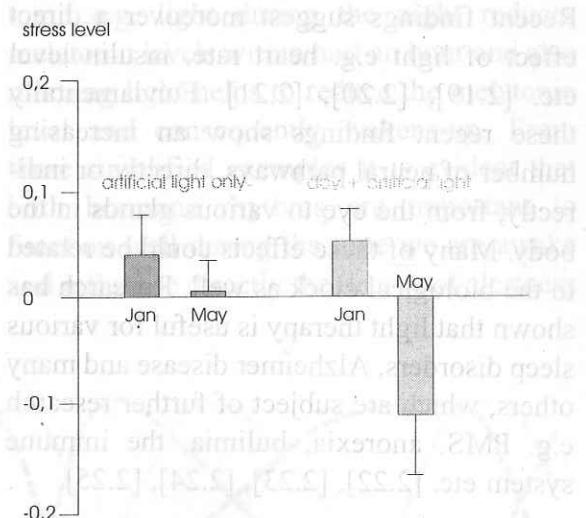


Figure 2.4 Stress levels in a group of workers working either under electric light only or under a combination of electric light and daylight (Kerkhof)

(see Fig. 2.4). It can be assumed that the high amount of the daylight component in summer contributes

to the reduced number of stress complaints. Bright light in winter as demonstrated in one of the above mentioned studies can most probably compensate this difference [2.14].

Light plays evidently an important role as good seeing conditions and a pleasant work place will stimulate positive mood and contribute through increased alertness to reduced accident rates and increased performance.

2.5 Daylight and electric light

Many of the mentioned positive effects are obtained as the result of medical and biological research projects proving that electric light can be as effective as natural light. However in the indoor environment usually the lighting levels are much lower than even the minimum lighting levels found outdoor which are in the order of 1000-2000 lx on a dull day (on a sunny day levels reach 100 000 lx). Indoor levels without daylight contributions are in the order of 100-500 lx only and usually depending on the (minimum) requirement in the standard or recommendations which are in most cases based on horizontal illuminance while for the biological effects the illuminance on the eye is relevant. Compared to daylight lighting levels the recommended illuminance values can be considered as „biological darkness“. Fortunately in many cases daylight contributions penetrate the buildings at least for a number of hours per day increasing the overall lighting levels substantially. Another difference between daylight and electric light is the dynamics in level and colour temperature of daylight which is missing in the (windowless) interior. It is generally accepted that these changes in daylight have a positive influence on mood and stimulate people. There is in case of electric light evidence that such changes by means of dynamic indoor lighting have a stimulating effect on people. An extensive study under office conditions has shown that people prefer high additional electric lighting in an office environment (average 800 lx on top of the

prevailing daylight contribution) [2.28]. If present installations all would meet the most recent lighting standards this would be an important step in realising healthy light in the workplace.

2.6 Effects of poor lighting quality

Although good quality lighting has positive effects on health, well-being and performance, it should also be emphasised that poor lighting can lead to negative effects even though people are not complaining on the quality of the lighting [2.29]. In the early nineties a lot attention is given to the so called Sick Building Syndrome: complaints of workers in office buildings on dry air, air quality, too high or too low temperatures, headache and irritated eyes and nose. In a survey in the Netherlands in 61 buildings half the people complain on air quality and 25% on health and well-being. About 30% of the people complain on the lighting [2.30]. Working in poor or low quality lighting can lead to eye strain and fatigue, influencing negatively the performance of the worker. In a number of cases it can lead to e.g. headaches [2.31]. Causes are in many cases a too low lighting level, glare from light sources and not well-balanced luminance ratios in the workplace and on the task. Headaches may sometimes be caused by so-called flicker of lamps, being the result of the use of magnetic ballast operated on the frequency of the electric supply system and/or poor maintenance of the lighting system. This flicker effects can also cause stress in people [2.32].

For a number of years electronic ballasts, operating at high frequencies in the order of 25 000 Hz, are available in the market. These lamp-ballast combinations do not show this flicker phenomenon. The occurrence of headaches is significantly lower with these types of ballast [2.31].

2.7 Final remark

In summing up it is evident that a good healthy condition, improving alertness, performance and mood will further decrease the accident rate, and have a positive effect on performance and consequently will also result in a lower absenteeism rate.

A good quality lighting, meeting both the visual and biological requirements, will contribute substantially to the productivity in the industrial processes as well as to the general health and well-being of the individual worker.

3 LIGHTING AND PRODUCTIVITY

In the previous part of this paper the relationships between lighting of good quality and visual performance, biological effects and a stimulating working environment have been discussed. Subsequently the consequences for work speed and failure rate for accident reduction, mood, alertness and health and well-being have been illustrated. All these factors together can have a considerable positive effect on the overall productivity.

It is evident that good mood and alertness together with a well maintained health condition of the industrial worker will further decrease the accident risks. Lower accidents in the industrial environment have, in turn, an additional positive effect on work performance. High work performance of course directly influences productivity in a positive sense. Added to this positive effect on productivity is the lower absenteeism which directly follows from the reduced accidents, improved mood and alertness, well maintained health and motivation connected to good-quality lighting.

Our preliminary evaluations of all data described in this paper lead to the following conclusion: Increasing the lighting level from the minimum required 300 lx to 500 lx

leads to an increased productivity

- based on conservative assumptions: 10-25%
 - based on probably more realistic assumptions: 10-40%
- but certainly to more than 10%.**

Nowadays most lighting installations in industry are hardly achieving the (minimum) required 300 lx. Those lighting installations consist most of the time of old fashioned bare battens with conventional electro-magnetic ballasts and standard fluorescent lamps. In the „better“ installations the battens are provided with a simple (white) metal reflector to prevent the light going to the ceiling.

A good quality installation would consist of a luminaire with an optical system that brings the light where it is really needed, provided with three-band fluorescent lamps with a colour rendering index of 80 or more, flicker-free operated on a high-frequency ballast.

Because of the higher lighting efficiency of such an installation, the far higher efficacy of the fluorescent lamps and the lower energy losses in the high-frequency ballast, energy savings up to 70% compared with the existing installation can be achieved. In such a case, increasing the lighting level from 300 lx to 500 lx would still result in a lower consumption of energy and thus to lower operating costs for lighting.

The investment for a better quality lighting installation and an increased lighting level of 500 lx will be paid back by the financial gain achieved by the increase in productivity within a very short period of usually (much) less than one year.

REFERENCES

References Chapter 1

- [1.1] Fortuin, G. J., „Visual power and visibility“, Philips Research Report 6, (1951)
- [1.2] Draft European Standard prEN 12464, „Lighting of work places“, (1998) (Comité Européen de Normalisation, CEN)
- [1.3] CIE Publication 29.2: „Guide on interior lighting“ (1986)
- [1.4] Lange, H., „Handbuch für Beleuchtung“, SLG, LiTG, LTG, NSVV, 5. Auflage, Ergänzung 1999
- [1.5] Fördergemeinschaft Gutes Licht, Dindustriele verlichting xxxxxxxxxxxx“, 19xx
- [1.6] Völker, S., „Eignung von Methoden zur Ermittlung eines notwendigen Beleuchtungsniveaus“, Dissertation, Ilmenau, 1999
- [1.7] Völker, S., Rüschenschmidt, H., und Gall, D., „Beleuchtung und Unfallgeschehen am Arbeitsplatz“, Zeitschrift für die Berufsgenossenschaften, 1995
- [1.8] Clements-Croome, D., et al., „An assessment of the influence of the indoor environment on the productivity of occupants in offices“, Design, constructions and operations of healthy buildings, ASHRAE, 1998
- [1.9] Preller, L., et al., „Gezondheidsklachten en klachten over het binnenklimaat in kantoorgebouwen“, Directoraat Generaal van de Arbeid, 1990
- [1.10] Wilkens, A. J., Nimmo-Smith, I., Slater, A., Bedocs, L., „Fluorescent lighting, headaches and eyestrain“, Lighting Research and Technology, 1989
- [1.11] Küller, R., Laike, T., „The impact of flicker from fluorescent lighting on well-being, performance and physiological arousal“, Ergonomics, 1998

References Chapter 2

- [2.1] Brainard, G.C., Effects of light on physiology and behaviour. Proceedings CIE session, New Delhi, 1996
- [2.2] OTA, Congress of the US, Biological rhythms. US DOCS Y. 3.T 22/2 2B 57/8
- [2.3] Czeisler, C.A., et al., Stability, precision and near-24-hour period of the human circadian pacemaker. Science 284, 2177-2281, 1999
- [2.4] Boulos, Z., et al., Light treatment for sleep disorders: Consensus Report VII Jet lag. Journal of biological rhythms, Vol.10, 1995
- [2.5] Colquhoun, W.P., et al. Shift work, Problems and solutions, Chapter 2. ISBN 3-631-49133-6, 1996
- [2.6] Mehrabian, A., Russell, J.A., An approach to environmental psychology. Cambridge, MA: MIT press, 1974
- [2.7] Mersch, P.P.A., et al. The prevalence of seasonal affective disorder in the Netherlands: A prospective and retrospective study of seasonal mood variation in the general population. Biol. Psychiatry 45 (1999) 1013-1022
- [2.8] Boyce, P.R., et al. Lighting the graveyard-shift: the influence of a daylight-simulating skylight on the task performance and mood of night shift workers. Lighting Research and Technology 29(3) 105-134 (1997)
- [2.9] Daurat, A., et al. Bright light affects alertness and performance rhythms during a 24-hour constant routine. Physics and behaviour, 1993
- [2.10] Grunberger, J., et al. The effect of biologically active light on the noo- and thymopsycne on psycho-physiological variables in healthy volunteers. Int. J. of Psychophysiology, 1993
- [2.11] Tops, M., et al. The effect of the length of continuous presence on the preferred illuminances in offices. Proceedings CIBSE Conference, 1998
- [2.12] Kuller, R., et al. Melatonin, cortisol, EEG, ECG and subjective comfort in healthy humans: impact of two fluorescent lamp types at two light intensities. Lighting Research and Technology, 1993
- [2.13] Baker, T.L., Use of circadian lighting system to improve night shift alertness and performance at the US Nuclear Regulatory Commission Headquarters Operations Centre. Proceedings ANS International meeting, Washington, 1995
- [2.14] Partonen, T., et al. Bright light improves vitality and alleviates distress in healthy people. Journal of Affective disorders 57 (2000) 55-61
- [2.15] Cajochen, C., et al. Dose response relationship for light intensity and ocular and electro-encephalographic correlates of human alertness. In press.
- [2.16] Zeitzer, M.Z., et al. Sensitivity of the human circadian pacemaker to nocturnal light: melatonin phase resetting and suppression. Journal of Physiology (2000), 526.3, pp. 695-702
- [2.17] Kerkhof, G.A., Licht en prestatie. Proceedings Symposium Licht en Gezondheid, Amsterdam, 1999
- [2.18] Mikellides, B., Emotional and behavioural reaction to colour in the built environment. Thesis Oxford, 1989
- [2.19] Ueyama, T., et al. Supra-chiasmatic nucleus: a central autonomic clock. Nat. Neuroscience (1999) 2(12) 1051-1053
- [2.20] Scheer, F.A., et al. Light and diurnal cycle affect human heart rate: possible role for the circadian pacemaker. Journal of Biological Rhythms 1999 (3) 202-212
- [2.21] Scheer, F.A., et al. Light affects morning salivary cortisol in humans. Journal of Clinical Endocrinological Metabolism 1999 (9) 3395-8
- [2.22] Lam, R., et al. Canadian consensus guidelines for the treatment of seasonal affective disorder. 1998.

- [2.23] Van Someren, E.J.W., Rest activities in ageing, Alzheimer's disease and Parkinson's disease. Thesis 1997
- [2.24] Lam, L.W., Light therapy for seasonal bulimia. American Journal of Psychiatry, 1989
- [2.25] SLTBR (Society for light treatment and biological rhythms. Various publications and bulletins)
- [2.26] Veitch, J.A. Full-spectrum lighting effects on performance, mood and health. National Research Council Canada, Internal Report No. 659, June 1994
- [2.27] Vallenduuk, V. The effects of variable lighting on mood and performance in an office environment. Graduation thesis, TUE Eindhoven, 1999
- [2.28] Begemann, S.H.A., et al. Daylight, artificial light and people in an office environment, overview of visual and biological responses. International Journal of Industrial Ergonomics 20 (1997) 231-239
- [2.29] Padmos, P. Adverse effects of fluorescent lighting on health and well-being ? A literature study (Dutch). TNO ISBN 90-5307-180-6 (1991)
- [2.30] Leijten, J., et al. Sick building blijft tol eisen. Klachten over kou en hoofdpijn klinken ook in nieuwe kantoren. Onderzoek Bouw 04/april 2000
- [2.31] Wilkins, A.J., et al. Fluorescent lighting, headaches and eyestrain. Lighting Research and Technology 1989
- [2.32] Kuller, R., et al. The impact of flicker from fluorescent lighting on well-being, performance and physiological arousal. Journal of Ergonomics, 1998

Paper presented at the International Conference

ILUMINATUL INDUSTRIAL, PRODUCTIVITATE, SĂNĂTATE ȘI CONFORT

Rezumat

În prezent, resursele umane sunt considerate în multe companii ca cel mai important bun. Din rațiuni atât economice cât și ale stării de sănătate și confort a oamenilor, siguranța, reducerea accidentelor și absenteismului au primit o atenție sporită. În multe țări sunt luate o serie de măsuri și există sau este în pregătire o legislație privind regulil de siguranță. Cu toate aceste eforturi, pierderile directe economice sunt în jur de 2,8-3,6% din PIB în țările membre, egale cu 100-200 milioane zile de muncă anual. De altfel, pe lângă tragediile

ILUMINAT 2001, June 28-30, 2001, Cluj-Napoca

personale, politicile UE și cele naționale se adresează costurilor sociale ale îngrijirii medicale și ale reintegrării muncitorilor după boală. Un alt aspect este cel al forței de muncă vârstnice, cu un grad mai mare de absenteism și o rată relativ ridicată de accidente fatale. Se remarcă o alunecare spre o societate de 24 ore, în special în procesele de producție intensivă și în organizații de servicii.

Competitivitatea globală contribuie de asemenea la creșterea procentului de activități de 24 ore în multe afaceri. Ca o consecință, muncitorii trebuie să desfășoare o activitate din ce în ce mai bună independent de momentul din zi.

Un bun iluminat al sarcinii și a locului de muncă este cerut pentru o optimizare a performanței sarcinii (vizuale), în special având

în vedere forța de muncă vârstnică. Efectele unui bun iluminat sunt chiar mai importante, din moment ce medicina a arătat în ultimele două decenii influența pozitivă a luminii asupra sănătății și a confortului, din moment ce lumina controlează ceasul biologic. Acest ceas al corpului reglează ritmul zilnic al proceselor fiziologice și psihologice, cum este nivelul secreției hormonale, starea de concentrare, forma psihică, ciclul treaz-somn, temperatura corpului și multe altele. Aceste aspecte ale unui bun iluminat industrial vor deveni mai importante în orpațiile de 24 de ore. Soluții de iluminat dedicate vor fi necesare.

Standardele de iluminat industrial actuale sunt bazate pe necesarul de lumină pentru desfășurarea eficientă a sarcinii vizuale. Cerințele luminotehnice sunt îndeplinite de iluminatul general al locului de muncă, eventual mărite cu un iluminat local al sarcinii/utilajului. Este evident că, în general, cerințele de calitate a iluminatului pentru industrie sunt mai scăzute decât, de exemplu, al celor pentru birouri. De altfel, multe sisteme de iluminat industriale sunt foarte vechi și depășite sub aspect economic și al calității. Ne-am aștepta la contrariul: cele mai bune sisteme de iluminat ar trebui să fie cele din mediul industrial, pentru productivitate îmbunătățită și din rațiuni de siguranță și sănătate. Un iluminat mai bun va contribui în mod pozitiv la mărirea vitezei și reducerea pierderilor de performanță, siguranță și rata accidentelor, absenteism, sănătate și confort.

În această lucrare este discutată importanța iluminatului industrial cu o calitate ridicată ca factor de îmbunătățire a productivității. Impactul luminii asupra vederii, performanței, stării de concentrare, confortului etc. sunt arătate în modelul ce va analiza pe baza cunoașterii actuale asupra relației lumină & vedere și lumină & sănătate.

În concluzie, iluminatul industrial va trebui să fie în atenția companiilor din punctul de vedere al economiei, sănătății și confortului muncitorului și politicii de sănătate publică și costuri.

1 ILUMINATUL INDUSTRIAL

Iluminatul industrial acoperă o gamă largă de spații interioare și sarcini de lucru: de la mici ateliere până la mari hale de producție, și de la lucrări de precizie până la sarcini de lucru industriale. În mediile industriale deseori trebuie să ne bazăm într-o măsură importantă doar pe iluminatul artificial. Acolo unde iluminatul natural neorbitor poate intra în zonele industriale, poate juca un rol important în obținerea unor iluminări satisfăcătoare în momentele când este disponibil. Este esențială o legătură bună cu iluminatul artificial. Există trei sisteme de iluminat artificial folosite în interioarele industriale: iluminatul general, iluminatul localizat și iluminatul pentru sarcini de lucru locale. Iluminatul general este proiectat pentru a produce o iluminare relativ uniformă pe întreaga arie a planului de lucru. În acele interioare unde aranjamentul pozițiilor de lucru este permanent, utilizarea iluminatului localizat, cu concentrarea iluminărilor mari în punctele de lucru, poate conduce la instalații mai eficiente din punctul de vedere al costurilor. Cerințele de iluminat pentru anumite sarcini de lucru pot fi atât de stringente încât nu este nici tehnic fezabil, și nici economic viabil să realizăm iluminarea doar folosind iluminatul general. Iluminarea sarcinilor de lucru locale este, astfel, folosită pentru a suplimenta iluminatul general.

1.1 Performanța vizuală și iluminarea

Calitatea iluminatului ar trebui să garanteze întotdeauna o performanță vizuală suficientă pentru sarcinile de lucru. Cercetarea cantității și calității iluminatului în ultimele decenii a arătat că îmbunătățirea calității iluminatului de la un nivel scăzut sau moderat crește viteza și acuratețea cu care obiectele pot fi detectate și recunoscute. Performanța vizuală reală a unei persoane este dependență de calitatea iluminatului și de abilitățile sale vizuale. În acest caz, vârstă este un criteriu important. Odată cu înaintarea în vîrstă, este necesară din ce în ce mai multă

lumină. Figura 1.1 reprezintă cererile relative de lumină pentru a citi o carte bine tipărită, în funcție de vârstă. Dacă cerința la vârsta de 10 ani este considerată 1, urmează că o persoană de 60 ani cere în medie de 15 ori mai multă lumină! Acest efect devine, desigur, din ce în ce mai important pe măsură ce forța de muncă îmbătrânește.

Figura 1.2 servește ca ilustrație a multor rezultate de cercetare relativ la influența calității iluminatului asupra performanței vizuale. Figura prezintă performanța vizuală relativă în funcție de nivelul de iluminat pentru sarcini de lucru de dificultăți diferite. Una pentru o sarcină de lucru moderată (ca, de exemplu, relevantă pentru lucrul general la o mașină) și o alta pentru o sarcină dificilă (ca, de exemplu, asamblare fină sau inspectare a culorilor). Pentru toate sarcinile este indicată o creștere clară a performanței vizuale dacă calitatea iluminării, în acest exemplu nivelul iluminării, crește. Din această figură devine, din nou, evident că efectul vârstei asupra performanței vizuale este foarte important. Pentru același nivel de performanță vizuală calitatea iluminării trebuie să fie mai mare pentru muncitorii mai vârstnici. Dar pentru sarcini vizuale dificile, iluminarea nu poate compensa complet efectul deteriorant al vârstei. Fiind dată creșterea în vârstă medie a forței de muncă pentru anii următori (20% creștere a grupului de vârstă cuprins în intervalul 50-65 ani în următorii 15 ani) aceasta înseamnă că, fără schimbări în nivelurile de iluminare, performanța muncitorilor va scădea. În grafic sunt indicate nivelurile de iluminat cerute pentru cele două sarcini de lucru, așa cum sunt specificate în propunerea de standard european a CEN [1.2]. Se arată că aceste cerințe ale CEN sunt, de fapt, conservatoare, mai degrabă decât prea pretențioase, dacă ținem seana de efectul vârstei.

O îmbunătățire în performanța vizuală produce, în schimb, o îmbunătățire în performanța de lucru. Această îmbunătățire este reflectată într-o producție mai mare și într-un număr mai mic de erori. Măsura în care o calitate mai bună a iluminatului

îmbunătățește performanța de lucru este, desigur, dependentă de componenta vizuală a sarcinii de lucru. O sarcină cu o componentă vizuală importantă va beneficia mai mult de condiții vizuale bune decât o sarcină cu o componentă vizuală mai puțin importantă.

Ca un exemplu, Tabelul 1 sumarizează din diferite publicații, pentru diferite sarcini industriale, creșterea în performanță de lucru și reducerea rebuturilor produse ca urmare a îmbunătățirii calității iluminatului. Figurile 1.3 și 1.4 sumarizează tendința generală a îmbunătățirii în performanță de lucru și reducerea erorilor împreună cu creșterea nivelului de iluminare.

1.2 Reducerea accidentelor și iluminatul

Accidentele sunt deseori o preocupare în mediul industrial. Rănilor fizice rezultate și angoasa mentală sunt uneori responsabile de pierderi considerabile în producție. Statisticile arată că numărul accidentelor industriale este în creștere. De exemplu, în Olanda, numărul înregistrat de accidente industriale este în creștere cu 40% de-a lungul ultimilor trei ani. Există dovezi clare că multe tipuri de accidente industriale pot fi evitate prin oferirea unor condiții vizuale mai bune. Într-un studiu german de simulare a accidentelor într-un depozit s-a arătat că la niveluri de iluminare mai ridicate pericolele potențiale au fost, într-adevăr, mai bine recunoscute [1.6].

Riscul unui accident este, de asemenea, redus când există o mai mare conștientizare a situațiilor potențial periculoase și când dispoziția, atenția și sănătatea muncitorului industrial sunt promovate printr-un iluminat de bună calitate (vezi și Capitolul 2). Acest efect poate fi important deoarece un număr considerabil de accidente sunt cauzate de un grad scăzut de concentrare și un grad ridicat de oboselă din partea muncitorului. Desigur, gradul în care numărul de accidente poate fi redus depinde foarte mult de tipul de industrie și de situația de mediu. Tabelul 2 prezintă gradul de reducere a accidentelor

pentru două din sarcinile industriale listate în Tabelul 1, unde au fost înregistrate îmbunătățirile de performanță și reducerile rebuturilor.

Figura 1.5, rezultând dintr-un alt studiu, prezintă numărul de accidente la locul de muncă în funcție de nivelul de iluminare pentru diferite tipuri de răni. Din nou, tendința este în mod evident de reducere a numărului de accidente împreună cu îmbunătățirea calității iluminatului.

În Figura 1.6 sunt combinate toate accidentele analizate în acest studiu. Devine foarte clar că locurile de muncă cu niveluri de iluminare între 50 și 250 lx sunt confruntate cu un număr relativ ridicat de accidente. Este important de notat că nu doar nivelul de iluminare, ci toate aspectele calității iluminatului joacă un rol în prevenirea accidentelor. Aceste aspecte de calitate vor fi abordate în mai mare detaliu în următoarea secțiune. Aici este suficient să menționăm că iluminatul neuniform poate crea probleme de adaptare care afectează vizibilitatea corespunzătoare. Orbirea excesivă conduce, de asemenea, la probleme severe de adaptare, cu toate consecințele negative ale acestora. Efectele stroboscopice ale iluminatului pot duce la situații periculoase în locuri unde este important ca părțile în mișcare ale mașinilor să fie văzute corect. Iluminatul operat în mod electronic prin înaltă frecvență elimină complet acest pericol potențial. și, finalmente, iluminatul cu proprietăți de culoare slabe poate conduce la judecarea în mod incorrect a unor situații potențial periculoase.

1.3 Iluminatul și mediul de lucru

În afară de influența pe care iluminatul o are asupra performanțelor vizuale, iluminatul are o influență și asupra mediului de lucru. Mediul global de lucru, dacă este corect proiectat, poate avea un efect stimulator asupra oamenilor care lucrează în acel loc [1.8]. Astăzi se acordă o mare importanță formatului și proiectării interioare a locului de muncă. Iluminatul poate avea aici un rol

important: în timp ce poate scoate în evidență elemente pozitive ale proiectării, poate să și distra gață atenția de la acestea, de exemplu printr-o redare slabă a culorilor sau prin efecte de orbire. Astfel de deficiențe conduc deseori la plângeri în legătură cu iluminatul [1.9]. A fost deja menționat că, dacă și când este disponibil, iluminatul natural poate avea un efect pozitiv important. În ceea ce privește aspectul cantitativ, acesta servește în cele mai multe locuri doar ca un supliment al iluminatului artificial. Efectul calitativ pozitiv este în special legat de "vederea de exterior" pe care o oferă. Ar trebui să se acorde o atenție specială efectelor secundare negative ale iluminatului natural cauzate de orbirea excesivă.

1.4 Cerințele unui iluminat de calitate

S-a arătat că pentru a permite oamenilor să realizeze sarcini vizuale eficiente, cu acuratețe și în siguranță, în special nivelul iluminării are o influență importantă. Totuși, și alte aspecte de calitate ale iluminatului, anume uniformitatea modelului de iluminare, restricția de orbire și redarea culorilor sunt foarte importante.

Iluminarea neuniformă, cu schimbări abrupte ale luminanței în jurul zonei de lucru, poate conduce la stres vizual și disconfort. Aceasta are legătură cu proprietățile de adaptare ale ochiului. O uniformitate suficientă a iluminării generale va asigura niveluri de iluminare suficiente de mari pentru a oferi o libertate completă în modul de plasare a mașinilor și locurilor de lucru.

Orbirea este senzația produsă de strălucirile în câmpul vizual mult mai mari decât strălucirea la care este adaptat ochiul. Aceasta poate conduce la o reducere a performanței vizuale și la disconfort. O orbire prea mare poate conduce chiar la dureri de ochi și de cap. Aceeași problemă poate apărea dacă există diferențe excesive între suprafețele din interior. Este, astfel, important să limităm strălucirea pentru a evita erorile, oboseala și accidentele. Gradul de restricție a orbirii depinde foarte

mult de calitatea optică a corpuriilor de iluminat folosite în combinație cu tipul de lampă folosit. Datorită dimensiunilor lor mari, lămpile fluorescente au luminanțe mai mici decât lămpile cu descărcare în gaz, de intensitate mare (lămpi cu mercur, sodiu și ioduri metalice, cu presiune mare). Este ușor de limitație orbirea cu lămpi având luminanțe mici.

Un obiect colorat este percepțut ca fiind astfel în virtutea faptului că reflectă doar o parte din lumina incidentă pe el. Vopseaua roșie, de exemplu, reflectă un procentaj mare din lungimile de undă roșii - cu cât mai mare este cantitatea de roșu din lumina incidentă, cu atât mai roșu este obiectul. Modul în care culorile din jurul nostru sunt redată este, astfel, puternic dependent de calitatele de redare a culorilor a iluminatului. Indicele de redare a culorilor; Ra, al unei surse de iluminat este măsura acestei calități. Ra poate avea valori de la zero (fără redarea culorilor) la 100 (redare excelentă a culorilor). Redarea corectă a culorii pielei umane este importantă în mod special. Iluminatul care face ca pielea să arate palidă și nesănătoasă deseori duce la plângeri. Prinț-o alegeră corespunzătoare a sursei de iluminat (redarea culorilor Ra de cel puțin 80), această problemă este ușor de evitat. Lămpile cu un indice de redare a culorilor mai mic decât 80 dau rezultate inaceptabile în interioarele unde oamenii lucrează sau locuiesc; acestea sunt inaceptabile din punctul de vedere al performanței lucrului, dar de asemenea inaceptabile din punctul de vedere al stării de spirit și dispoziției bune. Cerința pentru un Ra de 80 sau mai mult este în special importantă când se pune problema alegerii tipului corect de lampă tubulară fluorescentă, din cauza multitudinii de lămpi disponibile. Pentru mediile de lucru, doar acele lămpi fluorescente tubulare cu un cod de culoare de 830 sau mai mare satisfac această condiție.

Totuși, în practică, în aproximativ 80% din instalațiile de iluminat se utilizează surse de iluminat cu indici de redare a culorilor mult mai mici. Motivul este, deseori, costul inițial mai mic. Ar trebui să notăm că, totuși,

dacă costul total al instalației (inclusiv costul energiei) este luat în considerare, lămpile moderne cu redare bună a culorilor sunt mai economice.

Multe recomandări și standarde naționale și internaționale specifică numere ale calității iluminatului pentru toate aceste aspecte de calitate pentru o varietate mare de activități și interioare. Tabelul 3 sumarizează aspectele de calitate ale unei instalații de iluminat împreună cu cel mai important parametru al fiecărui aspect.

Că o ilustrare a calității care se cere în situații diferite, Tabelele de la 4 la 6 prezintă valorile cerute pentru trei tipuri de industrie: industria chimică, centralele electrice și industria tipografică. Aceste cerințe sunt valorile date într-un proiect de standard european (draft 1998) pentru locuri de muncă, care satisfac nevoile de performanță vizuale, confort și siguranță. Desigur, același standard specifică valori pentru multe alte tipuri de industrii. (Valorile specificate pentru iluminarea medie sunt numite și "valori ale iluminării de întreținere": valori sub care iluminarea medie pe suprafață specificată nu este permis să scadă).

Un criteriu de calitate rareori menționat în standarde este frecvența cu care lămpile sunt utilizate. Unii oameni acuză dureri de cap din cauza pâlpâirii lămpilor fluorescente operate pe balasturi magnetice (50 Hz). Lămpile fluorescente pe balasturi electronice moderne operate la frecvență înaltă (în jurul a 30.000 Hz) nu prezintă acest fenomen de pâlpâire. Într-un studiu comparativ s-a găsit că apariția durerilor de cap este, într-adevăr, semnificativ mai mică la utilizarea balasturilor electronice [1.10]. Pe baza influenței sale asupra modelului undelor de bază ale creierului (EEG), un alt studiu descrie lumina fluorescentă produsă de lămpile operate cu balasturi magnetice convenționale, ne-electronice ca o sursă potențială de stres [1.11]. Desigur, balasturile electronice de frecvență mare sunt, de asemenea, recomandate pentru că sunt mai eficiente și asigură o durată de viață mai mare a lămpilor decât în cazul lămpilor operate cu balasturi convenționale.

2 ILUMINATUL. EFFECTELE BIOLOGICE ALE ILUMINATULUI

2.1 Aspecte generale

Până acum câteva secole în urmă, viața omului a fost influențată de ciclul zi-noapte și de ritmul veghe-somn. O dată cu revoluția industrială și, în special, o dată cu descoperirea energiei electrice, societatea și-a extins gradual perioada activă a zilei, acum îndreptându-ne spre societatea activă timp de 24 de ore. Lucrul în schimburi, inclusiv schimbul de noapte, este deja de mulți ani aplicat în procesele de producție, de exemplu în industria metalurgică și alimentară și spitale. Astăzi, odată cu globalizarea activităților multor companii, a dezvoltării serviciilor IT și a numeroaselor călătorii intercontinentale, numărul oamenilor care nu lucrează după un program fix cunoaște o ascendență rapidă. În multe țări, o parte substanțială - 15% - 25% - a populației active lucrează într-o altă formă a programului schimbător, fie că este în producție, transporturi sau servicii.

Din timpuri străvechi, beneficiul efectului luminii (naturale) a fost bine cunoscut și utilizat, de exemplu în helioterapie. Terapia luminii în rezolvarea problemelor de sănătate a fost una din cele mai populare metode de terapie până în anii 1930, însă, odată cu inventarea penicilinelui, farmaceutica a trecut în frunte. Datorită importanței luminii în relație cu sănătatea și bunăstarea în ultimii 20-30 de ani, ea a fost redescoperită în urma multelor și variaților descoperirii biologice și cercetării medicale.

În mod normal noi considerăm ochiul ca un organ al vederii, însă, după descoperirea conexiunilor adiționale dintre ochi și creier, s-a evidențiat că lumina oculară mediază și controlează un mare număr de procese psihice și fiziologice umane. Cele mai relevante descoperiri privind efectele luminii oculare sunt:

- controlul ceasului biologic
- efectele directe (stimulative)
- influența asupra dispoziției.

2.2 Lumina și ceasul biologic

În noua știință a crono-fotobiologiei, lumina este considerată ca cel mai important factor - deseori denumit "Zeitgeber" - în controlul ceasului intern al organismului, localizat în nucleii chiasmatici localizați în hipotalamus [2.1]. Lumina oculară trimite prin intermediul unui sistem nervos separat, semnale ceasului nostru biologic localizat în creier, care determină ritmurile zilnice și anuale (sezoniere) [2.2] a unor variate procese ale organismului. Într-un cadru natural, lumina oculară, în special lumina răsăritului, sincronizează ceasul intern al organismului la ceasul naturii sau la ciclul de 24 de ore zi-noapte determinat de rotația Pământului. Fără lumină, acest ceas intern ar funcționa liber cu perioada de 24 de ore și 15 minute și, ca o consecință, ceasul intern va devia zi de zi, din ce în ce mai mult, de ceasul naturii [2.3]. Rezultatul ar fi acela al unui simptom similar cu cel întâlnit la călătoriile peste câteva fusuri orare [2.4].

În figura 2.1 sunt ilustrate câteva ritmuri umane tipice, de notat fiind faptul că acestea au fost netezite, astfel măscându-se anumite efecte (efectul temporar al foamei, setei etc.). Figura evidențiază doar câteva exemple: temperatura corpului, atenția și ritmul hormonal al cortizonului (hormonul stresului) și melantinina (hormonul somnului). Un alt aspect important este, de exemplu, ciclul somn-veghe, somnolența, obosalea, buna dispoziție și performanța.

Cei doi hormoni, cortizonul și melantonina, joacă un rol important în atenție și somn. Nivelul cortizonului crește dimineață pregătind corpul și mintea pentru o nouă zi de activitate. În același timp, nivelul melantoninei scade, reducând somnolența.

Melantonina este cunoscută popular ca hormonul somnului, inducând starea de somnolență. De exemplu, melantonina este utilizată ca somnifer pentru a rezolva problema diferenței de fus orar. Seară, creșterea nivelului melantoninei pregătește ciclul somnului și menține calitatea somnului în timpul nopții, ducând la începutul unei zile

cât mai fructuoase. Lumina are capacitatea de-a suprima direct producerea de melantonină, de exemplu lumina în timpul nopții reduce nivelul melantoninei în cursul unei jumătăți de oră și, de asemenea, lumina dimineții ajută la reducerea nivelului de melatonină, deci la trezire.

Plecând de la aceste exemple este evidentă importanța funcționării corecte a ambelor ritmuri hormonale de-a lungul timpului în care suntem trezi și influență directă asupra gradului de atenție (a se vedea de asemenea capitolul 2.4).

Corecta dozare și temporizare a luminii naturale este, deci, foarte importantă pentru a ține ceasurile extern și intern în fază unul cu celălalt, mai ales deoarece ceasul nostru intern reglează ritmul zilnic care este relevant în activitatea noastră cotidiană, cum ar fi atenția, somnolența, oboseala, buna dispoziție, performanța. [2.2]; [2.5].

2.3 Lumina și efectele directe de stimulare a organismului

Efectele stimulatoare directe ale luminii sunt recunoscute de aproape oricine, mai ales când comparăm vara și iarna, dar de asemenea și în ambianța interioară (de lucru). [2.18]. Aceasta este, parțial, un efect psihologic, dar aşa cum s-a ilustrat mai sus, comportamentul corporal își aduce contribuția la aceasta. Diferite niveluri ale luminii produc schimbări ale formei EKG-ului și, ca o consecință, influențează sistemul nervos central, rezultând astfel efecte asupra diferitelor funcții ale organismului. De asemenea, sunt influențate procesele organismului prin înlăturarea de către lumină a melantoninei (a se vedea mai sus).

Recentele descoperiri sugerează pe deasupra și efectele luminii asupra bătăilor inimii, nivelului de insulină etc. [2.19], [2.20], [2.21]. Aceste recente descoperiri arată în mod fundamental un număr crescut de căi nervoase directe sau indirecte de la ochi la diferite glande al corpului uman. Multe din aceste efecte pot fi la fel de bine raportate la ceasul biologic. Cercetarea a ară-

tat că terapia luminoasă este utilă în cazul diferitelor deregări ale somnului, bolii Alzheimer și multor altora, care sunt subiectul unor viitoare cercetări, ca de exemplu PMS, anorexia, bulimia, sistemul imunitar etc. [2.22], [2.23], [2.24], [2.25].

2.4 Lumină, bună dispoziție și atenție

Buna dispoziție este reflecția simțirii proprii, a stării fizice de bine sau de rău, iar mental, a te simți mai mult sau mai puțin în alertă [2.6]. Alți factori ce influențează dispoziția sunt, de exemplu, și vremea/sezonul [2.7], respectiv în cazul locului de muncă: vederea condițiilor și a ambianței (vizuale).

În domeniul industrial, atenția este de primă importanță deoarece este un factor nu numai pentru buna dispoziție ci și pentru performanță și evitarea accidentelor. Atenția este puternic influențată la un moment dat al zilei de un comportament endogen, aferent unui ceas biologic zilnic, (crescător dimineața, stabil la amiază și descrescător în timpul serii târziu) și de un comportament exogen, descrescător de-a lungul perioadei de trezire. Atenția subiectivă la un moment dat al zilei este combinația acestor două componente, mai puțin probabil ca o sumă a acestora, dar într-o relație mai complexă. Aceasta conduce, de asemenea, la aşa numitul dejun-lung (lunch-dip) cu o relativ înaltă înclinație spre somn și, de exemplu, cu un număr crescut de accidente de trafic.

Considerând ritmul atenției (fig. 2.1) nu este remarcabil că multe investigații ale efectelor luminii asupra atenției și nivelului de trezire au fost desfășurate în condițiile unui schimb de producție (de noapte), deoarece la nivel scăzut de trezire și efectele așteptate sunt mai puternice. Figura 2.2 arată efectul a două regimuri de iluminat în trezire ca o funcție de timpul de muncă pentru muncitorii din schimburi [2.8].

Un declin în trezire de-a lungul nopții apare pentru ambele condiții, dar regimul iluminării puternice se concretizează într-o creștere semnificativă a nivelului de trezire.

Alte studii arată că utilizarea unor

niveluri înalte ale iluminatului pentru a face față oboselii sunt conduc spre o stare prelungită de atenție [2.9], [2.10], [2.11]. Aceasta ține de asemenea de conținutul EKG-ului, cu mai puține unde delta (care este un indicator pentru somnolență), ceea ce înseamnă că lumina strălucitoare are o influență alertă asupra sistemului nervos central (a se vedea Fig.2.3) [2.12].

În sfârșit, un studiu al luminii strălucitoare, până la niveluri de luminare de 5000 lx aplicat în camere de control cu algoritm controlat de computer, arată că 75% dintre operatori au raportat o mărire a atenției, iar 64% și-au îmbunătățit performanța. Frapant în același studiu al luminii strălucitoare este reducerea accidentelor în cazul întoarcerii acasă după tura de noapte (10% comparativ cu 40%) [2.13].

Alt aspect este cel al deosebirilor sezoniere în buna dispoziție, nivelul energiei și vitalitatea a unei părți considerabile din populație la latitudinea noastră. Studiile cu 145 de funcționari (sănătoși, în tură de zi, folosind pentru cel puțin o oră pe zi un luminator cu lumină strălucitoare asigurând 2500 lx) arată că 62% dintre oamenii raportând mai puține efecte sezoniere negative (pe un VAS: Visual Analogue Scale), rezultând într-o stare de bună dispoziție îmbunătățită, dispoziție și nivel de energie [2.14]. În alte studii de cercetare, efectul stimulant al luminii strălucitoare a fost descoperit în timpul zilei și al noptii ducând spre niveluri înalte de atenție și performanță [2.11], [2.15], [2.16].

În timpul iernii suprimarea melatoninei de către lumina electrică a dimineții (aşa numita simulare a răsăritului) ar putea juca un rol important, în special în orele întunecate ale dimineții, deoarece va ajuta oamenii să depășească somnolența dimineții. Stimularea directă poate juca un rol în orele întunecate ale după-amiezei pentru a îmbunătăți concentrarea și atenția.

Nivelul de stres și nemulțumirile au fost studiate la oameni care lucrează în încăperi luminate electric, în comparație cu oameni lucrând sub o combinație de lumină electrică

și lumină a zilei. Numai cu lumină artificială (același nivel de iluminare) nu se observă nici o diferență în nemulțumirile legate de stres între iarnă și vară [2.17]. Oricum, stresul în grupul cu lumina combinată a fost pe timpul verii mult mai scăzut decât în iarnă (vezi Fig. 2.4).

Se poate presupune că o componentă mai mare a luminii naturale în timpul verii contribuie la numărul redus de plângeri legate de stres. Lumina strălucitoare în timpul iernii aşa cum s-a demonstrat într-unul din studiile mai sus menționate poate fi probabil compensată de această diferență [2.14].

Lumina joacă un rol important evident de vreme ce condițiile optice bune și un loc de muncă plăcut va stimula pozitiv buna dispoziție și va contribui prin atenție crescută la reducerea ratelor de accidentare și la creșterea performanței.

2.5 Lumina naturală și lumina electrică

Multe din efectele pozitive menționate sunt obținute ca un rezultat al unor proiecte de cercetare medicale și biologice dovedind că lumina electrică poate fi la fel de eficientă ca lumina naturală. În orice caz, nivelurile de iluminare în spațiile interioare sunt, de obicei, mult mai scăzute decât nivelurile de iluminare minime găsite în exterior, care sunt de ordinul a 1000-2000 lx într-o zi înnoarată (într-o zi însorită nivelurile ajung la 100.000 lx). Nivelurile din încăperile fără contribuție a luminii naturale sunt doar de ordinul a 100-500 lx și, de obicei, depind de cerințele minime conform standardelor sau recomandărilor care sunt în cele mai multe cazuri bazate pe iluminarea orizontală, în timp ce, pentru efectele biologice, este relevantă iluminarea pe ochi. Comparativ cu nivelurile luminii naturale, valorile recomandate ale iluminării pot fi considerate ca "întuneric biologic". Din fericire, în multe cazuri, lumina naturală pătrunde în clădiri cel puțin pentru un număr de ore pe zi, crescând per ansamblu în mod substanțial nivelurile de iluminare în interior. Altă dife-

rență între lumina naturală și lumina electrică este dinamica în nivel și temperatura celorii luminii naturale care lipsește în interiorul fără ferestre.

Este general acceptat că aceste schimbări în lumina naturală au o influență pozitivă asupra bunei dispoziții și stimulează oamenii. În cazul lumiilor electrice este evident că astfel de schimbări realizate cu ajutorul unui iluminat interior dinamic au un efect pozitiv în buna dispoziție și stimulant asupra oamenilor. Un studiu extensiv realizat în condiții de birou a arătat că oamenii preferă un iluminat electric adițional mai mare (în jur de 800 lx suplimentar față de contribuția luminii naturale care prevalează) [2.28].

Dacă instalațiile actuale ar fi la cele mai recente standarde de iluminare acesta ar fi un pas important în realizarea unei lumi sănătoase la locul de muncă.

2.6 Efectele unei slabe calități a iluminatului

Deși o calitate bună a iluminatului are efecte pozitive asupra sănătății, bunei dispoziții și performanței, ar trebui accentuat faptul că iluminatul insuficient poate conduce la efecte negative chiar și la persoane care nu se plâng de calitatea iluminatului [2.29]. La începutul anilor 90, o mai mare atenție s-a acordat aşa numitului Sindrom al Clădirii Bolnave, manifestat prin dureri de cap și iritații ale nasului și ochilor ale lucrătorilor din clădirile cu birouri cu aer uscat, temperatură prea mică sau prea mare. Într-un sondaj de opinie desfășurat în 61 de clădiri din Olanda, jumătate dintre ocupanți se plâgeau de calitate aerului, iar 25% pe motive de sănătate și bună dispoziție. În jur de 30% dintre intervievați au avut de obicei în privința luminii [2.30].

Desfășurarea activității în condiții de iluminare slabă poate conduce la forțarea ochilor și oboseală, influențând negativ performanțele muncitorilor. Într-un număr de cazuri poate conduce la dureri de cap [2.31]. Cauzele, în multe situații, sunt datorate unui

nivel de iluminare prea scăzut, strălucirea datorată surselor de lumină și a unor raporturi necorespunzătoare ale luminanței la locul de muncă și pe sarcină. Durerile de cap pot fi cauzate de multe ori de fenomenul de flicker al lămpilor, datorită utilizării balasturilor magnetice controlate în frecvență sau datorită unei mențenanțe necorespunzătoare a sistemului de iluminat. Acest efect de flicker poate de asemenea cauza și stres [2.32].

Balasturile electronice care lucrează la frecvențe înalte, de ordinul a 25.000 Hz, pot fi găsite în comerț de mai mulți ani. Aceste combinații lampă-balast nu prezintă fenomenul de flicker. Apariția durerilor de cap este semnificativ redusă cu aceste tipuri de balast [2.31].

2.7 Concluzii

În concluzie, este evident că condițiile bune de sănătate, atenția ridicată, performanța și buna dispoziție duc la scăderea ratei accidentelor și au o influență pozitivă asupra performanțelor, ceea ce va duce la o rată mai scăzută a absenteismului.

Bună calitate a iluminatului, înțelegând prin aceasta asigurarea cerințelor vizuale și biologice, va contribui substanțial la o mai bună productivitate în cadrul proceselor de producție industrială, ca și la o stare generală de sănătate și bună dispoziție a fiecărui muncitor în parte.

3 Iluminatul și productivitatea

În capitolele anterioare ale lucrării s-a discutat despre relația dintre calitatea iluminatului și performanțele vizuale, efectele biologice și mediul de lucru stimulativ. De asemenea, s-au ilustrat aspectele ce privesc viteza de lucru și rata eșecului la reducerea accidentelor, buna dispoziție, atenția și sănătatea. Toți acești factori împreună pot avea un considerabil efect asupra întregii productivități.

Evident că buna dispoziție și atenția, împreună cu o sănătate corespunzătoare a

muncitorilor din industrie, vor determina descreșterea riscului de accidentare. Accidentele ușoare în mediu industrial, au pe ansamblu un efect pozitiv în performanță. Înalta performanță de muncă, desigur, influențează direct productivitatea în sens pozitiv. La acest efect pozitiv asupra productivității se adaugă un absentism mai scăzut care duce în mod direct la scăderea accidentelor, îmbunătățește sănătatea și motivația pentru un iluminat de bună calitate.

Evaluările noastre preliminare la toate datele descrise în acest articol conduc la următoarea concluzie: creșterea nivelului de iluminare de la minimul cerut de 300 lx la 500 lx conduce la o productivitate mărită - cu 10 - 25%, bazat pe o prezumție conservativă;

- cu 10 - 40%, bazat pe o probabilă prezumție mai realistă, dar cu siguranță la mai mult de 10%.

În prezent, multe instalații de iluminat din industrie realizează cu dificultate nivelul (minim) cerut de 300 lx. Acele instalații de iluminat sunt realizate cu vechile corpuri de iluminat deschise (bare battens) cu balasturi electromagnetice convenționale și lămpi fluorescente convenționale. Într-o instalație "mai bună", corpurile de iluminat sunt prevăzute cu un reflector metalic (alb) pentru a preveni iluminarea tavanului.

O instalație de bună calitate va consta dintr-un corp de iluminat cu un sistem optic, care conduce lumina acolo unde este într-adevăr nevoie, prevăzut cu lămpi fluorescente trifosfor cu un indice de redare a culorii de 80 sau mai mult, cu balast electronic (fără flicker, ce operează în înaltă frecvență).

Datorită înaltei eficiențe a iluminatului unei astfel de instalații, precum și a eficiențăii lămpilor fluorescente și a pierderilor scăzute de energie în balastul de înaltă frecvență, economia de energie poate fi de 70% față de instalațiile existente. În astfel de cazuri, creșterea nivelului de iluminare de la 300 lx la 500 lx va păstra consumul de energie și costurile de operare pentru iluminat.

Investiția pentru o instalație de iluminat de o calitate mai bună și un nivel de iluminare mărit la 500 lx va fi recuperată prin câștigul financiar oferit de creșterea productivității într-o scurtă perioadă de timp, de obicei mai scurtă de un an.

I. Introducere

Traducere realizată de
Adrian GLIGOR
și Horațiu GRIF

CONCEPTION/DESIGN OF LIGHTING SYSTEMS FOR URBAN TRAFFIC ROADS

Cornel BIANCHI*,

Camelia BURLACU**

* Technical University of
Constructions, Bucharest

**ELECTRICA S.A., Bucharest

Abstract

The paper treats an up-to-date conception of lighting systems for medium and high speed traffic roads, based on international research, CIE norms and recommandations, corroborated with researches made by Lighting and Electrical Installations Chair within Bucharest Technical University of Constructions and by Romanian National Committee of CIE (CNRI). On this solid base, an approach structure is suggested. It starts with quantitative and qualitative aspects of urban luminous environment in connection with traffic specific requirements/criteria, tackling adequate solution/solutions step-by-step. It also realises necessary calculation structure regarding road luminance values, as well as drivers visual protection about physiological glare and psychological glare. So, an up-to-date treatment of road lighting systems designing is emphasized, that was also applied in Romania, during last years.

2.6 Efectele unei sisteme de iluminat a luminosului

1 Introduction

This paper suggests the evidence of modern conception of lighting systems for medium or high speed traffic ways (streets and highways). CIE (Commission Internationale d'Éclairage) researches, experience and recommendations are used, corroborated with experience and researches of Lighting and Electrical Installations Chair of Bucharest Technical University of Constructions (UTCB), Faculty of Installations.

2 Conception of lighting systems for traffic ways

Like any other lighting systems, recommended original structure of lighting systems for traffic ways requires a logical composition including the following component parts (Figure 1):

- A. specific requirements (criteria);
- B. determination of quantitative and qual-

itative components of luminous environment that can satisfy the needs of visual comfort, traffic security, functionality and connected esthetical aspects;


C. selection of system solution on the basis of relevant reasons from stages A and B;

D. quantitative calculations of lighting system on the basis of reference dimension: average luminance (\bar{L}) on road surface;

E. qualitative evaluation of lighting system from luminance distribution and visual field points of view.

Using this algorithm step-by-step, correct final solution can be reached, which can realize decisive quantitative and qualitative requirements.

In Figure 2, these specific criteria of lighting systems for medium and high speed traffic ways are shown; these criteria must be taken into account in conception of lighting systems.

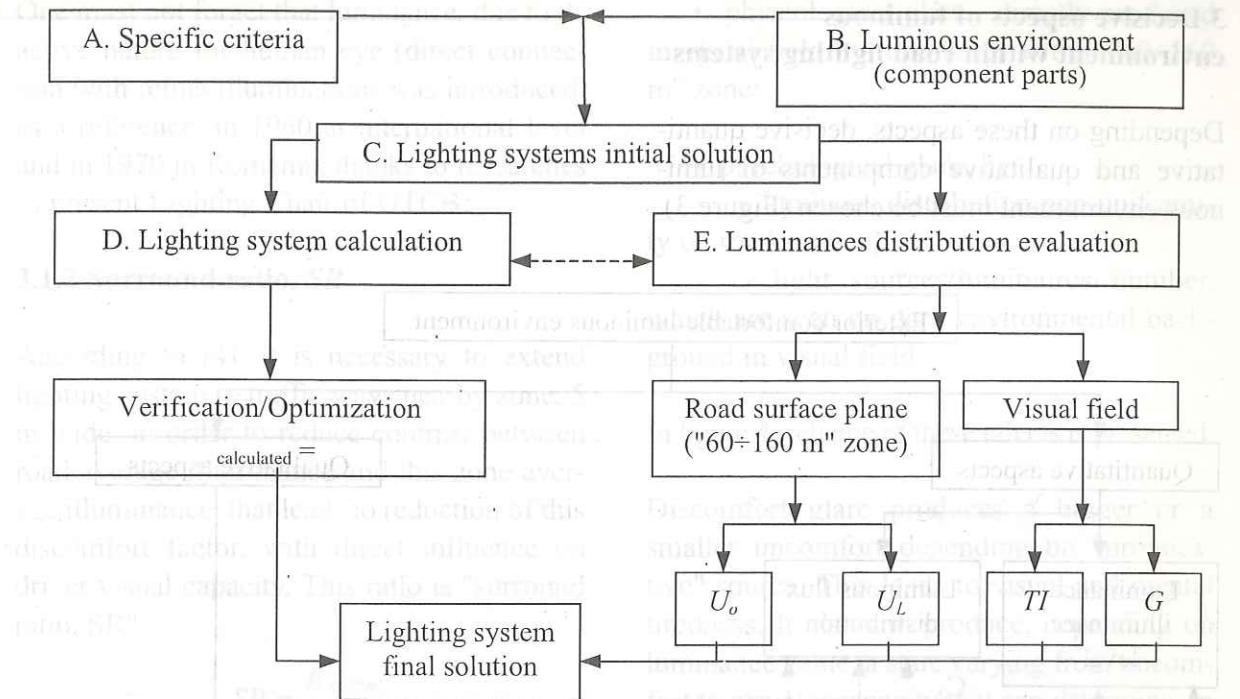

L - average luminance of road surface
 U_o - overall uniformity of road luminance
 UL - longitudinal uniformity of road luminance
 TI - threshold increment
 G - glare control mark

Figure 1 Structure of lighting systems conception approach for traffic ways


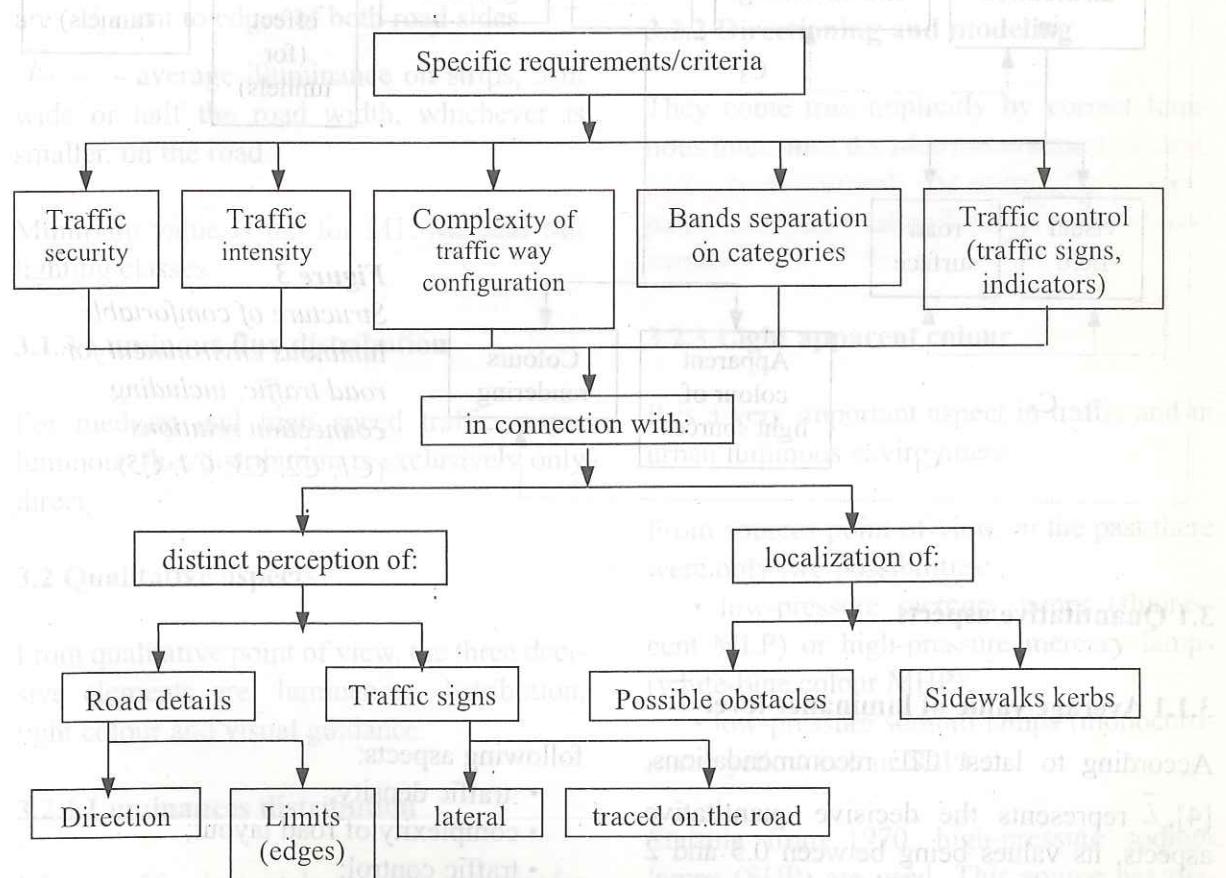


Figure 2 Specific criteria in road traffic

3 Decisive aspects of luminous environment within road lighting systems

Depending on these aspects, decisive quantitative and qualitative components of luminous environment must be chosen (Figure 3).

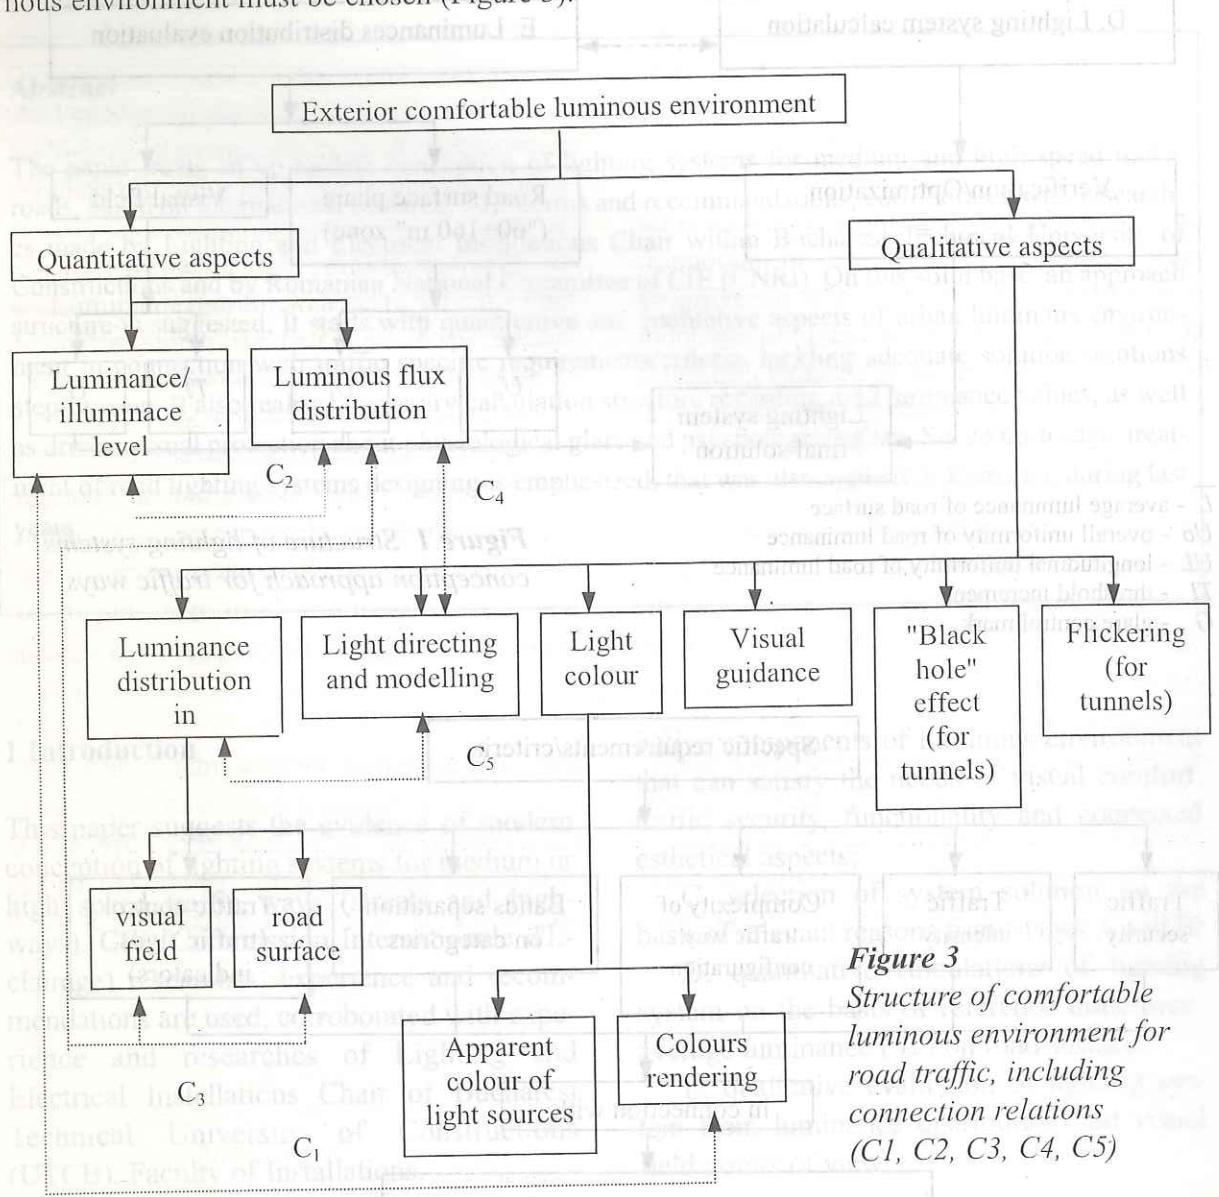

3.1 Quantitative aspects

3.1.1 Average value of luminance level \bar{L}

According to latest CIE recommendations, [4], \bar{L} represents the decisive quantitative aspects, its values being between 0.5 and 2 cd.m⁻², for different traffic ways categories (lighting classes: M1, M2, M3, M4, M5). Traffic ways are classified depending on the

following aspects:

- traffic density;
- complexity of road layout;
- traffic control;
- separation of different types of road users.

One must not forget that luminance, due to its active nature for human eye (direct connection with retina illumination) was introduced, as a reference, in 1960 at international level and in 1970 in Romania, thanks to researches of present Lighting Chair of UTCB.

3.1.2 Surround ratio, SR

According to [4], it is necessary to extend lighting system in traffic ways nearby zone, 5 m wide, in order to reduce contrast between road average illuminance and this zone average illuminance, that leads to reduction of this discomfort factor, with direct influence on driver visual capacity. This ratio is "surround ratio, SR":

$$SR = \frac{\bar{E}_{nz,5m}}{\bar{E}_{r,5m}} \quad (1)$$

where:

$\bar{E}_{nz,5m}$ - average illuminance on strips, 5 m wide or less if space does not permit, which are adjacent to edges of both road sides

$\bar{E}_{r,5m}$ - average illuminance on strips, 5 m wide or half the road width, whichever is smaller, on the road.

Minimum value is 0.5 for M1, M2 and M3 lighting classes.

3.1.3 Luminous flux distribution

For medium and high speed traffic ways, luminous flux distribution is exclusively only direct.

3.2 Qualitative aspects

From qualitative point of view, the three decisive elements are: luminances distribution, light colour and visual guidance.

3.2.1 Luminances distribution

It is one of fundamental qualitative aspects for obtaining traffic comfort and security, by avoiding the two types of glare:

- physiological glare, directly produced in visual field by luminaires within "60÷160 m" zone;

- psychological glare, by:

- luminous distribution non-uniformity on road surface;
- light sources/luminaires number, which are seen on dark environmental background in visual field.

In figure 4, scheme of these effects is presented.

Discomfort glare produces a bigger or a smaller discomfort depending on "provocative" source. This leads to visual and mental tiredness. It also can produce, depending on luminance value, a state varying from discomfort to visual incapacity that can determine, in extremis, impossibility to distinguish some road elements/structures. Finally, it can lead to control loss besides visual/mental perturbation.

3.2.2 Directioning and modeling

They come true implicitly by correct luminous intensities distribution structure of luminaires (non-uniform) and eventually by luminaires adequate orientation compared to road surface.


3.2.3 Light apparent colour

It is a very important aspect in traffic and in urban luminous environment.

From sources point of view, in the past there were only two possibilities:

- low-pressure mercury lamps (fluorescent MLP) or high-pressure mercury lamps (white-blue colour MHP);
- low-pressure sodium lamps (monochromatic yellow colour SLP).

Starting from 1970, high-pressure sodium lamps (SHP) are used. This source has distinct qualities from both visual-esthetical and energy performance points of view:

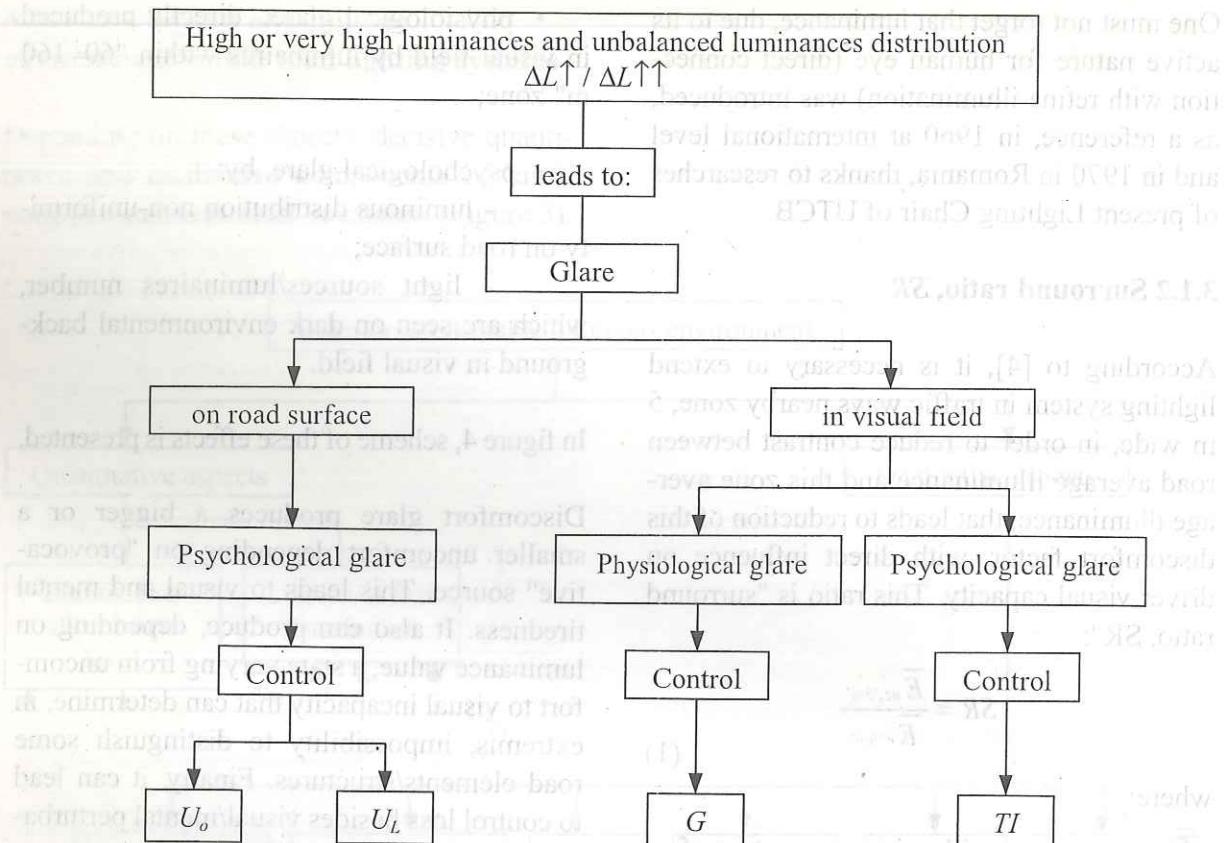

L - average luminance of road surface

U_o - overall uniformity of road luminance

U_L - longitudinal uniformity of road luminance

TI - threshold increment

G - glare control mark

- visual, thanks to spectral emission "evolute" curve that has maximum value approximately at the same wavelength as "relative visibility curve";

- yellow-gold colour of emission, that creates a exquisite pleasant, warm, attractive and esthetical environment;

- luminous efficacy is double compared to classical high-pressure mercury lamps and with 60÷80% higher than metal halide lamps and fluorescent lamps;

- lifetime (12000÷25000 h) is more than double compared to high-pressure mercury lamps and metal halide lamps.

High-pressure sodium lamp represents optimum solution from colour-visibility-aesthetics-energy consumption points of view, although colours rendering is low, aspect that is not generally irritating in evening/night conditions.

Figure 4 Effects of luminances non-uniform distribution

In Figure 5, qualities of high-pressure sodium lamp are presented. It must be mentioned that the new generation of high-pressure sodium lamp with xenon has a higher efficacy (with ≈20%) compared to standard variant.

3.2.4 Visual guidance

It is a very important qualitative aspect for traffic and can usually be realized by adequate solutions choice depending on road configuration (junction, curve, ramp).

Generally speaking, single-sided arrangement with luminaires along outside of the curve represents an optimum solution for narrow streets (Figure 6).

For wide streets curves, opposite arrangement represents a good visual guidance, compared to staggered arrangement that can create visual confusion (Figure 7).

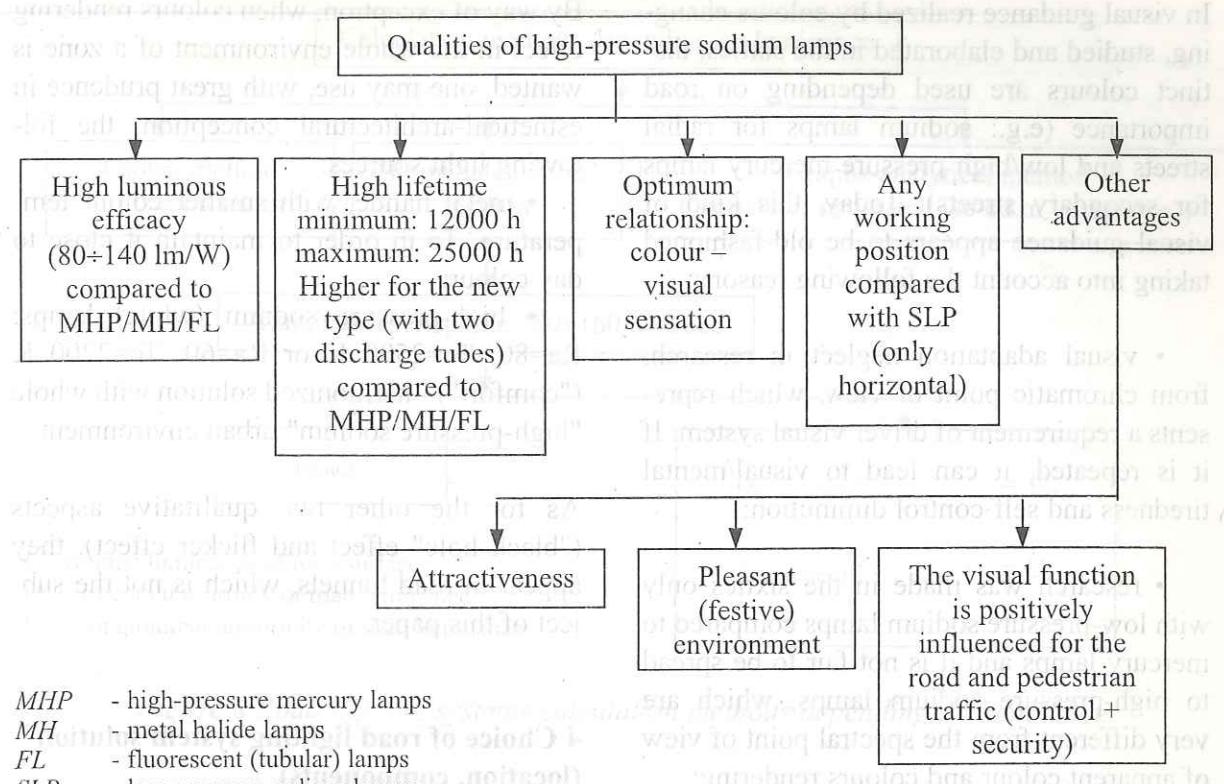


Figure 5 Qualities of high-pressure sodium lamp

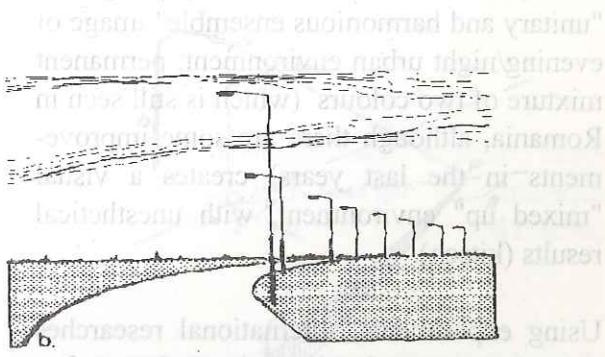
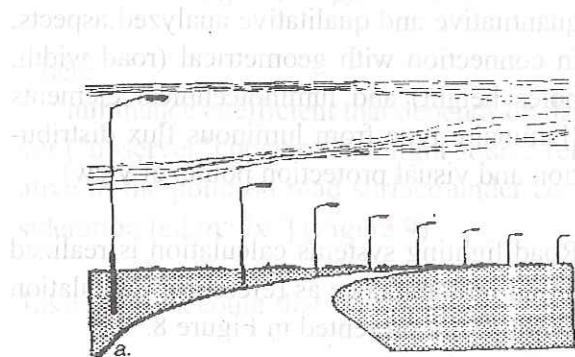


Figure 6 Visual guidance in curves for single-sided arrangement; a - luminaires along outside of curve (good); b - luminaires along inside of curve (confusion)

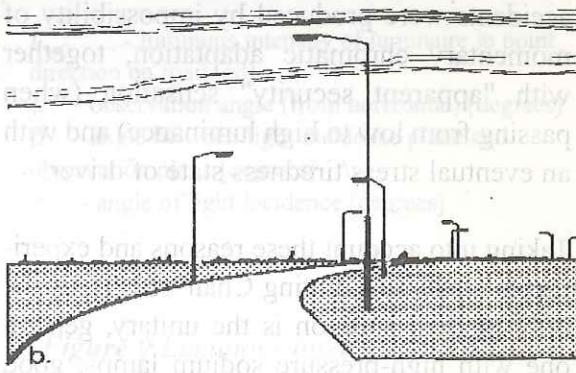
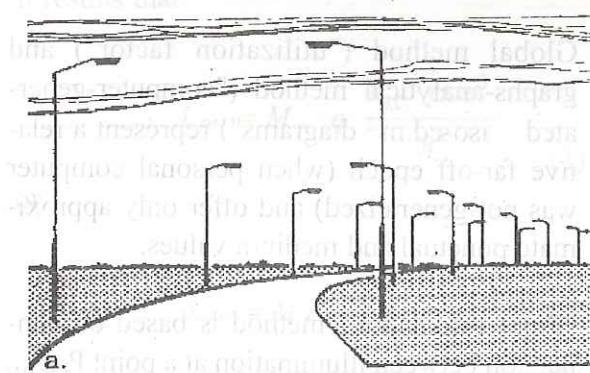


Figure 7 Visual guidance in curves for bilateral arrangement; a - opposite arrangement (good); b - staggered arrangement (confusion)

In visual guidance realized by colours changing, studied and elaborated in the sixties, distinct colours are used depending on road importance (e.g.: sodium lamps for radial streets and low/high pressure mercury lamps for secondary streets). Today, this kind of visual guidance appears to be old-fashioned taking into account the following reasons:

- visual adaptation neglect in research, from chromatic point of view, which represents a requirement of driver visual system. If it is repeated, it can lead to visual/mental tiredness and self-control diminution;
- research was made in the sixties only with low-pressure sodium lamps compared to mercury lamps and it is not fair to be spread to high-pressure sodium lamps, which are very different from the spectral point of view of apparent colour and colours rendering;
- permanent colours change degrades "unitary and harmonious ensemble" image of evening/night urban environment; permanent mixture of two colours (which is still seen in Romania, although there are some improvements in the last years) creates a visual "mixed up" environment, with unesthetic results (kitsch).

Using experiments, international researches proved an aspect harder to be understood at first interpretation: accident risk when passing from white-blue colour (mercury) with low luminance level to warm yellow colour with high luminance level (for main streets). These accidents were produced by impossibility of momentary chromatic adaptation, together with "apparent security" sensation (when passing from low to high luminance) and with an eventual stress/tiredness state of driver.

Taking into account these reasons and experiments made by Lighting Chair of UTCB, the only modern solution is the unitary, general one with high-pressure sodium lamps, good colours rendering not being necessary in traffic and urban environment.

By way of exception, when colours rendering effect in the whole environment of a zone is wanted, one may use, with great prudence in esthetical-architectural conception, the following light sources:

- metal halide, with smaller colour temperature, T_c in order to maintain it close to day colour;
- high-pressure sodium (white) lamps: $R_a=80$, $T_c=2500$ K or $R_a=60$, $T_c=2200$ K ("comfort") - harmonized solution with whole "high-pressure sodium" urban environment.

As for the other two qualitative aspects ("black hole" effect and flicker effect), they appear in road tunnels, which is not the subject of this paper.

4 Choice of road lighting system solution (location, components)

It is realized based on luminous environment quantitative and qualitative analyzed aspects, in connection with geometrical (road width, poles height) and luminotecnical elements (luminaire type from luminous flux distribution and visual protection points of view).

Road lighting systems calculation is realized based on luminance as reference. Calculation methods are presented in Figure 8.

Of course, "point calculation" method is the most used today in modern lighting software and offers pertinent and sure analysis possibility of whole "controlled" zone.

Global method ("utilization factor") and graphs-analytical method ("computer-generated iso- $cd.m^2$ diagrams") represent a relative far-off epoch (when personal computer was not generalized) and offer only approximate punctual and medium values.

"Point calculation" method is based on connection between illumination at a point P, E_{PH} and corresponding luminance, L_{PH} :

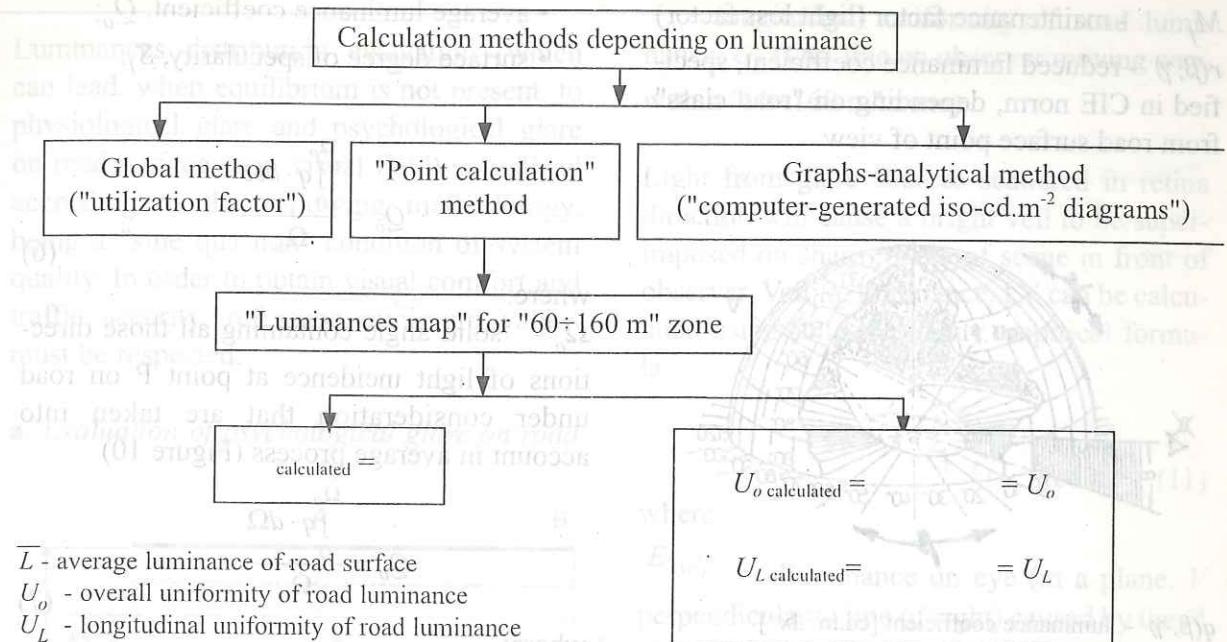


Figure 8 Road lighting systems calculation methods depending on luminance

Figure 11 Determination of U_o and U_L

$$L_{PH} = q \cdot E_{PH} [\text{cd.m}^{-2}] \quad (2)$$

where:

q - luminance coefficient that depends on driver ("observer") position and light source relative to the point on road surface under consideration [$\text{cd.m}^{-2}.\text{lx}^{-1}$] (Figure 9)

Taking into account that:

$$E_{PH} = M_f \cdot \frac{I_{\hat{\alpha},C} \cdot \cos^3 \hat{\alpha}}{h^2} \quad (3)$$


It results that:

$$L_{PH} = M_f \cdot q \cdot \frac{I_{\hat{\alpha},C} \cdot \cos^3}{h^2} \quad (4)$$

or:

$$L_{PH} = M_f \cdot \frac{I_{\hat{\alpha},C} \cdot r(\hat{\alpha}, \hat{\alpha})}{h^2} \quad (5)$$

where:

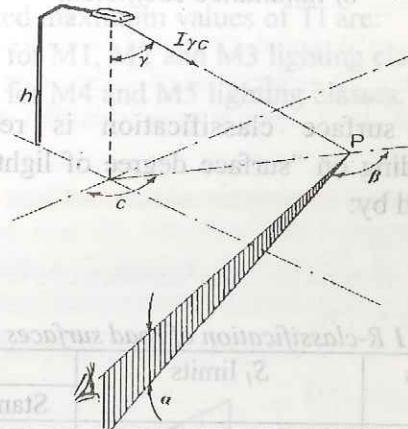

$I_{\hat{\alpha},C}$ - luminous intensity of luminaire in point direction on road [cd]


α - observation angle (from horizontal) [degrees]

β - angle between light incidence plane and observation plane [degrees]

γ - angle of light incidence [degrees]

Figure 9 Luminous intensity and decisive angles

M_f - maintenance factor (light loss factor)
 $r(\beta, \gamma)$ - reduced luminance coefficient, specified in CIE norm, depending on "road class" from road surface point of view.

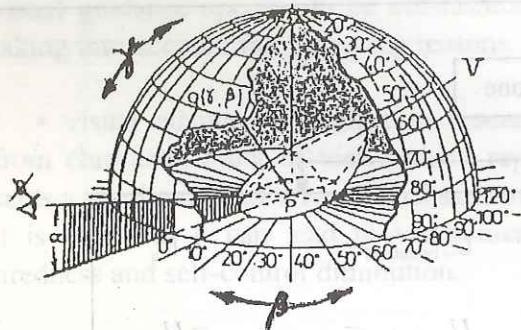

$q(\beta, \gamma)$ - luminance coefficient [$\text{cd} \cdot \text{m}^{-2} \cdot \text{lx}^{-1}$]
 α - observation angle (from horizontal) [degrees]
 β - angle between light incidence plane and observation plane [degrees]
 γ - angle of light incidence [degrees]
 V - volume of reflected intensities distribution

Figure 10 Spatial representation of luminance coefficient

Road surface classification is realized depending on "surface degree of lightness", defined by:

Table 1 R-classification of road surfaces (old)

Class	S_I limits	R system		Reflection type
		Standard S_I	Normalized Q_o	
R I	$S_I < 0.42$	0.25	0.10	diffuse
R II	$0.42 \leq S_I < 0.85$	0.58	0.07	approximately diffuse
R III	$0.85 \leq S_I < 1.35$	1.11	0.07	slightly glossy
R IV	$1.35 \leq S_I$	1.55	0.08	glossy

Table 2 C-classification of road surfaces (new)

Class	S_I limits	Standard S_I	Normalized Q_o
C I	$S_I < 0.4$	0.24	0.10
C II	$S_I \geq 0.4$	0.97	0.07

- average luminance coefficient, Q_o ;
- surface degree of specularity, S_I .

$$Q_o = \frac{\int_{\Omega_o} q \cdot d\Omega}{\Omega_o} \quad (6)$$

where:

Ω_o - solid angle containing all those directions of light incidence at point P on road under consideration that are taken into account in average process (Figure 10)

$$Q_o = \frac{\int_{\Omega_o} q \cdot d\Omega}{\Omega_o} \quad (7)$$

where:

$r(0,2)$ - reduced luminance coefficient for $\beta=0$ and $\gamma=2$
 $r(0,0)$ - reduced luminance coefficient for $\beta=0$ and $\gamma=0$

Depending on S_I and Q_o , road surfaces classification can be realized in:

- four classes, according to CIE old system (Table 1);
- two classes, according to CIE new system (Table 2).

5 Conclusion

Luminances distribution evaluation (which can lead, when equilibrium is not present, to physiological glare and psychological glare on road surface or in visual field) is realized according to the following methodology, being a "sine qua non" condition of system quality. In order to obtain visual comfort and traffic security, reference minimum values must be respected:

a. Evaluation of psychological glare on road

in the side for traffic illumination and security.

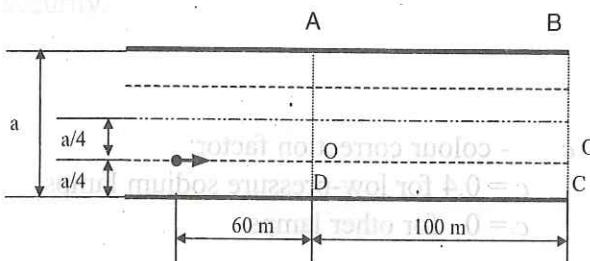


Figure 11 Determination of U_o and U_L

plane is realized using (Figure 11):

- overall uniformity of road luminance, U_o (ABCD surface);

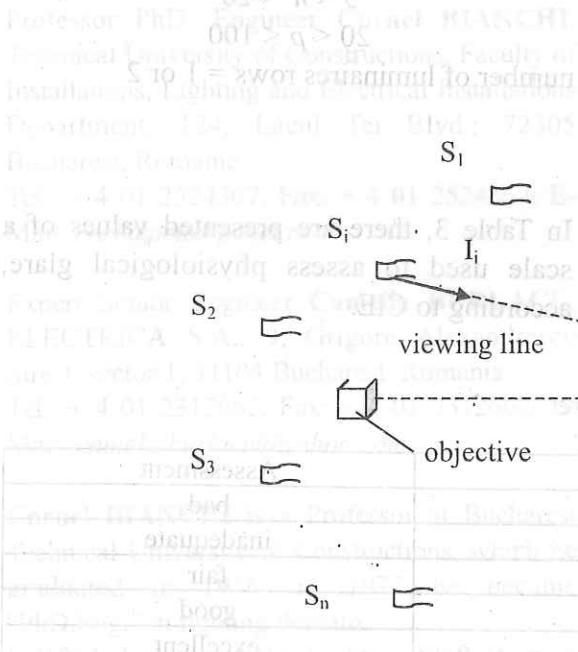


Figure 12 Determination of veiling luminance, L_V , on observer retina

- longitudinal uniformity of road luminance, U_L (OO' line on observer moving way, within "60÷160 m" zone).

Light from glare sources scattered in retina direction will cause a bright veil to be superimposed on sharp image of scene in front of observer. Veiling luminance, L_V can be calculated using Stiles-Holladay empirical formula:

$$L_V = k \cdot \sum_{i=1}^n \frac{E_{eye'i}}{\delta_i^2} [cd.m^{-2}] \quad (11)$$

where:

$E_{eye'i}$ - illuminance on eye (in a plane, V perpendicular to line of sight) caused by the i^{th} glare source, S_i [lx] (Figure 12)

θ_i - angle between viewing direction and direction of light incidence on eye of the i^{th} glare source, S_i [degrees]

k - age factor (for calculation purposes taken as 10)

Admitted maximum values of TI are:

- 10%, for M1, M2 and M3 lighting classes;
- 15%, for M4 and M5 lighting classes.

c. Evaluation of physiological glare
is realized using glare control mark, G.

After tests realized using a large number of observers, international research elaborated an empirical formula for G:(12) where:

$$G = 13.84 - 3.31 \cdot \log I_{80} + 1.3 \cdot (\log \frac{I_{80}}{I_{88}})^{0.5} - 0.08 \cdot \log \frac{I_{80}}{I_{88}} + 1.29 \cdot \log F + 0.97 \cdot \bar{L} + 4.41 \cdot \log h' - 1.46 \cdot \log p + c$$

I_{80} - absolute luminous intensity at an angle of 80° to downward vertical, in a vertical plane parallel to road axis [cd]

I_{80}/I_{88} - ratio of luminous intensities at an angle of 80° and at an angle of 88° to downward vertical, in a vertical plane parallel to road axis

F - orthogonal projected flashed area of luminaire in a direction of 76° to downward vertical, in a vertical plane parallel to road axis [m^2]

\bar{L} - average luminance of road surface
[$\text{cd} \cdot \text{m}^{-2}$]

h' - vertical distance between eye level and luminaire [m]

$h' = h - 1.5$, where h is luminaire mounting height [m]

p - number of luminaires per kilometer
[no. km^{-1}]

Formula for G is valid for following ranges of values:
 $50 < I_{80} < 7000$
 $1 < L < 50$
 $0.007 < F < 0.4$
 $0.3 < I_{80}/I_{88} < 7$
 $5 < h' < 20$
 $20 < p < 100$

number of luminaires rows = 1 or 2

In Table 3, there are presented values of a scale used to assess physiological glare, according to CIE.

Table 3 Scale used for assessing physiological glare

Index	Glare	Assessment
1	unbearable	bad
3	disturbing	inadequate
5	just admissible	fair
7	satisfactory	good
9	unnótticeable	excellent

5 Conclusions

This paper offers a modern conception structure of lighting systems for medium and high speed traffic roads (streets, highways, tunnels, passages) on the basis of decisive aspects:

- specific criteria of connection with luminous environment;
- calculation depending on luminance;
- evaluation of luminances distribution.

This is a complex modality that leads to accomplishment of a lighting system capable to provide for traffic luminous comfort and security.

References

1. Bianchi C., Luminotehnica, vol. I, II, Ed. Tehnica, Bucuresti, România, 1990
2. Bianchi C., s.a., Culoarea aparentă a luminii în sistemele de iluminat urban, Light & Lighting 2000 Proceedings, Bucuresti, România, 2000
3. Bommel, Van W.J.M., De Boer J.B., Road Lighting, PHILIPS Library, Eindhoven, Holland, 1980
4. CIE, Recommendation for the Lighting of Roads for Motor and Pedestrian Traffic, Publication no. 115, Vienna, Austria, 1995
5. PHILIPS, Lighting Manual, 5th Edition, Eindhoven, Holland, 1993
6. Manualul inginerului de instalatii, Partea I-a: Iluminat, în curs de aparitie
7. ASRO, ILUMINATUL CAILOR DE CIRCU-LATIE. Conditiile de iluminat pentru cai de circulatie destinate traficului rutier, pietonal si/sau ciclistilor si tunelurilor /pasajelor subterane rutiere, SD 13433:1999, Bucuresti, România, 1999

Paper presented at the International Conference ILUMINAT 2001, June 28-30, 2001, Cluj-Napoca

Professor PhD. Engineer **Cornel BIANCHI**, Technical University of Constructions, Faculty of Installations, Lighting and Electrical Installations Department, 124, Lacul Tei Blvd., 72305 Bucharest, Romania
Tel.: + 4 01 2524367; Fax: + 4 01 2524367; E-Mail: cnri@pcnet.pcnet.ro

Expert Senior Engineer **Camelia BURLACU**, ELECTRICA S.A., 9, Grigore Alexandrescu Street, sector 1, 71104 Bucharest, Romania
Tel.: + 4 01 2312662; Fax: + 4 01 2312662; E-Mail: cameliaburlacu@yahoo.com

Cornel BIANCHI is a Professor at Bucharest Technical University of Constructions, which he graduated in 1956; in 1972 he became "PhD.Eng." in lighting domain.

In 1964, he created the Lighting Staff (first in Romania) and in 1992 - the Lighting Chair, first in Romania and Eastern Europe.

Starting 1990, he is a leader of doctor's degree. From 1974 till 1992, he represented Romania at Division 3 of CIE; in 1999, he was awarded with

CIE Certificate.

Within CNRI (Romanian National Committee of CIE), he was the Vice-President between 1982 and 1990 and, starting from 1990, he is the President, representing Romania at the CIE General Assembly.

Camelia BURLACU is a Senior Expert Engineer at ELECTRICA S.A. Bucharest (Romanian Electricity Distribution Company).

In 1985, she graduated Polytechnic Institute from Iassy (Romania), Electrotechnical Faculty.

During the years, within ICEMENERG (Institute for Energy Research and Modernization) and CONEL (former Romanian National Electricity Company), she coordinated activities regarding lighting, DSM (Demand Side Management) projects, equipment maintenance within electricity distribution national network.

Starting from 1992 she is a member of CNRI (Romanian National Committee of CIE) and, from November 1999, she is the secretary for international relations of CNRI.

QUICK, RATIONAL AND ACCURATE LUMEN METHOD USING MINIMUM AVAILABLE DATA

Paul DINCULESCU
"Politehnica" University
of Bucharest

Abstract

One propose to patch together the various existing lumen methods and the CIE methods into a single, efficient, expeditious and more accurate method for the design and for the verification of a lighting installation in an interior by maintaining all their important particularities. The method uses analytical relationships for more accurate establishing of utilization factors for all room surfaces, using a minimum available data concerning the considered luminaire (i.e. flux code or the average luminous intensity distribution) and general data (average geometric multipliers for CIE reference room and luminaire arrangement, as a function of the room index). If the manufacturer does not supply the flux code, this may be easily calculated. The use of tabulated specific utilization factors and indispensable interpolations are avoided. The results are practically few different from those referring to a certain room shape and luminaire arrangement. The correction factors may be avoided. As for another methods, the proposed method applies to luminaires considered as point sources characterized by their average luminous intensity distribution.

1 Lighting installation models and denotements

The general model for interior general lighting calculations using the lumen method consists of a rectangular parallelepiped whereby the following diffusely reflecting surfaces are delimited (fig. 1):

- three material surfaces S_1, S_2, S_3 (the ceiling, the frieze and the four walls lumped together) characterized by their areas $A_1 = ab, A_2 = 2h'(a+b), A_3 = 2h(a+b)$ and reflectances r_1, r_2, r_3 ;
- the working plane S_4 (material or immaterial) surface, having an area $A_4 = ab$; due to the fact that it isn't always a continuous, homogenous surface, an equivalent reflectance r_4 may be given to it;
- an immaterial surface defined by the plane of luminaires S_5 .

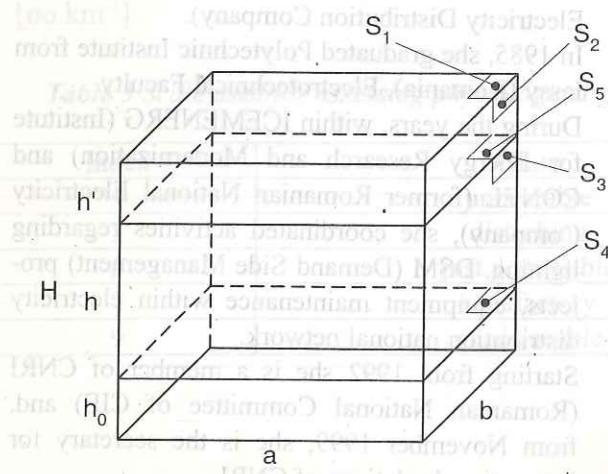


Figure 1 General calculation model

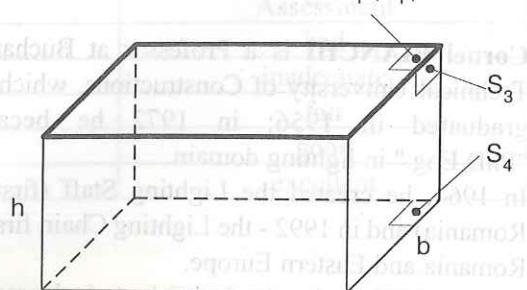


Figure 2 Simplified calculation model

To designate photometric characteristics and geometric characteristics the suffixes 1, 2, 3, 4 and 5 are respectively used.

Generally, illuminances on the room surfaces are given by the final luminous fluxes obtained as a result of the combined effect of direct- and interreflected fluxes.

One denotes: Φ_{lt} - installed lamp flux; Φ , Φ_U , Φ_O - installed luminaire fluxes (total, downward and utile respectively); $f = \Phi/A_4$, $f_U = \Phi_U/A_4$, $f_O = \Phi_O/A_4$ - flux densities of the interior (total, downward and utile respectively); Φ_c - luminous flux from a luminaire; Φ_{lc} - lamp flux of a luminaire; Φ_{0i} - direct fluxes, Φ_i - final fluxes; $Ui = \Phi_i/\Phi$ - utilances; $U_{ri} = E_i/f$ - reduced utilances; $u_i = \Phi_i/\Phi_{lt}$ - utilization factors; A_i - areas; $E_i = \Phi_i/A_i$ - final illuminances; r_i - (average) reflectances; N_1, N_2, N_3, N_4, N_5 - identifying numbers of a luminaire (flux code); $R_d = \Phi_{04}/\Phi_U$ - direct ratio of the installation [1, 2].

Room index $K = ab/h/(a+b)$, ceiling-cavity index $K_c = ab/h'/(a+b)$ and suspension height ratio $J = h'/(h+h')$ are defined (h - mounting height, h' - suspension height).

Form factor from a surface j to a surface i [3] is denoted by f_{ji} (sometimes substituted for q_{ji} to avoid confusion with flux densities).

Two simplified three-surface models may be used instead of the general model. In the simplified models the ceiling and the frieze (ceiling cavity) is substituted for:

a) a single flat surface S_1' (fig. 2) coinciding with the surface S_5 (flat equivalent ceiling) having the area A_1 and an equivalent reflectance r_{le} depending on r_1, r_2, K_c respectively on r_1, r_2, K, J [4, 5];

b) a single concave surface S_1' having the area $A_1 + A_2$ (concave equivalent ceiling) and the average reflectance r_c depending on A_1, A_2, r_1, r_2 [4, 5].

By comparing the three models described above, one can find that the general four-surface model is more complete but the relation for computation of the flux densities or illuminances are more complicated. More simple relations characterize the both simplified three-surface models and it follows from the calculation that they give identical results, very close to the general model results [5].

2 Comparison of different existing lumen methods used in lighting calculations

It has been shown [6] that in calculating the interior lighting the existing utilization factor methods are actually identical with the CIE methods [1, 2], all of them representing only versions on applying the general flux transfer theory, as it is briefly exposed in Annex.

With the same procedure for determining the direct flux distribution as well as by using properly calculated tables of coefficients and/or of utilization factors, both the CIE methods and any other version of the lumen method give identical results in calculating either final luminous fluxes or illuminances on the room surfaces. Despite all appearances, even coefficients for computing fluxes or illuminances are essentially the same.

All existing methods have as common traits:

- starting from a reference arrangement of luminaires in a reference interior;
- assumptions regarding evaluation of room reflectances, illuminance uniformity, interreflection circumstances.

Though, the CIE methods have important advantages such as:

- an accurate and quick determination, for any arrangement of luminaires and shape of the interior, either of direct fluxes or of their contribution to the final illuminances without necessarily calculate their own values;

- establishing and using the flux code of a luminaire as a main photometric datum (at least for symmetrical point sources);

- computation of illuminances on all room surfaces;

- eliminating the need to produce utilization factors table for each luminaire type.

Besides that, the CIE methods have some major disadvantages among which one can enumerate:

- they make use of some quantities not having an obvious physical meaning (e.g. installed flux density, reduced utilance, reduced utilization factor, exchange coefficient etc);

- they are difficult to understand and complicate to use;

- they require two sets of relationships used to design an respectively to verify an installation and therefore, two sets of tables for a single (and sometimes irrelevant) value of the suspension height ratio;

- many tables have been elaborated depending on a given luminaire classification to which many existing luminaires cannot be easily affiliated.

On the other hand, both the CIE methods and the other lumen methods use tabulated data (coefficients for computing flux densities, illuminances or final fluxes, values of utilances or of utilization factors). This is a reminiscence of times when calculation means were still rudimentary. Frequently the number of required tables is great enough. By using tables one must perform numerous uncomfortable interpolations and insert correction factors. Moreover, tables cannot cover all practical cases involved in lighting design.

Under the conditions of computer-aided design, it is preferable to dispose of analytical relationships to directly calculate the quantities of interest for any value of reflectances, of room index and of suspension height ratio.

3 Basic relations

For the reason above (§ 1), the common used model of an installation considers the luminaires mounted on a flat ceiling and the ceiling reflectance either r_1 (for $J = 0$) or r_{1e} (for $J \neq 0$).

Only three surfaces (denoted S_1, S_3, S_4) and the corresponding direct fluxes ($\Phi_{01}, \Phi_{03}, \Phi_{04}$) and final fluxes (Φ_1, Φ_3, Φ_4) are therefore taken into account.

For evaluating the interreflections one uses the form factors f_{ij} between room surfaces, based on the final flux distribution; the inertia of the human eye cannot allow the perception of each reflection separately.

By solving the set of simultaneous equations of flux transfer written for all model surfaces

$$\Phi_i = \Phi_{0i} + \sum_j f_{ji} r_j \Phi_j \quad (i=1,3,4; \quad j=1,3,4) \quad (3.1)$$

one can obtain the relationship either between direct and final fluxes or between flux densities and final illuminances:

$$[\Phi_0] = [C] \cdot [\Phi] \quad (3.2)$$

$$[f] = [D] \cdot [E] , \quad (3.3)$$

where $[\Phi_0]$, $[\Phi]$, $[f]$, $[E]$ are three-row vectors and $[C]$, $[D]$ result as square 3×3 numerical matrices.

The solution of the set (3.2), (3.3) may be written as

$$[\Phi] = [F] \cdot [\Phi_0] , \text{ where } [F] = [C]^{-1} , \quad (3.4)$$

$$[E] = [I] \cdot [f] , \text{ where } [I] = [D]^{-1} . \quad (3.5)$$

Coefficients [C], [D], [F] and [I] are expressed in terms of reflectances and, by means of form factors, of room index and suspension height ratio [4, 5]. This common approach can be considered as a source of all existing relationships that a number of countries have developed as their own individual methods in lighting calculations using the lumen method.

The points of difference from one method to another are confined in the main to:
a) the way that the direct flux distribution and interreflections are dealt with; b) the coefficients used; c) the quantities involved.

One can easily show (see Annex) that all these well-known methods used in lighting calculations for interior lighting may be derived from the basic relations above.

Each method comprises a number of specific tables of coefficients for classical ("manual") calculation of fluxes and/or illuminances.

4 Proposed method

4.1 Principles

Taking into account the exposed considerations both for and against concerning main lumen methods, it is useful to reexamine the present CIE methods in order to:

- patch the two methods together and maintain all their important particularities concerning especially the use of the flux code of a luminaire and calculation of direct fluxes;
- eliminate their useless particulars such as correction factors for unusual luminaire arrangements or where their values are too low to be taken into consideration;
- use quantities with an immediate physical meaning;
- make them more versatile (e.g. by reducing the number of formulas and/or tables);
- make them applicable by using computer-aided design by using either specific or general calculation programs (e.g. Mathcad, Matlab).

Such a revised method can be recommended as an *improved utilization factor method* that:
- is logical and conceptual simple;
- is closer to the physical meaning;
- needs only one set of relationship both for the design and for the verification procedure through the agency of utilization factors;

- can provide fluxes to all room surfaces;
- may also make use of a simplified model for the interior;
- uses only a single form factor (referring to rectangular parallel identical surfaces); one may dispense from exchange coefficients;
- may be conceived to provide procedures both for computer-aided design and for classical ("manual") calculations as well as for partly computer-aided calculations.

To perform either the design or the verification of an installation using the *utilization factor method based on the CIE methods*, the following technical data are needed: dimensions of the interior, room reflectances, luminous flux of a lamp (Φ_l), maintenance factor ($\delta < 1$), desired average illuminances on room surfaces (E_1, E_3, E_4), number of lamps in a luminaire (n_l). The Photometric Data Sheet (PDS) must contain luminous flux distribution of a luminaire only, in the form of flux code $N_1 \dots N_5$. If the manufacturer does not supply this datum, only the average luminous intensity distribution (shown preferably in tabular form or in the form of a polar diagram) is needed to calculate the flux code. Moreover, a table containing the average geometric multipliers must be available independently of the luminaire used. One exempts

from specific utilization factor(s) table.

At the beginning one may be content with a CIE reference arrangement of luminaires in a reference interior for which reference geometric multipliers are known (or may be calculated) in terms of room index. Should it be necessary to depart from the standard luminaire arrangement or from the reference shape of the interior, the actual arrangement and the actual shape can be considered in a second iteration and the actual geometric multipliers can be computed by using specific relationships and calculation programs. One finds that the results are practically few different.

Utilization factor defined for a surface S_i is the single quantity to be determined. The definition of the utilization factor (§ 1) gives the main relationship used in calculations:

$$u_i = \frac{\Phi_i}{\Phi_u} = \delta \frac{E_i A_i}{N_l \Phi_l}, \quad (4.1.1)$$

where N_l is the numbers of lamps in the installation. This simplest relationship serves both for the design and for the verification procedure.

Taking into account that, as in the CIE methods, there is no solution for any set of the three desired illuminances, in the design procedure it is preferable to consider firstly the requirement for the working plane only (and use the corresponding utilization factor), select the luminaire and the luminaire arrangement, then pass to the verification procedure and compare provided and given illuminances for all surfaces. If the requirements for the walls and the ceiling cavity are not achieved one can try to select another luminaire.

4.2 Calculation of the utilization factors

To calculate the utilization factors it is useful to adopt the simplified model of the installation (flat equivalent ceiling) and start from the relation (2.1.4).

The luminous flux Φ_l and respectively the illuminance E_l calculated by using the three-surface model refer to the equivalent ceiling. Therefore, the final flux on the ceiling-cavity surfaces has to be calculated for suspended luminaires by multiplying that flux by the coefficient of multiple reflections on the ceiling-cavity surfaces [4]:

$$\kappa_c = (K_c + 2)^2 / [(K_c + 2)^2 - 2(K_c r_1 + 2r_2)] \quad (4.2.1)$$

The reflectance of the equivalent ceiling may be calculated by the relationship [4]:

$$r_{le} = K_c (K_c r_1 + 2r_2) / [(K_c + 2)^2 - 2(K_c r_1 + 2r_2)] \quad (4.2.2)$$

The matrix $[C]$ in (2.1.4) has been found [4,II] as

$$[C] = \begin{bmatrix} 1 & -(1-f_{45}) \cdot K/2 \cdot r_3 & -f_{45} \cdot r_4 \\ -(1-f_{45}) \cdot r_{le} & 1 - [1 - (1-f_{45}) \cdot K] \cdot r_3 & -(1-f_{45}) \cdot r_4 \\ -f_{45} \cdot r_{le} & -(1-f_{45}) \cdot K/2 \cdot r_3 & 1 \end{bmatrix} \quad (4.2.3)$$

Using the conservation and reciprocity relationships between form factors [4,II], only form factor between parallel flat surfaces either f_{45} (the case of suspended luminaires) or f_{41} (ceiling mounted luminaires) is finally used:

$$f_{45} = \frac{2}{\pi} \cdot \left[\frac{\sqrt{a_*^2 + 1}}{a_*} \cdot \operatorname{arctg} \frac{b_*}{\sqrt{a_*^2 + 1}} + \frac{\sqrt{b_*^2 + 1}}{b} \cdot \operatorname{arctg} \frac{a_*}{\sqrt{b_*^2 + 1}} - \frac{1}{a_*} \cdot \operatorname{arctg} a_* + \frac{1}{2a_* b_*} \cdot \ln \frac{(a_*^2 + 1)(b_*^2 + 1)}{(a_*^2 + b_*^2 + 1)} \right], \quad (4.2.4)$$

where

$$a_* = \frac{a}{h} = \frac{\mu + 1}{\mu} K, \quad b_* = \frac{b}{h} = (\mu + 1)K; \quad \mu = \frac{b}{a} \quad (4.2.5)$$

A very good approximation is obtained by the relation:

$$f_{45} = \exp \left(-\frac{0,92}{K} \right) + \frac{0,02675}{K} - 0,011 \quad (4.2.6)$$

The relation:

$$f_{45} = \frac{\sqrt{K^2 + 1} - 1}{K} \quad (4.2.7)$$

also gives a good approximation.

Table giving f_{45} as a function of room index for standard rooms may be available as an alternative.

For ceiling mounted luminaires $r_{le} \rightarrow rI$, $f_{45} \rightarrow fI4$, $k_c \rightarrow 1$.

It follows from the calculations:

$$\begin{aligned} u_1 &= k_c \{ F_{11} + [F_{12} - F_{11} + (F_{13} - F_{12}) R_d] N_4 \} N_5 \\ u_3 &= \{ F_{21} + [F_{22} - F_{21} + (F_{23} - F_{22}) R_d] N_4 \} N_5 \\ u_4 &= \{ F_{31} + [F_{32} - F_{31} + (F_{33} - F_{32}) R_d] N_4 \} N_5 \end{aligned} \quad (4.2.8)$$

The direct ratio R_d is given by the relation:

$$R_d = M_1 N_1 + M_2 N_2 + M_3 N_3 + M_4, \quad (4.2.9)$$

where $M_1 \dots M_4$ (average geometric multipliers for the reference arrangement of luminaires in a standard room) are known as a function of room index [2].

Coefficients F_{ij} may be calculated by using relationships derived from the inversion of 3x3 matrices [4,III]. The simplest way consists in using the numerical matrix [C] by substituting the values of quantities involved and applying a fast method of inversion (e.g. MATHCAD or MATLAB procedures). Simple procedures are also used to calculate k_c , r_{le} , R_d (including interpolations for geometric multipliers corresponding to intermediate values of K) and finally utilization factors.

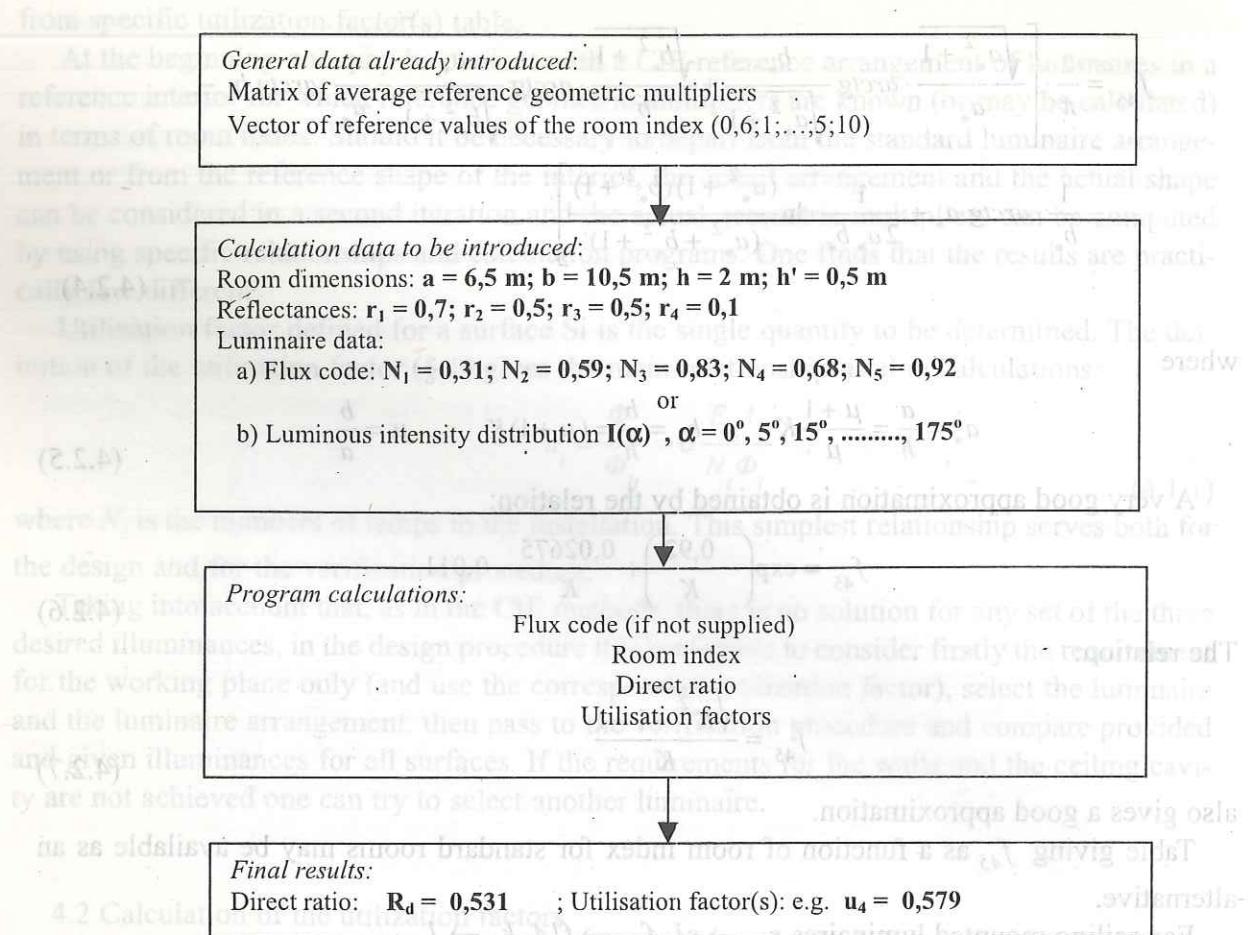


Figure 3 Calculation of direct ratio and utilization factors

To calculate the utilization factors it is useful to know the simplified model of the installation (flat equivalent ceiling). In this model the luminaires are considered as point sources located at the height of the ceiling. The luminaires are considered as point sources located at the height of the ceiling.

Denoting

$$\begin{aligned}
 B_{11} &= F_{11}, & B_{12} &= F_{12} - F_{11}, & B_{13} &= F_{13} - F_{12}, \\
 B_{21} &= F_{21}, & B_{22} &= F_{22} - F_{21}, & B_{23} &= F_{23} - F_{22}, \\
 B_{31} &= F_{31}, & B_{32} &= F_{32} - F_{31}, & B_{33} &= F_{33} - F_{32},
 \end{aligned} \quad (4.2.10)$$

equations (4.2.8) become

$$\begin{aligned}
 u_1 &= \kappa_c \{B_{11} + [B_{12} + B_{13} R_d] N_4\} N_5 \\
 u_3 &= \{B_{21} + [B_{22} + B_{23} R_d] N_4\} N_5 \\
 u_4 &= \{B_{31} + [B_{32} + B_{33} R_d] N_4\} N_5
 \end{aligned} \quad (4.2.11)$$

Tables with coefficients B_{ij} or F_{ij} calculated for certain reference combinations of room reflectances and room index values may be also available if classic ("manual") calculations are desired [7]. At least three tables are needed if the working plane is only considered. However, this practice eliminates the advantages offered by the analytical procedure described above.

As an example, figure 3 illustrates the main steps of a program used to calculate direct ratio and utilization factors

ANNEX

Particular procedures used with the lumen method

For simplicity, the discussion will be restricted to the relationships for the working plane.

For the working plane, the reduced utilance U_{r4} and the utilance U_4 are the same. Working plane utilization factor may be expressed as:

$$u_4 = U_4 N_5 ,$$

where N_5 is the light output ratio of a luminaire.

A.1. CIE Basic Method [1] and French (basic) Method [8]

From (2.5), it results for the working plane

$$E_4 = I_{31} f + I_{32} f_{\cup} + I_{33} f_u \quad (A.1.1)$$

respectively

$$E_4 = [I_{31} + (I_{32} + I_{33} R_d) N_4] f , \quad (A.1.2)$$

where $R_d = \Phi_{04} / \Phi_{\cup}$ is the direct ratio of the installation and $N_4 = \Phi_c / \Phi_{\cup}$

The expression

$$U_{r4} = U_4 = I_{31} + (I_{32} + I_{33} R_d) N_4 \quad (A.1.3)$$

gives the (reduced) working plane utilance.

The working plane utilization factor will be:

$$u_4 = [I_{31} + (I_{32} + I_{33} R_d) N_4] N_5 \quad (A.1.4)$$

A.2. French Applied Method [9]

Denoting

$$S = I_{31} + I_{32} N_4 , \quad R = I_{33} , \quad (A.2.1)$$

the expression (A.1.2) can be written as

$$E_4 = (R N_4 R_d + S) f = (R f_u^* + S) f , \quad (A.2.1)$$

where $f_u^* = f_u / f$ is the relative flux density on the working plane.

The (reduced) working plane utilance and the corresponding utilization factor are expressed as:

$$U_{r4} = U_4 = R f_u^* + S$$

$$u_4 = (R f_u^* + S) N_5 \quad (A.2.2)$$

A.3. Russian Method [10]

The general equations (2.1) for the three-surface model are written in the form:

$$\Phi_i = (\Phi_{0i} + \sum_{j=1}^2 q_{ij} r_j \Phi_j) \kappa_i , \quad (A.3.1)$$

where k_i is the coefficient of multiple reflections on the surface i . With a flat ceiling model $k_1 = k_4 = 1$, $k_3 > 1$.

It follows from (A.3.1) a set of simultaneous equations similar to (3.4) with the solution for the working plane:

$$\Phi_4 = A\Phi_{01} + B\Phi_{03} + C\Phi_{04}, \quad (\text{A.3.2})$$

where coefficients A, B and C are also expressed in terms of room reflectances and room index.

The utilization factor is given by:

$$u_4 = (A\Phi_{01} + B\Phi_{03} + C\Phi_{04})/\Phi_{ll} \quad (\text{A.3.3})$$

By employing (A.1.1) one has

$$\Phi_4 = E_4 A_4 = I_{31}\Phi_{01} + I_{32}\Phi_{03} + I_{33}\Phi_{04}$$

wherfrom

$$\Phi_4 = I_{31}\Phi_{01} + (I_{31} + I_{32})\Phi_{03} + (I_{31} + I_{32} + I_{33})\Phi_{04} \quad (\text{A.3.4})$$

By comparing (A.3.4) with (A.3.2), it is easily seen that:

$$I_{31} = A, \quad I_{31} + I_{32} = B, \quad I_{31} + I_{32} + I_{33} = C \quad (\text{A.3.5})$$

A.4. Transfer Factors Method [11]

The working plane utilization factor is given by

$$u_4 = D_1 T_{14} + D_3 T_{34} + D_4 T_{44} \quad (\text{A.4.1})$$

where $D_i = \Phi_{0i}/\Phi_{ll}$ denote distribution factors and T_{14} , T_{34} , T_{44} and are transfer factors between room surfaces.

Note the identity of equations (A.4.1) and (A.3.3) wherfrom

$$T_{14} = A, \quad T_{34} = B, \quad T_{44} = C \quad (\text{A.4.2})$$

A.5. British Zonal Method [12]

Using the downward and upward components of the flux from the installation to the working plane ($\Phi_{4\downarrow}$ and $\Phi_{4\uparrow}$), one can express the utilization factor as:

$$u_4 = U_{\downarrow}\eta_{c\downarrow} + U_{\uparrow}\eta_{c\uparrow}, \quad (\text{A.5.1})$$

where $U_{\downarrow} = \Phi_{4\downarrow}/\Phi_{ll}$ and $U_{\uparrow} = \Phi_{4\uparrow}/\Phi_{ll}$ are lower and upper flux utilances respectively and $\eta_{c\downarrow} = \Phi_{c\downarrow}/\Phi_{lc}$, $\eta_{c\uparrow} = \Phi_{c\uparrow}/\Phi_{lc}$ are downward and upward light output ratio of a luminaire (Φ_{lc} is the lamp flux of the luminaire).

It is easily to show that

$$U_{\downarrow} = (1 - R_d)T_{34} + R_d T_{44}; \quad U = T_{14} \\ E_4 = [(1 - N_4)U_{\uparrow} + N_4 U_{\downarrow}]f \quad (\text{A.5.2})$$

It follows from (A.5.2), (A.4.2) and (A.3.5) the general equation (A.1.2).

References

1. CIE Publication No 40. *Calculations for Interior Lighting. Basic Method*
2. CIE Publication No 52. *Calculations for Interior Lighting. Applied Method*
3. Dourgnon, J. *Les réflexions mutuelles entre surfaces diffusantes*. Revue d'optique; 38, 1959; No: 8; pp:365 - 394
4. Dinculescu, P. *O prezentare unitara a interreflexiilor in instalatiile de iluminat*. EEA-Electrotehnica, 38 (1990): I) nr. 2, pp. 65-70; II) nr.4, pp. 159-171; III nr.5, pp. 194-208
5. Dinculescu, P. *Calculations for Interior Lighting*. 8-th Conference "LIGHTING '90", Varna, 1990
6. Dinculescu, P. *On the Calculation of Average Illuminance in Various Existing Methods for Interior Lighting*. 6-th Conference "LIGHTING '84", Varna, 1984, pp. 81-86
7. Dinculescu, P. *Proiectarea instalatiilor de iluminat interior folosind tabele precalculate*. Energetica, Seria B, 41 (1993), nr. 6, p. 123-127
8. Norme ANFOR S 40-001. *Détermination des éclairements sur le plan utile et sur les parois*
9. Norme UTE 71-121, 1970. *Méthode simplifiée de pré-détermination des éclairements dans les espaces clos*
10. Epaneshnikov, M.M. *Elektricheskoe osveshchenie*. Moskow-Leningrad, Energiya, 1973
11. Bean, A.R. and Bell, R.I. *Calculation of Utilization Factors*. Lighting Research and Technology, 8, 1976, No. 4, pp. 200 - 210
12. IES Technical Report No. 2. *The Calculation of Utilization Factors. The BZ Method*. London, 1971

O VARIANTĂ RAPIDĂ, RATİONALĂ, EFICIENTĂ ȘI PRECISĂ A METODEI FLUXULUI LUMINOS, FOLOSIND UN MINIM DE DATE ȘI MATERIALE AUXILIARE

Rezumat

Se propune reunirea diverselor variante ale metodei factorilor de utilizare și metodelor propuse de CIE, într-o metodă unică, operativă și mai precisă de proiectare și verificare a instalațiilor de iluminat, reunind avantajele tuturor metodelor existente. Metoda are la bază relații analitice pentru calculul mai exact al factorilor de utilizare corespunzători suprafețelor încăperii, solicitând un număr minim de date luminotehnice inițiale specifice corpului de iluminat folosit (codul de flux CIE sau distribuția intensității luminoase) și generale (multiplicatorii geometrici medii de referință, în funcție de indicele instalației). Se elimină astfel necesitatea tabelelor cu factori de utilizare precalculați specifici fiecărui corp de iluminat, precum și a interpolărilor inerente. Amplasarea și configurația de referință conduc la rezultate acceptabile practic. Pentru instalații care se abat de la situația de referință, multiplicatorii geometrici se pot, de asemenea, calcula. Ca și toate celelalte proceduri existente, metoda se aplică în cazul asimilării corpurilor de iluminat cu surse punctiforme simetrice, caracterizate prin curba de distribuție medie a intensității luminoase.

1 Modelul de calcul al instalației de iluminat și notații

Modelul general pentru calculul iluminatului interior general folosind metoda factorului de utilizare (metoda fluxului luminos) este un paralelipiped în care se disting următoarele suprafețe perfect difuzante (fig. 1):

- trei suprafețe materiale S_1, S_2, S_3 (tavanul, friza și cei patru pereti considerați împreună) caracterizate prin ariile corespunzătoare $A_1 = ab, A_2 = 2h'(a+b), A_3 = 2h(a+b)$ și factorii lor

de reflexie r_1, r_2, r_3 ;

- planul de lucru (util) S_4 (suprafață materială sau materializată, nu totdeauna continuă și omogenă) având aria $A_4 = ab$, căreia i se poate atribui un factor de reflexie echivalent r_4 ;
- planul corpuriilor de iluminat S_5 (suprafață nematerială).

Pentru definirea caracteristicilor luminotehnice și geometrice se folosesc respectiv indicii 1, 2, 3, 4 și 5.

În general, iluminările pe suprafețele încăperii sunt date de fluxurile luminoase finale obținute ca efect combinat al fluxurilor directe și reflectate.

Se notează: Φ_{lt} - fluxul lămpilor instalate; Φ , Φ_{\cup} , Φ_{\cap} - fluxurile luminoase instalate (respectiv total, inferior și superior); $f = \Phi/A_4$; $f_{\cup} = \Phi_{\cup}/A_4$; $f_{\cap} = \Phi_{\cap}/A_4$ - densitățile de flux (respectiv totală, inferioară și superioară); Φ_c - fluxul luminos al unui corp de iluminat; Φ_{lc} - fluxul lămpilor dintr-un corp de iluminat; Φ_{di} - fluxurile directe, Φ_f - fluxurile finale; $Ui = \Phi_i/\Phi$ - utilanțele; $U_{ri} = E_i/f$ - utilanțele reduse; $u_i = \Phi_i/\Phi_{lt}$ - factorii de utilizare; A_i - ariile; $E_i = \Phi_i/A_i$ - iluminările finale; r_i - factorii de reflexie (medii); N_1, N_2, N_3, N_4, N_5 - indicatorii de distribuție ai corpului de iluminat; $R_d = \Phi_{04}/\Phi_{\cup}$ - raportul direct al instalației [1, 2].

Se definesc mărimile adimensionale: indicele instalației $K = ab/h/(a+b)$, indicele cavității tavan-friză $K_c = ab/h'/(a+b)$ și raportul de suspendare $J = h'/(h+h')$ (h - înălțimea de montare, h' - distanța de suspendare).

Factorul de formă al suprafeței j în raport cu suprafața i [3] se notează cu f_{ji} (notație înlocuită uneori cu q_{ji} , pentru a evita confuzia cu densitățile de flux).

Practica arată că în locul modelului general (cu patru suprafețe de calcul) se pot folosi două modele simplificate, cu câte trei suprafețe de calcul, în care tavanul și friza (cavitatea tavan-friză) sunt înlocuite cu:

a) o suprafață plană S_1' (fig. 2) care coincide cu suprafața S_5 (tavan echivalent plan) având aria A_1 și un factor de reflexie echivalent r_{1e} care depinde de r_1, r_2, K_c respectiv de r_1, r_2, K, J [4, 5];

b) o suprafață concavă S_1' având aria $A_1 + A_2$ (tavan echivalent concav) și factorul de reflexie mediu r_c depinzând de A_1, A_2, r_1, r_2 [4, 5].

Comparând cele trei modele descrise anterior, se constată că modelul general este mai complet, dar relațiile de calcul al densităților de flux sau iluminărilor sunt mai complicate. Ambele modele simplificate sunt caracterizate prin relații mai simple și, aşa cum rezultă din calcule, conduc la rezultate foarte apropiate de cele obținute prin folosirea modelului general [5].

2 Comparație între diversele variante existente ale metodei fluxului luminos

Așa cum s-a arătat [6], metodele factorilor de utilizare folosite în prezent sunt practic identice cu metodele CIE [1,2], reprezentând doar variante ale teoriei generale a transferului de flux luminos, aşa cum se arată pe scurt în Anexă.

Pentru aceeași procedură de determinare a fluxurilor luminoase directe, ca și prin folosirea corectă a tabelelor precalculate cu coeficienți/factori de utilizare, atât metodele CIE cât și orice altă versiune a metodei fluxului luminos conduc la rezultate identice în calculul fluxurilor luminoase finale sau al iluminărilor medii pe suprafețele încăperii. În ciuda aparențelor, chiar și diverse variante ale coeficientilor de calcul al fluxurilor sau iluminărilor sunt în esență aceleași.

Toate metodele existente au ca trăsături comune:

- considerarea inițială a unei amplasări de referință a corpurilor de iluminat într-o încăpere standard (de referință):

- ipotezele privind evaluarea factorilor de reflexie, uniformitatea iluminării, condițiile de schimb reciproc de flux luminos între suprafete.

Cu toate acestea, metodele CIE au avantaje importante cum ar fi:

- determinarea rapidă și precisă, pentru orice amplasare a corpurilor de iluminat și orice configurație a încăperii, fie a fluxurilor directe, fie a contribuției lor la iluminările finale, fără a calcula în mod obligatoriu valorile respective;

- folosirea codului de flux al corpului de iluminat ca principală dată luminotehnică (cel puțin pentru sursele de lumină punctiforme simetrice):

- calculul iluminărilor pe toate suprafetele încăperii;

- eliminarea necesității câte unui tabel cu factori de utilizare pentru fiecare corp de iluminat.

Pe lângă aceasta, metodele CIE prezintă dezavantaje importante, printre care se pot enumera:

- utilizarea unor mărimi fără o semnificație fizică directă (de exemplu, densitățile de flux instalat, utilanțele reduse, factori de schimb tec);

- sunt mai dificil de înțeles și de aplicat;

- necesită două seturi de relații folosite pentru proiectarea respectiv verificarea unei instalații și, prin urmare două seturi de tabele pentru o anumită (și uneori nerelevantă) valoare a factorului de suspendare;

- multe tabele sunt întocmite pe baza unei clasificări a corpurilor de iluminat, la care corpurile reale nu se pot afilia totdeauna.

Pe de altă parte, atât metodele CIE, cât și alte variante ale metodei fluxului luminos au la bază folosirea de date tabelate precalculate (coeficienți pentru calculul densităților de flux, iluminărilor sau fluxurilor finale, valori ale utilanțelor sau ale factorilor de utilizare), reminiscentă a vremurilor când mijloacele de calcul erau rudimentare. Deseori, numărul tabelelor necesare este destul de mare. Folosirea tabelelor implică numeroase și inconfortante interpolări, precum și introducerea de coeficienți de corecție. De asemenea, tabelele nu pot acoperi toate cazurile practice dintr-o instalație de iluminat.

În condițiile proiectării asistate de calculator, este preferabil să se dispună de relații analitice care să permită calculul direct al mărimilor care prezintă interes, pentru orice valori ale factorilor de reflexie, ale indicelui instalației sau ale raportului de suspensie și pentru orice corp de iluminat.

3 Relații de bază

Pe baza considerațiilor precedente (§ 1), cel mai uzitat model de calcul consideră corpurile de iluminat montate pe un tavani plan având factorul de reflexie fie r_1 (pentru $J = 0$), fie r_{1e} (pentru $J \neq 0$). În consecință, trebuie considerate numai trei suprafete de calcul (S_1, S_3, S_4) și fluxurile corespunzătoare directe ($\Phi_{01}, \Phi_{03}, \Phi_{04}$) și finale (Φ_1, Φ_3, Φ_4).

În vederea evaluării interreflexiilor, se folosesc factorii de formă f^{ij} între suprafetele încăperii, deoarece inerția ochiului nă permite perceperea separată a fiecărei reflexii.

Rezolvând sistemul de ecuații referitoare la schimbul de flux scrisă pentru cele trei suprafete ale modelului (3.1), se obțin relațiile fie între fluxurile directe și fluxurile finale, fie între densitățile de flux și iluminările finale (3.2, 3.3) unde $[\Phi_0], [\Phi], [f], [E]$ sunt vectori cu trei coloane iar $[C], [D]$ sunt matrice numerice 3×3 .

Soluțiile sistemelor (3.2), (3.3) pot fi scrise sub forma (3.3, 3.4).

Factorii $[C]$, $[D]$, $[F]$ și $[I]$ se determină în funcție de factorii de reflexie și, prin intermediul factorilor de formă, în funcție de indicele instalației și de raportul de suspendare [4,5].

Această abordare este sursa tuturor relațiilor pe care diverse țări le-au stabilit ca propriile metodologii de calcul folosind metoda fluxului luminos. Diferențele principale între acestea constau în: a) modul de operare cu distribuția fluxurilor directe și cu interreflexiile; b) factorii (coeficienții) folosiți; c) mărimele care intervin.

Se poate arăta ușor (a se vedea Anexa) că toate metodologile ("metodele") cunoscute folosite în calculul iluminatului interior pot fi deduse din relațiile de bază prezentate mai sus.

Fiecare "metodă" conține un număr de tabele specifice de factori (coeficienți) folosiți pentru calculul clasic ("manual") al fluxurilor luminoase și/sau al iluminărilor.

4. Metoda propusă

4.1 Principii

Având în vedere considerațiile pro și contra, expuse mai sus, privind metoda fluxului luminos, devine utilă reexaminarea celor două metode CIE existente în sensul de a reuni metodele respective și variantele uzitate ale metodei factorilor de utilizare, menținând particularitățile importante ale fiecărei, în special în privința utilizării codului de flux (indicatorilor de distribuție) pentru un corp de iluminat și calculul fluxurilor directe, rezultând o metodă care să realizeze:

- eliminarea particularităților inutile, cum ar fi factorii de corecție pentru amplasări ale corpurilor de iluminat diferite de cea de referință sau cei cu valori prea mici pentru a fi luate în considerație în practică;

- folosirea de mărimi cu semnificație fizică nemijlocită;

- operativitate și suplete, de exemplu prin reducerea numărului de formule și/sau de tabele sau eliminarea unora dintre acestea;

- adaptarea la proiectarea asistată de calculator, cu folosirea unor programe de calcul atât specifice cât și generale (de exemplu MATHCAD, MATLAB).

O astfel de metodă poate fi recomandată ca o variantă îmbunătățită a metodei factorului de utilizare care reunește calitățile tuturor celorlalte metode și care:

- este logică și simplă;

- este mai apropiată de semnificația fizică;

- necesită un număr minimal de date de catalog inițiale, renunțându-se la tabele cu valori precalculate, specifice fiecărui corp de iluminat;

- necesită un singur set de relații atât pentru problema de proiectare cât și pentru problema de verificare a unei instalații, care pot fi extinse la orice amplasare a corpurilor de iluminat și orice încăperie;

- permite determinarea fluxurilor luminoase și a iluminărilor pe toate suprafețele încăperii;

- folosește un singur factor de formă (pentru două suprafețe paralele identice), eliminându-se coeficienții de schimb;

- poate fi folosită atât pentru proiectarea asistată de calculator cât și pentru proiectarea clasică ("manuală").

In vederea proiectării sau verificării unei instalații de iluminat, folosind *metoda factorilor de utilizare bazată pe metodele CIE*, sunt necesare următoarele date inițiale: geometria încăperii, factorii de reflexie ai suprafețelor, fluxul luminos al unei lămpi (Φ), factorul de

mentenanță ($\delta < 1$), iluminările medii necesare pe suprafețele încăperii (E_1, E_3, E_4), numărul de lămpi dintr-un corp de iluminat (n_l). Singura dată luminotehnică referitoare la corpul de iluminat folosit este codul de flux $N_1 \dots N_5$. Dacă fabricantul nu oferă această dată, este necesară distribuția în plan a intensității luminoase, sub forma curbelor polare sau, preferabil, sub formă tabelară. Pentru inițierea calculului, este necesar un tabel cu multiplicatorii geometrici medii ai instalației independent de corpul de iluminat folosit.

Pentru început se poate opera cu o amplasare de referință CIE, într-o încăpere de referință, pentru care multiplicatorii geometrici sunt cunoscuți (sau pot fi calculați) în funcție de indicele instalației. În cazul unei amplasări diferite și/sau al unei încăperi de proporții diferite față de valorile de referință, acestea pot fi luate în considerare într-o a doua iterație când multiplicatorii geometrici reali pot fi calculați. Se constată însă că rezultatele obținute în situațiile practice sunt relativ puțin diferite.

Factorul de utilizare definit pentru o suprafață. Si este singura mărime care trebuie determinată. Pe baza definiției factorilor de utilizare (§ 1), rezultă principala relație folosită în calcul (4.1.1), unde N_l este numărul total de lămpi din instalație. Această relație extrem de simplă servește atât pentru calculul de proiectare, cât și pentru calculul de verificare.

Deoarece, ca și în metodele CIE, pentru corpul de iluminat ales nu există totdeauna o soluție pentru orice combinație de valori ale iluminărilor necesare pe cele trei suprafețe de calcul, este preferabil să se considere inițial numai cerințele impuse pentru planul de lucru (și să se folosească factorul de utilizare corespunzător), să se stabilească numărul de coruri de iluminat și amplasarea lor, apoi să se treacă la operația de verificare și să se compare valorile obținute și impuse ale iluminării pe toate suprafețele. În cazul când nu sunt satisfăcute cerințele impuse pentru perete și tavan, se poate încerca alegerea unui alt corp de iluminat cu o distribuție convenabilă.

4.2 Calculul factorilor de utilizare

Pentru calculul factorilor de utilizare este indicat să se adopte modelul simplificat al instalației (tavan echivalent plan) și să se pornească de la relația (2.1.4).

Fluxul luminos Φ_l și respectiv iluminarea E_l calculate folosind modelul cu trei suprafețe de calcul se referă la tavanul echivalent. Prin urmare, fluxul luminos final pe suprafețele caviatii tavan-friză trebuie calculat (4.2.1), pentru corpurile de iluminat montate suspendat, multiplicând acest flux cu factorul de reflexie multiple pe suprafețele respective [4]. Factorul de reflexie al tavanului echivalent poate fi calculat cu relația (4.2.2) [4]:

Matricea [C] din (2.1.4) poate fi calculată folosind relația (4.2.3) [4].

Folosind relațiile de conservare și de reciprocitate între factorii de legătură [4], rezultă că, în final, va fi folosit numai factorul de formă între două suprafețe plane paralele f_{45} (pentru montajul suspendat) sau f_{41} (pentru montajul corpurilor de iluminat direct pe tavan) (4.2.4, 4.2.5).

O foarte bună aproximare se obține cu relația (4.2.6). Relația (4.2.7) permite, de asemenea, o bună aproximare.

Ca o alternativă, poate fi precalculat un tabel al f_{45} (f_{41}) în funcție de indicele instalației.

Pentru corpurile de iluminat montate pe tavan: $r_{1e} \rightarrow r_p, f_{45} \rightarrow f_{14}, k_c \rightarrow 1$.

Din calcul, rezultă expresiile (4.2.8).

Raportul direct R_d este dat de relația (4.2.9) în care $M_1 \dots M_4$ (multiplicatorii geometrici medii pentru amplasarea de referință într-o încăpere standard) sunt cunoscuți în funcție de indicele instalației [2].

Factorii F_{ij} pot fi calculați folosind relațiile care rezultă din inversarea unei matrice 3x3 [4]. Cel mai simplu este însă să se utilizeze matricea numerică [C], prin înlocuirea valorilor mărimilor care intervin și să se aplice o metodă de inversare rapidă (de exemplu, o secvență MATHCAD sau MATLAB). Alte procedee simple pot fi folosite pentru a calcula k_c , r_{le} , R_d (inclusiv interpolarea pentru multiplicatorii geometrici corespunzători valorilor intermediare ale lui K) și, în final, factorii de utilizare.

Notând (4.2.10), ecuațiile (4.2.8) devin (4.2.11).

În vederea unei eventuale calculări clasice ("manuale"), se pot furniza tabele conținând factorii B_{ij} sau F_{ij} pentru anumite combinații de referință ale factorilor de reflexie ai suprafețelor și anumite valori ale indicelui instalației [7]. Sunt necesare cel puțin trei tabele în cazul considerării numai a planului de lucru. Această modalitate elimină însă avantajele oferite de modalitatea analitică descrisă anterior.

În figura 3 se prezintă pașii principali ai unui program de calcul al raportului direct și al factorilor de utilizare.


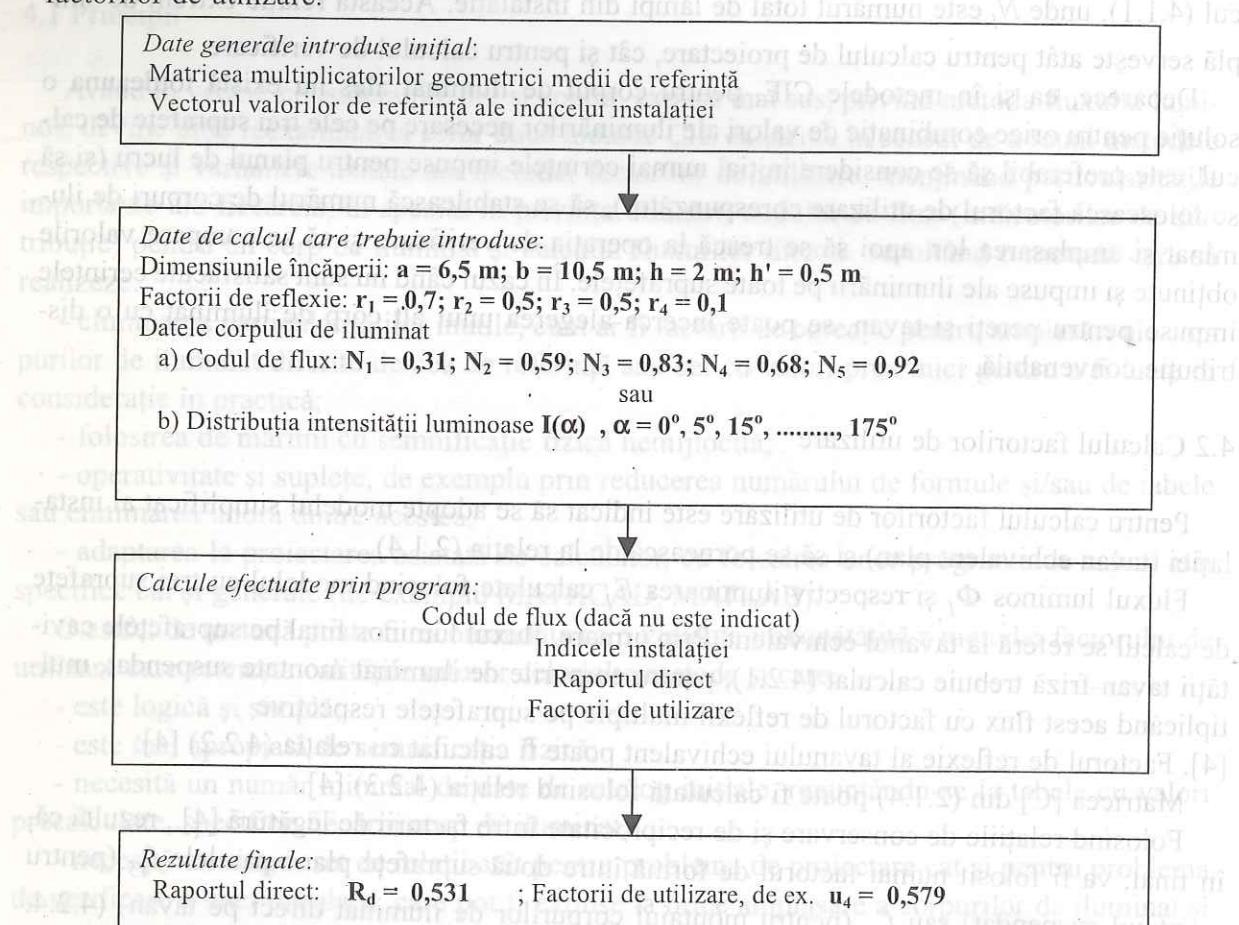


Figure 3 Calculul raportului direct și al factorilor de utilizare



dr. ing. **Paul DINCULESCU**, Profesor Universitatea "Politehnica" București
Facultatea de electrotehnică, 77206, București, Spl. Independenței 313
Tel.(401)410.4.00/139; 092.429.814, E-mail: paul@apel.apar.pub.ro

Absolvent al Facultății de Electrotehnică 1960; doctorat 1973 la UPB.
Predă cursuri de Instalații electrice și Iluminat electric. Autor de manuale universitare și lucrări științifice în domeniu. Contribuții la studiul surselor de lumină și al caracteristicilor corpurilor de iluminat și la calculul instalațiilor de iluminat interior.

Abstract

The Commission Internationale de l'Eclairage (CIE) was established in 1913. From work on basic standard matters in light and lighting the interest focused on application with publication of guides. Today the main interest is again on standards where the CIE is the international standardising body in co-operation with ISO and CEN and in new technology.

As financial support is more difficult to find for the National Committees, the CIE seeks new forms for membership and new ways of getting funding from organisations and companies.

1 History

International co-operation in the field of lighting started a long time ago, more than 100 years. There was a need for standardisation of measures and terms to use in lighting and lighting applications. September 3rd, 1900 the CIP, Commission International de Photométrie, started in Paris with representatives from the USA and Europe, in all 9 countries. It was the National Electrotechnical Committees from the different countries that were invited to take part.

During the first decade or so it became clear that lighting involves much more than production and photometry of light. Lighting engineering became more pronounced and lighting engineering societies were established in the industrialised countries.

CIP held conferences about every 4th year in Zürich. At the 4th meeting of CIP held in Berlin end of August 1913 the CIE was established. And it has gradually grown since then to become the international organisation in lighting.

2 Development

The number of member countries has grown to about 40 today. And one of the important tasks for the coming years is to widen the CIE family even more. Different ways are tried.

One of the major tasks for the CIE has been to find international agreement on matters related to light, lighting and vision, both fundamental and in applications. Some of these matters are so basic that they have become standards. First more in reality than in actual presentation.

The results of the work in CIE were for many years only presented in the proceedings of the sessions but in the early 60:s it was recognised that CIE should publish reports on specific topics to make them more easy to find. Today the number of reports has exceeded 140 and that includes a number of new editions, or updating of existing reports. For a period the CIE also published a Journal.

At the meeting in 1928 a number of recommendations were endorsed. As an example 85 cm above the floor was agreed as the basic level for measurements of illuminance indoors. The ratio between the "international candle" and the Hefnerkerze was very noticeably different at different colour temperatures. This led to a recommendation to work on finding a method for heterochromatic photometry.

At the 1931 session the international system, the so-called CIE System, of trichromatic colorimetry was established. The colour vision characteristics of a "reference observer" were defined. A standard white light and 3 illuminants for use in colorimetry were defined.

In *colour* the CIE has thus been very active and published standards and methods also for describing the *colour rendering* properties of light sources. These have been criticised very much over the years but so far no one has been able to present a better method. The first official CIE Standards were on Colorimetric illuminants and on the Colorimetric observer numbered S001 and S002 and published in 1986.

The term *candela* was adopted at the session in 1948 (in Paris) to replace the old national names such as bougie, candle and Kerze.

Another field where the CIE has been active is in glare, especially *discomfort glare* in interiors. As you know methods to describe the risk for glare disturbance were developed in many countries and it was very difficult to find a method that all could agree upon. One reason for this was of course that no method was perfect for all applications. It should be both simple and still flexible! The CIE presentation of lighting guides for indoor lighting needed a method also for the assessment of discomfort glare. And finally in 1995 a proposal for a CIE method called the UGR was published as an interim method until new research could lead to a better method.

And the CIE has the challenge to find both a better basis in understanding what glare is and from that a better method. So far funding and interested researchers is lacking.

The *vocabulary* used in lighting and the definitions of measures and words has been published in the three official CIE languages plus Russian. The first edition came in 1938 including 103 terms and their definitions in the then 3 official languages. Each term or word has also been translated to several languages by the CIE. 2nd edition in 1957. When the 3rd edition came in 1970 it was adopted also as an IEC standard and this is also the case with the 4th edition from 1987. The revision of this vocabulary is constantly going on and is now approaching a new edition. Due to the rapid-

ly increasing number of terms and definitions it is quite probable that the 5th edition will only appear on disc, with the possibility to print relevant chapters for specific purposes.

3 Standardisation

Among the early standards that CIE established is the $V(\lambda)$ curve which was first published in 1924 at the session in Geneva. The celebration of its 75 years was held in the special CIE symposium on photometry in Budapest in 1999.

As mentioned above the first official CIE standards were related to colour.

The luminance distribution of the *overcast sky* was also established by the CIE and later for the *clear sky*. These are used for calculation of indoor daylight all over the world. They have now appeared as formal CIE standards. Today we also have a draft standard for a general description of the sky luminance distribution that covers all sky conditions.

An important step for the recognition of the CIE as the international body in lighting was the agreement with ISO and IEC in 1989 that all standardisation work in lighting should be done by the CIE. This is published in an "ISO Council Resolution 10/1989", a "CIE Council Resolution 1/89 on Joint ISO/CIE Standards" and a "Memorandum of mutual understanding between the IEC and CIE". The CIE standards can be accepted as ISO standards, or rather joint CIE/ISO standards after a simplified procedure within the ISO. This is not only good for the CIE reputation but also a practical agreement as the number of experts is limited and duplication of work would mean also that the same persons, more or less, should do the work twice. Thanks to this agreement the CIE work on standardisation has become officially accepted.

At the CIE Session in Warsaw in June 1999 an agreement on co-operation between the CIE and CEN, the European Standardisation

Organisation, was signed. This is an agreement basically similar to the one between CIE and ISO about avoiding double work and making use of existing reports and standards. As the legal status of CEN standards in the member countries are different from the ISO standards the agreement has a slightly different form.

4 Situation today

Standards. Several technical committees in the CIE are working on standards. This is partly by request from ISO, partly because standards are playing a more important role internationally, as trade becomes more and more worldwide. It also seems easier to get national support for the work in the CIE when the outcome can be a standard.

There are certain rules for the work on standards within the CIE. To ensure that the outcome is an agreement between several countries you must have participants, TC members, from at least five member countries. And it is advisable that all division members in the actual division inform their country standardising committees that a work is going on so they can follow and influence the work before a draft standard is presented for voting. This makes it easier for the following voting which must be done in the NCs, not only within the TC, division and Board of CIE.

New technology. Light and lighting including light-sources is a very active area for development. The new technologies lead to a need for new application guides and rules for both calculation and measurements. For the CIE this means establishment of new technical committees and even a new Division. (As you know the activities in the CIE are handled by Divisions for different areas.)

During 1999 a division for Image Technology was established as a result of international discussions and demand for guides in description and measurement of image quality in a broad sense. For the CIE it is a positive sign that the

international community involved in image technology turned to us to create this forum for co-operation.

LED. Light emitting diodes (LEDs) is another hot topic. LEDs can now be made in "all colours" and there is a need for describing their properties in an agreed way. A 2nd CIE expert symposium on LED measurements was held in Gaithersburg, USA, in May this year. The attendance was bigger than expected and already planning a 3rd symposium has started.

5 The future

Members and funding

The CIE will not only try to widen the fields of technology to cover new areas of importance to light and lighting. The funding of the CIE is an everlasting problem and new ways of finding sponsoring are tried. At the Session on Warsaw in June 1999 the General Assembly, consisting of representatives for all member countries, decided to widen the membership categories both in order to facilitate for new members to participate but also to allow sponsoring members to be part of the CIE family.

The funding of the CIE has been based on fees from the National Committees that are members and from sales of publications. CIE publications are rather expensive, many thinks, and the number of copies sold is small. In order to spread the CIE knowledge we would like to be able to distribute the reports for free or make them available on the net. But then the fees must be raised and this is a very big problem for many members. So finding interested national and international organisations and companies that are willing to sponsor the activities is one way to reduce the burden on the member countries. They are called Supportive Members in the new structure. The first has already signed as member.

New member countries or persons from countries yet without a National Committee have also a possibility to become what is called

Associate National Committees or Associate Members on a trial period basis to get familiar with the activities within the CIE without a too high cost. Also developing countries can become associate members.

Today the majority of member countries are from Europe even if all continents are represented. One goal is of course to get more members from all continents including developing countries to make the CIE really world wide.

Activities in the Divisions

Has the CIE covered the fundamentals in light and lighting? Even if we have been working for such a long time there are questions not yet solved. Glare for instance is still debated. How can you describe glare and measure or calculate the risk for glare? We don't have the answer.

Colour notation is another area where the debate continues and the CIE lacks the answer, if there is one answer.

Lighting applications become more complex as the understanding of the interactions of all environmental parameters is increasing. Many propose that the CIE should develop new guides in lighting for specific places, not only develop standards. The aim is of course good lighting quality, but we don't know how to describe lighting quality in a measurable way!

Lighting and energy is another area where the CIE has not been very clear in its role.

Education is an area where the CIE could be more active. But how? One way could be to offer courses via the net.

As new technology develops also the measurements must be developed. The same for calculations. Computerised calculations are spreading but how can we assure that the programs give reasonably correct answers? What tolerances in calculations can we accept and what are the tolerances in both calculations

and measures? This becomes more and more important as standards have to be fulfilled and the quality assurance becomes more and more a legal matter.

Summary

Even if the CIE has worked for almost 90 years there are still questions unanswered and new challenges appearing.

To handle this the CIE is developing both in its technical activities and in its member structure. There are many important questions to solve for the board in the new millennium. As the CIE is based on voluntary work the support from the National Committees and from all individuals is crucial.

The Session in Warsaw was very successful. Many good papers were presented, new contacts and liaisons established and a number of new active persons are found for the work. The CIE expert symposia held once or twice a year is also an excellent way to widen knowledge within the CIE and about the existence of CIE. All this looks promising and I am convinced that we together will achieve a lot during the coming years.

Finally I hope that the number of member countries also has increased at the end of the period.

Paper presented at the International Conference ILU-MINAT 2001, June 28-30, 2001, Cluj-Napoca

CIE ÎN LUME

Rezumat

Comisia Internațională de Iluminat (CIE) a luat ființă în 1913. De la activitatea de bază de standardizare în domeniul luminii și iluminatului, interesul s-a concentrat mai apoi pe aplicații și studii ale căror rezultate au fost publicate în diferite ghiduri și broșuri. În prezent, interesul de bază este din nou orientat în direcția standardelor, unde CIE este parte componentă a organizațiilor internaționale de standardizare alături de ISO și CEN, precum și în domeniul noilor tehnologii.

Cum suportul finanțier este mult mai greu de găsit pentru Comitetele Naționale, CIE caută noi forme de parteneriat și noi căi de obținere a unor fonduri de la organizații și companii.

1 Istoric

Cooperarea internațională în domeniul iluminatului a început cu mult timp în urmă, de mai bine de 100 de ani, când s-a simțit nevoiea standardizării unităților de măsură și a termenilor utilizati în iluminat și aplicațiile din acest domeniu. La Paris, în 3 septembrie 1900, a luat ființă Comisia Internațională de Fotometrie (CIP) formată din reprezentanți ai SUA și din țări europene. Aceștia au fost reprezentanți ai Comitetelor Electrotehnice Naționale din diferite țări care au fost invitate să ia parte.

În perioada primei decade sau ulterior a devenit lăpide că iluminatul implica mai mult decât fotometria și producerea luminii. Ingineria iluminatului a devenit din ce în ce mai importantă, societățile de inginerie a iluminatului consacrandu-se în state industrializate.

CIP a organizat conferințe din patru în patru ani la Zürich. La cea de-a patra întâlnire a CIP desfășurată la Berlin la sfârșitul lunii august a anului 1913 a luat ființă CIE. În timp, aceasta a crescut gradual până când a devenit o organizație internațională de iluminat.

2 Dezvoltarea CIE

În prezent, numărul de țări membre a crescut depășind numărul de 40 de membri. O sarcină importantă pentru anii care urmează este lărgirea familiei CIE.

Una dintre mariile sarcini ale CIE a fost să găsească acorduri internaționale în probleme legate de lumină, iluminat și vizibilitate, atât fundamentale cât și aplicative. Unele dintre aceste chestiuni sunt de bază, astfel încât au devenit standarde. La început mai mult în realitate decât în formă.

Rezultatele muncii CIE au fost pentru mulți ani doar prezentate în lucrări ale unor sesiuni. La începutul anilor 60, a fost recunoscut că CIE ar trebui să publice rapoartele pe teme specifice pentru a le face mult mai accesibile și ușor de găsit. În prezent, numărul rapoartelor a trecut de 140, incluzând un număr de ediții noi sau actualizare a rapoartelor existente. Într-o vreme, CIE a publicat și o revistă.

La întâlnirea din 1928 au fost aprobată un număr de recomandări. De exemplu, a fost stabilită distanța de 85 de cm deasupra pardoselei ca nivel de bază pentru determinarea iluminării interioare. Raportul dintre "candela internațională" și "Hefnerkerze" a fost notabil diferit la diferite temperaturi de culoare. Aceasta a condus la o recomandare de-a se lucra la găsirea unei metode pentru fotometria heterocromatică.

La sesiunea din 1931 a fost stabilit sistemul internațional al colorimetriei tricromatice, denumit Sistemul CIE. S-au stabilit caracteristicile vizuale ale culorii ale unui "observator referință". S-au definit lumina alba standard și trei iluminanți utilizati în colorimetrie.

În domeniul *colorilor* CIE a fost astfel foarte activă și a publicat standarde și pentru descrierea proprietăților *redării colorilor* sursei de lumină. Acestea au fost criticate de-a lungul anilor, dar nimeni nu a mai prezentat o altă metodă mai bună. Primele standarde oficiale al CIE au fost Iluminanții colorimetri și Observatorul colorimetric, numerotate cu S001 și S002 și publicate în 1986.

Termenul *candela* a fost adoptat la sesiunea din anul 1948 (de la Paris) pentru a înlocui vechile nume naționale ca bougie, candle și Kerze.

Luminanța (strălucirea) este un alt punct de interes unde CIE a fost activ, în special *disconfortul produs de luminanță* în interioare.

După cum se știe, metodele pentru descrierea pericolului apariției tulburărilor cauzate de luminanță au fost dezvoltate în multe țări și a fost foarte dificil de-a se găsi metode cu care toți să fie de acord. Un motiv, desigur, a fost imposibilitatea găsirii unei metode perfecte pentru toate aplicațiile. Ar fi trebuit să fie pe de o parte simplă dar și flexibilă! Prezentarea Ghidului de iluminat al CIE pentru iluminatul interior a avut nevoie de o metodă pentru evaluarea disconfortului produs de luminanță. În final, în 1995, o propunere pentru metoda CIE denumită UGR a fost publicată ca o metodă interimară până când noi cercetări ar putea să conducă la o metodă mai bună.

CIE și-a propus de-a răspunde la provocarea de-a găsi pe de o parte fundamentul în înțelegerea a ceea ce este strălucirea și, de aici, de a oferi o metodă mai bună. Până în prezent fondurile și cercetătorii interesați în această problemă sunt inexistenti.

Vocabularul utilizat în iluminat și definițiile unităților de măsură au fost publicate în cele trei limbi oficiale CIE plus limba rusă. Prima ediție datează din 1938 incluzând 103 termeni cu definițiile lor în trei limbi oficiale. Fiecare termen sau cuvânt a fost de asemenea tradus de către CIE în câteva limbi, la două ediție din 1957. Cea de-a treia ediție din 1970 a fost adoptată și ca standard IEC, lucru care s-a întâmplat și cu cea de-a patra ediție din 1987. Revizuirea acestui vocabular a continu-

at permanent astfel că se apropiie o nouă ediție.

Aferent creșterii rapide a numărului de termeni și definiții este posibil ca cea de-a 5-a ediție să apară pe disc, cu posibilitatea listării capitolelor relevante pentru un scop specific.

3 Standardizare

Printre standardele de la începuturi stabilite de CIE este *curba V(λ)* publicată pentru prima oară în 1924 la sesiunea de la Geneva. La aniversarea a 75 de ani de la acest eveniment, s-a ținut un simpozion special al CIE în fotometrie la Budapesta, în 1999.

După cum s-a menționat mai sus primul standard oficial al CIE s-a referit la culori. De asemenea, CIE a stabilit distribuția luminanței cerului înnorat, iar mai târziu pentru cerul senin. Acestea sunt utilizate pentru determinarea iluminatului natural interior în întreaga lume. Ele au apărut acum ca standarde formale CIE. Azi noi avem un standard schițat pentru descrierea generală a distribuției luminanței cerului care acoperă toate condițiile atmosferice.

Un pas important pentru recunoașterea CIE ca un organism internațional în iluminat a fost acordul cu ISO și IEC din 1989, care stabilește ca standardizarea în iluminat să fie realizată de CIE. Această decizie a fost publicată în "Rezoluția Consiliului ISO 10/1989", "Rezoluția Consiliului CIE 1/89 la întâlnirea ISO/CIE" și "Memorandumul înțelegerii mutuale dintre IEC și CIE". Standardele CIE pot fi acceptate ca standarde ISO, sau, de preferat, ca standarde CIE/ISO după o procedură simplificată interioară ISO. Acest lucru este nu numai pozitiv pentru reputația CIE, ci este și un acord practic, atât timp cât numărul de experți este limitat iar duplicarea lucrului ar însemna ca aceleași persoane, mai multe sau mai puține, să realizeze același lucru de două ori. Mulțumită acestui acord, activitatea de standardizare a CIE a fost acceptată oficial.

La Sesiunea CIE de la Varșovia din iunie 1999 a fost semnat un acord de cooperare între Organizația Europeană pentru Standarde, CIE

și CEN. Acesta este un acord similar în principiu cu cel dintre CIE și ISO pentru evitarea dublei activități și pentru a face posibilă utilizarea rapoartelor și standardelor existente. Ca aspect legal în ce privește statutul standardelor CEN în țările membre, acestea sunt diferite de standardele ISO, acordul având mici diferențe.

4 Starea actuală

Standardele. Câteva comitete tehnice ale CIE lucrează la standarde. Aceasta este parțial cerută de ISO, parțial deoarece standardele joacă un rol mult mai important pe plan internațional, când comerțul devine din ce în ce mai întins pe întreg cuprinsul Pământului. De asemenea, pare mai ușor a se obține sprijin național pentru activitatea desfășurată în CIE când rezultatul poate fi standardizat.

Există reguli certe pentru desfășurarea activității de standardizare în interiorul CIE. Pentru a se asigura că rezultatul este un acord între țări, trebuie să fie asigurat numărul de participanți, membri TC din cel puțin cinci țări membre. Este recomandabil ca toate diviziile membre în diviziile curente să-și informeze comitetele de standardizare ale propriilor țări că se desfășoară o anumită activitate, astfel încât ei să poată să urmărească și influențeze munca înainte de prezentarea rezumatului standardului spre a fi votat. Aceasta face mai ușoară votarea care trebuie realizată de Comitetele Naționale, nu doar în interiorul TC, divizia și comisia CIE.

Noua tehnologie. Lumina și iluminatul, inclusiv sursele de lumină, sunt un domeniu foarte activ de dezvoltare. Noile tehnologii conduc la nevoia de noi ghiduri de aplicații și reguli atât pentru calcul cât și pentru măsurare. Pentru CIE, aceasta înseamnă stabilirea de noi comitete și chiar a noi divizii (după cum știți activitățile CIE sunt tratate în Divizii ale diferitelor domenii).

În cursul anului 1999 s-a creat divizia pentru Tehnologia Imaginii ca rezultat al discuțiilor internaționale și cerințelor în descrierea și măsurarea calității imaginii în sensul cuprinzător al termenului. Pentru CIE acesta este

semnul pozitiv că comunitatea internațională implicată în tehnologia imaginii și-a îndreptat privirea spre noi pentru a crea acest forum de cooperare.

LED. Dioda electroluminescentă este un alt punct fierbinte. LED-urile pot acum fi realizate în toate culorile, iar aici este nevoie de o descriere a proprietăților lor într-o formă de comun acord. Cel de-al doilea Simpozion expert CIE axat pe măsurători pentru LED-uri s-a desfășurat la Gaithersburg, SUA, în luna mai a acestui an. Participarea a fost mai numeroasă decât s-a așteptat și deja a fost demarat cel de-al 3-lea simpozion.

5 Perspective

Membri și resurse. CIE nu va încerca doar să se extindă în domeniul tehnologic, ci și să acopere noi domenii de importanță pentru iluminat. Fondurile CIE sunt o problemă din totdeauna, de aceea sponsorizări noi sunt căutate pe diferite căi. La Sesiunea desfășurată în iunie 1999 la Varșovia, Adunarea Generală, constituită din reprezentanți ai tuturor țărilor membre, a decis să-și extindă colaborarea pentru a facilita intrarea de noi membri în familia CIE pe de o parte, cât și de membri care pot aduce sponsorizări pe de alta.

Fondurile CIE s-au bazat pe cotizațiile Comitetelor Naționale care erau membre și din vânzarea publicațiilor proprii. Publicațiile CIE sunt mai degrabă scumpe, cu multe accesorii, iar numărul de copii vândute este mic. Pentru a face cunoscută baza de cunoștințe CIE am vrea să putem distribui rapoartele gratuite sau să le face disponibile pe Internet. Dar, atunci, taxele vor trebui ridicate ceea ar constitui o problemă pentru mulți membri. Deci, pentru a reduce această povară a țărilor membre să caută organizații și companii naționale și internaționale care ar dispune să sponsorizeze o parte din activitățile CIE. În noua structură, acești membri poartă titulatura de

Membri Sustinători. Primul s-a și înscris deja. Noi țări membre sau persoane din țări care încă nu și-au organizat Comitete Naționale au, de asemenea, posibilitatea de-a deveni ceea ce se numesc Comitete Naționale

Asociate sau Membrii Asociați pe o perioadă de test pentru familiarizarea cu activitățile din cadrul CIE fără costuri prea mari. De asemenea, țările în curs de dezvoltare pot deveni membre asociate.

În prezent, majoritatea țărilor membre sunt din Europa chiar dacă toate continentele sunt reprezentate. Un obiectiv oricum rămâne cel de-a primi noi membri de pe toate continentele inclusând țări în curs de dezvoltare, pentru a face din CIE cu adevărat o organizație ce cuprinde întreaga lume.

Activitatea în divizii. A acoperit CIE fundamentele în lumină și iluminat? Chiar dacă am lucra o lungă perioadă de timp, întrebarea anterioară nu va fi rezolvată. Luminanța, de exemplu, este încă în dezbatere. Cum putem descrie luminanța (strălucirea), cum o putem măsura și calcula riscul de orbire? Sunt probleme la care încă nu avem răspuns.

Notația culorilor este un alt câmp de dezbatere continuă iar CIE duce lipsa răspunsurilor, dacă există vreunul.

Aplicațiile de iluminat devin din ce în ce mai complexe ca și înțelegerea faptului că interacțiunile cu parametrii ecologici cresc. Multe dintre propunerile CIE ar trebui să dezvolte noi ghiduri de iluminat pentru zone specifice, nu numai spre dezvoltarea de standarde. Scopul este, desigur, calitatea iluminatului, dar nu cunoștem cum să descriem calitatea iluminatului într-o formă măsurabilă! Iluminat și energia este un alt punct unde rolul CIE nu este bine conturat.

Educația este un domeniu unde CIE ar putea fi mai activ. Dar cum? Un mod ar fi cursurile deschise la distanță pe Internet.

După cum noile tehnologii se dezvoltă la fel și tehnicele de măsurare trebuie să dezvoltate. La fel și pentru calcule. Calculul computerizat este răspândit, dar cum putem fi siguri că acele programe ne dau niște rezultate corecte sau cel puțin rezonabile? Ce toleranțe de calcul putem accepta, dar considerate împreună, toleranța de calcul și de măsurare? Acestea devin din ce în ce mai importante ca standardele să fie complete și asigurarea calității să devină o cheśćune din ce în ce mai legală.

Concluzii

Chiar dacă CIE a lucrat mai bine de 90 de ani, încă mai sunt întrebări fără răspuns și, în plus, noile provocări ce apar.

Pentru a trata aceste probleme CIE se dezvoltă în partea de activități tehnice cât și în structura membrilor. Există multe probleme importante de rezolvat de comisie în noul mileniu. Cum CIE se bazează pe munca voluntară, suportul individual și cel venit de la Comisiile Naționale este crucial.

Sesiunea desfășurată la Varșovia a fost una de succes. Multe lucrări de înaltă ținută au fost prezentate, noi contacte și legături au fost stabilite și un număr nou de persoane active au fost găsite pentru desfășurarea de activități. Simpozioanele expert CIE ținute o dată sau de două ori pe an sunt, de asemenea, un bun prilej de-a transmite cunoștințele în cadrul CIE și despre existența CIE. Toate aceste aspecte promit, și sunt convins că împreună vom realiza multe în anii ce au să vină.

În final sper că numărul țărilor membre să crească la sfârșitul acestei perioade.

Eduardo R. MANZANO*,
Ramon SAN MARTIN **
*Universidad Nacional de Tucumán
**Universitat Politècnica de Catalunya

THE BENEFIT/COST IN URBAN LIGHTING

Abstract

Urban lighting should be designed and managed in order to work efficiently preserving quality values as high as possible during life cycle, all this at reasonable costs. In order to relate quality service and costs the design of new urban lighting installations and the evaluation of existing installations can be done through a benefit/cost approach. A quantification of the benefit based on quality service parameters as the lighting level, the permanent failure rate, and the lighting system operation time, is proposed. For design purposes factors as mechanical degree protection, environmental pollution, lamp survival and maintenance policies are analysed under a life cycle benefit/cost approach and the results obtained are indicated. In order to evaluate existing installations the benefit/cost life cycle analysis is applied to a town where an external contractor does the lighting maintenance. At representative city sectors the lighting parameters, energy consumption and maintenance historical records were registered. The results of actual installations and comparisons with simulated situations are described and results discussed. Lighting installation performance can also be traced by periodical evaluations of the benefit/cost ratio and parameters used for simulating behaviour can even be adjusted to make a more reliable analysis.

1 Introduction

A methodology to evaluate urban lighting installations, focused on the overall quality service has been proposed based on the Benefit/Cost ratio [1]. The benefit is assessed in terms of factors linked to the service, that is to say the performance during the use of the installations. The factors taken into consideration have been illuminance, failure rate and time of operation of the installations. These factors have been evaluated taking, as a reference, suitable values established by standards or recommendations. The costs of installation, energy, maintenance, refurbishment and disposal during the life cycle of the installations are considered in relation to the financial cost of money.

The application of the methodology has been analysed in two situations: the design of new installations and the evaluation of existing installations. When considering the design of

new installations, different alternatives have been simulated studying the effect of the specific characteristics of the installations in the benefit/cost relationship. When considering existing installations, the methodology has been applied to a town and the results have been compared to an 'optimal' situation. This has enabled to assess the existing situation and to adjust maintenance policies.

2 The benefit/cost ratio

A procedure based on the determination of the ratio benefits /annual operation costs, for planning and controlling lighting management, requires to establish which are the benefits and costs and to quantify both.

The benefit that citizen and road drivers get from urban lighting is to find appropriate visual conditions to precede safety, creating an ambient of security and comfortable use. Quantifying these aspects presents certain

difficulty; this is why it is convenient to look for a more operative indicator relating, illuminance ($K(E)$), the necessary operation time ($K(T_O)$), reliability and failure duration ($K(PFL)$). The benefit can be defined as the multiplication of these factors, where the relative weight of each one is considered as equal for the moment.

The benefit can be quantified as:

$$B = K(E) \times K(T_O) \times K(PFL) \quad (1)$$

$K(E)$ depends of the road average illuminance (E), which limitations, in spite to be known is chosen as a magnitude representative of the lighting level due to its ease of measurement, low cost of the measurement equipment's, use habit and besides to the fact that it can be compared with reference values conveniently

Table 1 Factor $K(E)$

E	$E < E_m/2$	$E_m/2 \leq E < E_m$	$E \geq E_m$
$K(E)$	0	$(2E/E_m) - 1$	1

established. Minimum maintained values are used as reference (E_m). $K(E)$ varies according to table 1

Due to depreciation, illuminance decreases with time, starting from the initial values when installation is new (E_O). Depreciation is caused by lamp lumen output reduction (lamp lumen maintenance factor $LLMF$), lamps failures (lamp survival factor, LSF) and the reduction of luminaire output flux by ageing and dirt accumulation (luminaire maintenance factor LMF). The multiplication of these factors gives the maintenance factor (MF). After a certain period of time:

$$E = E_O \times MF \quad (2)$$

Maintenance counteracts depreciation; therefore E will depend of the adopted maintenance policy. Four possible maintenance policies have been assumed, for which the MF is indicated in table 2.

Maintenance policy	MF
GR+GC: Group lamp replacement and group luminaire cleaning.	$LLMF \times LSF \times LMF$
SR+GR+GC: Spot lamp replacement + group lamp replacement + group luminaire cleaning	$LLMF \times LMF$
SR+GC: Spot lamp replacement and group luminaire cleaning	$(LLMF \text{ average value from } 0 \text{ to } 2T_{50\%}) \times LMF$ [i]
SR+SC: Spot lamp replacement and simultaneous luminaire cleaning	$(LLMF \text{ average value from } 0 \text{ to } 2T_{50\%}) \times (LMF \text{ average value from } 0 \text{ to } 2T_{50\%}/T_O)$ [i]

Table 2 Maintenance factor according to maintenance policy

$T_{50\%}$: average rated life, time over which LSF falls to 50% in reference conditions.

T_O : annual lamp operating time [hours].

Maintenance factor components are associated to exponential curves for calculations. LOR curves for different degrees of ingress protection IP and pollution are used from CIE [2]. LSF curves were used from data collected and presented in [1] and curves for LLO are employed from manufacturers average

data. To evaluate existing installations local data are collected before and after cleaning and lamp replacement operation at random selected luminaires.

$K(T_O)$, is the operation time factor. The scheduled reference time used is T_{OR} , that is the annual necessary operating time which depends of the geographical situation (refer to table 3).

Table 3 Factor $K(T_O)$

T_O	$T_O < 0,95T_{OR}$	$0,95T_{OR} < T_O < T_{OR}$	$T_O \geq T_{OR}$
$K(T_O)$	0	T_O/T_{OR}	1

The system reliability factor is described by the percentage of permanent failure luminaire observed, $K(PFL)$ accepting a first limit $PFL_{min}=1\%$ from which the factor decreases linearly up to an unacceptable second limit were benefit is null $PFL_{max}=3\%$. Refer to table 4.

Table 4 Factor $K(PFL)$

PFL	$\leq PFL_{min}$	$PFL_{min} < PFL < PFL_{max}$	$> PFL_{max}$
$K(PFL)$	1	$1 - (PFL - PFL_{min}) / (PFL_{max} - PFL_{min})$	0

3 The design using benefit/cost ratio

The B/C ratio as a design tool was analysed for installations fulfilling the lighting quality figures from table 5. To reduce the study, a single side arrangement installation was used (figure 1) where the variable parameters considered were: column height ($6m \leq H \leq 17m$), bracket length ($0m \leq E \leq 3m$), tilt. angle ($0^\circ \leq T \leq 15^\circ$), luminaire separation ($15 \leq S \leq 80m$), road width ($A=6m$ and $8m$), 4

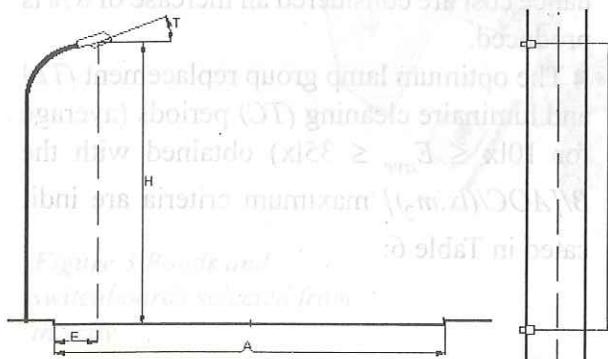


Figure 1 Lighting installation arrangement

All the costs obtained from local data, are reduced to "uniform present worth annual values" to consider the time value of money in a life cycle analysis (20 years). What is called the annual operational cost (AOC) is calculated by this means. The AOC of a lighting installation can be grouped in:

consumption

- Capital: the annual amortisation cost from invested capital
- Energy: active and reactive

The maximum Benefit/Cost ratio value for different cleaning and group replacement periods can be used for the management planning. This allows the application of a maintenance policy, which can be subsequently adjusted by control data.

luminaire types and 2 lamp types (HPS 100,150,250, 400W and Mercury 125, 250, 400W), road CIE R3 $q_o = 0,07$, LSF average

E_{ave}	L_{ave}	$U_0 \geq$	$U_L \geq$	$TI\% \leq$
10	0,5			
15	1			
20	1,2	0,4	0,5	
25	1,5			
35	2		0,7	10%

Table 5 Lighting quality criteria

from manufacturers and LSF local data from [1], four maintenance policies (table 2) and group lamp replacement and luminaire cleaning periods between 2 months and 6 years.

As an example, the $B/[AOC/(lx.m^2)]$ maximum obtained for a 8m width road, HPS 250W lamp, high pollution ambience category, luminaire sealed protection IP2, IP5, IP6

and LSF from [1] are indicated in figure 2 for Eave 10, 15, 20, 35 lx according to table 5.

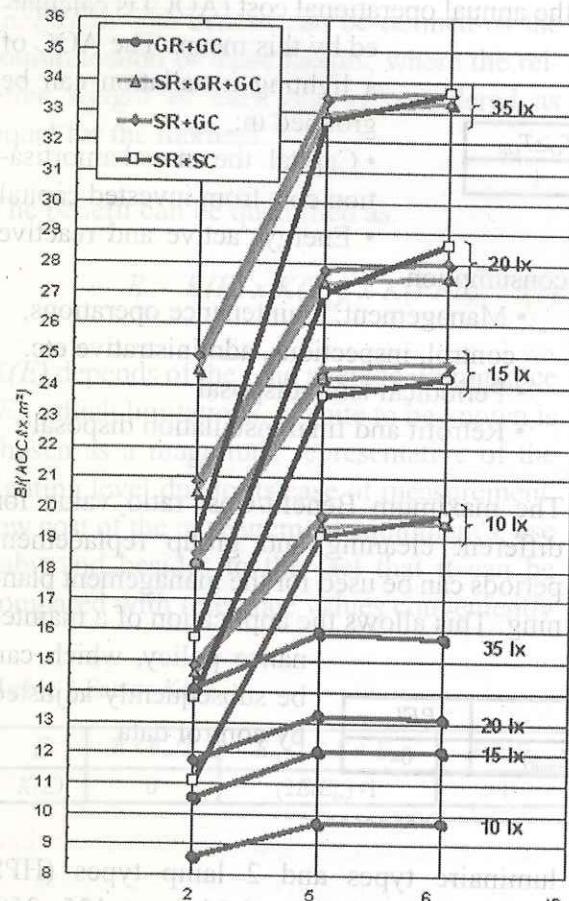


Figure 2 $B/[AOC/(lx.m^2)]$ maximum with a one side, 8m width road, HPS 250W lamp, high pollution ambience category, luminaire IP2, IP5, IP6 and LSF from [1] for the different E_{ave} from Table 5.

From the results obtained we can conclude:

- $B/[AOC/(lx.m^2)]$ maximum compared with minimum cost criteria has, as an advantage, the fact that it considers quality service factors as the installation failure rate (associated to lamp mortality) that is lacking in a minimum cost analysis.
- There is a dependency of $B/[AOC/(lx.m^2)]$ maximum with Eave, UO, UL and the lit area

although the annual operational costs have been referred to lx and m². Because of this fact B/C must be calculated in any case in order to compare installations by means of these criteria.

- Regarding to the effect of maintenance policies, ambient pollution, IP luminaire sealing protection and LSF it can be concluded that:

- $SR+GR+GC$ and $SR+GC$ in high-polluted areas with luminaires IP2 or IP5 are the most convenient. $SR+SC$ with IP6 is the most convenient. $GR+GC$ is the worst policy in all cases except with IP2 luminaires.

- Installations where the ambient category shifts from low polluted to high polluted experiment a $B/[AOC/(lx.m^2)]$ reduction of 20% using IP2 luminaires, 5% with IP5 and 3% with IP6.

- IP2 luminaires with $SR+GR+GC$ or $SR+GC$, have the lowest $B/[AOC/(lx.m^2)]$, with an average difference of 25% compared with IP5 and IP6 while IP5 and IP6 luminaires differ in 1.4% making IP6 more convenient than the others.

- Uses of local data for LSF instead of average manufacturer data in $B/[AOC/(lx.m^2)]$ calculation produces differences of -45% in the values with a $GR+GC$ policy. This is because mortality from actual installations is greater (10% per year). As Benefit is affected by mortality, the optimum situation is reached with shorter group lamp replacement periods to compensate the increasing failure rate that otherwise would occur. Policies with spot replacement show differences of only 1% because spot labour and lamp cost relative to the overall cost are not so important nevertheless if only maintenance cost are considered an increase of 8% is produced.

- The optimum lamp group replacement (TL) and luminaire cleaning (TC) periods (average for $10lx \leq E_{ave} \leq 35lx$) obtained with the $B/[AOC/(lx.m^2)]$ maximum criteria are indicated in Table 6:

Maintenance Policies	Luminaire seal protection	Pollution category	Lamp	T_L	T_C	
<i>SR+GR+GC</i> and <i>SR+GC</i>	IP2	High	HPS 250W	3 years	1 year	
			Merc. 400W	1 year	3 to 4 month	
	IP5 and IP6 D		HPS 250W	4 years	1 to 3 years	
			Merc. 400W	1 year	1 year	

Table 6 Optimum lamp group replacement (T_L) and luminaire cleaning (T_C) average periods for the $B/[AOC/(lx.m^2)]$ maximum criteria

3 Evaluating existing installations by benefit/cost ratio

A town closed to Barcelona, having 78.000 inhabitants, 6.800 light points (luminaire + column) controlled by 100 switchboards was chosen in order to evaluate the B/C ratio application. The city was first sorted in order to group lighting installation according to common features like road categories, illuminance level, luminaire type etc. Four roads types were considered to be appropriate.

A second sorting was done in these areas for the analysis through isolating the lighting installations connected to the same switchboard because energy consumption and switching times are measured and controlled in each switchboard. The roads and switchboards selected (indicated in figure 3) were:

- Residential roads (switchboards 35 and 36),
- Industrial roads (switchboard 45),
- Main roads (switchboards 1, 2, and 29) and
- Secondary roads (50).

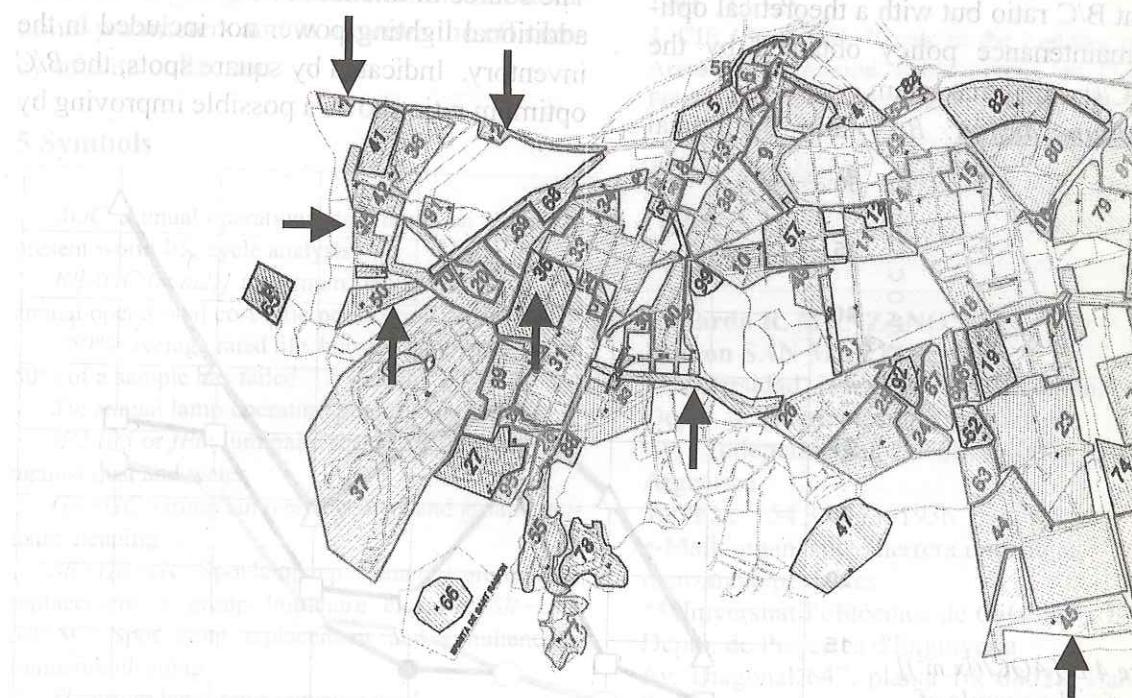


Figure 3 Roads and switchboards selected from *Parc del Serral de Marina* the city at a point of time

From each installation the data collected was:

- characteristics: lamp type, luminaire IP, pollution degree
- maintenance policy, relamping and cleaning periods
- permanent failure rate
- E_{ave} at the present time and after cleaning and relamping operations
- switching time schedule
- energy tariff contract
- cost: installation, maintenance, energy, disposal etc.

From the data collected the B/C ratio was calculated for each switchboard, considering four special situations to be compared one against each other:

actual: B/C ratio value calculated for the lighting installation with maintenance policy, energy consumption and lighting service quality parameters (Eave, failure rate, switching operation times) at the present time.

efficient: B/C ratio value calculated as actual B/C ratio but with a theoretical energy efficient consumption.

optimum: B/C ratio value calculated as efficient B/C ratio but with a theoretical optimum maintenance policy obtained by the $B/[AOC/(lx.m^2)]$ maximum criteria.

optimum design: B/C ratio theoretical

value calculated with a new design according to the functional needs energy efficient practice and with the optimum maintenance policy.

The actual B/C value can be compared with the different theoretical situations. A difference between the actual and the efficient B/C ratio will be associated to an energy problem. A difference between the actual and the optimum B/C ratio will be associated to maintenance policy problem. A difference between the actual and the optimum design B/C ratio will be associated to an inappropriate design. If there is any significant difference, a more deep analysis will be necessary to identify the specific source. For each switchboard (horizontal axis of figure 4) and all the situations above described the B/C ratios were calculated and indicated in figure 4.

In figure 4, the B/C ratio for the actual situation (full spots) is overlapped by the B/C ratio for the efficient situation (circle spots) except at switchboard 35 where an increase in energy consumption has increased also the costs and therefore reduced the actual B/C ratio. The source of this difference was found to be additional lighting power not included in the inventory. Indicated by square spots, the B/C optimum ratio shows a possible improving by

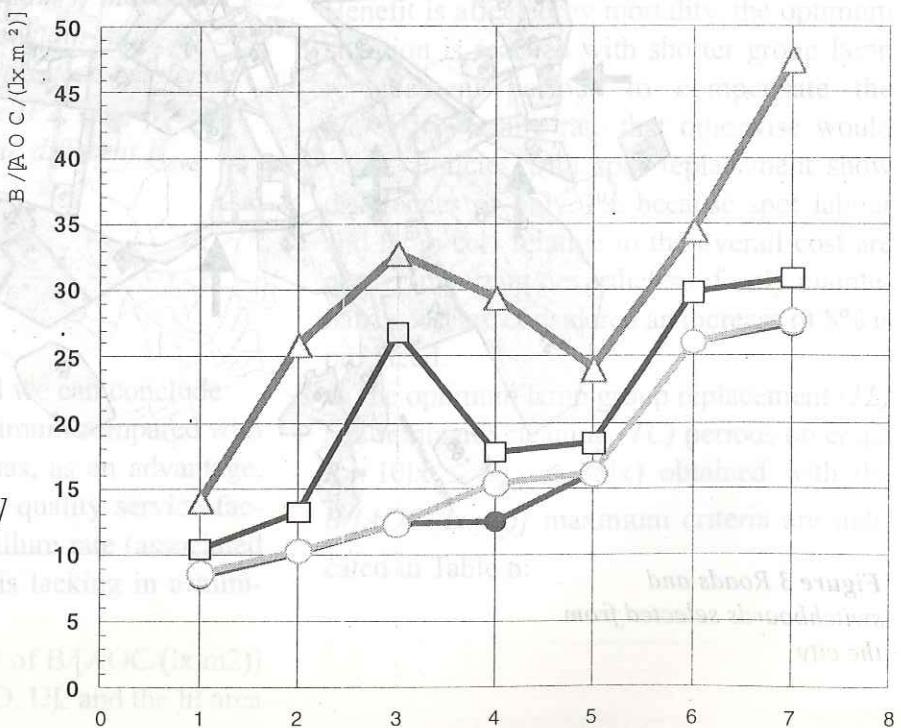


Figure 4 $B/[AOC/(lx.m^2)]$ values for the sample of installations studied.

changing the maintenance policy. A closer look to switchboard 2 reveals that the actual Eave is lower than the reference illuminance, a fact which is not convenient to compensate by means of maintenance but with a proper renovation of the installation. The B/C optimum design values are indicated with triangle spots. The great difference is observed in switchboards 1, 2, 36 and 29 that correspond to the oldest installation. The B/C ratio alone could not be a sufficient argument for a renovation, others indicators, like simple payback could add additional information.

4 Conclusions

The B/C ratio can be used as a criterion for urban lighting installations design and also as a evaluation tool for existing lighting installations. In the last case, if the sample analysed is big enough the results can be extrapolated to the entire city. Periodical controls (6 to 12 month periods) measuring and checking the B/C parameters can allow to trace the evolution on time, to adjust the parameters involved and the lighting management. Research is going on in order to include additional parameters and to improve the efficiency of data collection.

5 Symbols

AOC: Annual operational cost based on a uniform present worth life cycle analysis

B/[AOC/(lx.m²)]: maximum: maximum Benefit to annual operational cost ratio per lux and square meter

T50%: average rated life, burning lamp hours when 50% of a sample has failed

T0: annual lamp operating time [hours]

IP2 IP5 or IP6: luminaire sealed degree protection against dust and water

GR+GC: Group lamp replacement and group luminaire cleaning

SR+GR+GC: Spot lamp replacement + group lamp replacement + group luminaire cleaning *SR+GC:*

SR+SC: Spot lamp replacement and simultaneous luminaire cleaning

TL: group lamp replacement period

TC: group cleaning luminaire period

LSF: Lamp survival factor. Percentage of survival lamps after a period of time

LLMF: Lamp lumen maintenance factor

LMF: Luminaire maintenance factor

MF: Installation maintenance factor

E_{ave}: Minimum maintained average illuminance over de road surface [lx]

L_{ave}: Minimum maintained average luminance over de road surface [cd/m²]

U₀: Overall luminance uniformity $U_0 = L_{min}/L_{ave}$

U_L: Lengthwise luminance uniformity

TI%: Threshold increment, glare limitation criteria

6 Acknowledgements

The authors wish to thank S.E.C.E. and M.O.S.E.C.A. Lighting maintenance companies from Barcelona, Spain and specially Universidad Nacional de Tucumán, CONICET and FOMEC for the financial support given to E. Manzano to let him stay at the Universitat Politècnica de Catalunya, Barcelona, Spain.

7 References

1. Manzano E.R., San Martín R., 1999, "Procedure for continue urban lighting management evaluation". Proceedings of the 24th CIE, (Commission Internationale de l'Eclairage) Session, Warsaw, Poland, 234 - 238.
2. Marsden A.M.: "The economics of lighting maintenance", Lighting Research & Technology, 25, UK, 1993, 112-125.
3. CIE 136 , 2000, "Guide to the Lighting of Urban Areas". Commission Internationale de l'Eclairage. Publication CIE No 136 ISBN 3 900 734 98

Intrat în redacție: 20.06.2001

**Eduardo R. MANZANO*,
Ramon SAN MARTIN ****

*Universidad Nacional de Tucumán, FCEyT,
Depto. de Luminotecnia Luz y Visión
Av. Independencia 1800, 4000, Tucumán,
Argentina

Tel./Fax: +54 381 4361936

e-Mail: emanzano@herrera.unt.edu.ar,
manzano@pe.upc.es

**Universitat Politècnica de Catalunya, ETSEIB,
Depto. de Projectes d'Enginyeria
Av. Diagonal 647, planta 10, 08028, Barcelona,
Spain

Tel.: +34 93 401 71 68/9 Fax: +34 93 334 02 55

e-Mail: sanmartin@pe.upc.es

EFFECT OF DIMMING ON LAMP LIFE - RESULTS OF A LAMP LIFE TEST

Eino TETRI,
Helsinki University of
Technology

Abstract

A lamp life test was used to study the effect of dimming on lamp life and the lumen maintenance of fluorescent lamps. There were eight test groups and in each test group there were fifteen lamps. Lamps were burned undimmed or dimmed to 1%, 5% or 15% luminous flux level or dimmed dynamically. The static and dynamic dimming was simulating dimming according to daylight. The results show that with electronic ballasts, lamps will reach the nominal lamp life even if the lamps are dimmed according to daylight. Results show that neither the lamp nor the electronic ballast are obstacles for wider use of daylight with artificial lighting.

1 Introduction

The failure of fluorescent lamps is caused mainly by the loss of the electron emissive coating of the lamp electrodes, and the electrode temperature directly determines the rate of loss of this emissive coating [1]. Thus, the electrode temperature directly affects the lamp life [2]. The rate at which the emissive coating leaves the electrodes during starting and operation depends on many factors, including filling gas pressure, electrode characteristics, lamp operating current, wave-shape of lamp current, direct-current operation, lamp operating voltage, surrounding air temperature, type of starter (quality of start), type of ballast, ballast/lamp combination and high frequency operation [3].

When a lamp is dimmed, the current through the lamp decreases and without any action taken, the cathode temperature decreases. The temperature in dimming use is maintained by an additional heating current through the cathode. The total current is the sum of the discharge current and heating current, Figure 1. The figure is only schematic, in practice the heating current can be conducted to the electrode through both wires. Additional heating current ensures good lamp life performance. If the cathode voltage

is increased too much, it can cause increased end darkening. [1] [4] [5]

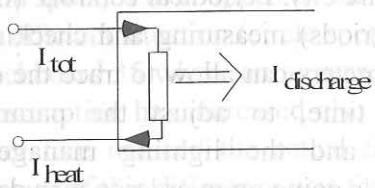


Figure 1 In dimming use the temperature of the cathode is maintained with the heating current I_{heat}

The amount of daylight indoors is dependent on many variables. These are for instance the size and shape of the window, the point of compass and shape and surface reflectances of the room and external barriers shadowing the windows. The daylight coming inside is not directly proportional on the horizontal illuminance outside, but is dependent on the direction of the sun and the brightness of the sky. Also on cloudy days the daylight indoors can be high, if the luminance of the clouds, facing the windows, is high. On the contrary, a clear, blue sky can cause quite low daylight levels indoors.

Lighting constitutes from 20% to 60% of all

electrical energy consumption in buildings. In Knight's measurements lighting annual power consumption decreased from 5.2 W/m² to 0.6 W/m² in a room not specifically designed for admittance of daylight. He used a photocell control of individual fluorescent luminaires. The energy savings were between 74% to 89% compared to switch-start system. The savings when starting from a high-frequency luminaire were 44% to 76%. The luminaires were arranged not to turn off but instead to dim to 10% and remain there. This was to avoid an unacceptable distraction to the occupants. [6]

Embrechts and Van Bellegem (1997) pointed out that the energy savings through daylight are possible only if the control systems function unnoticed by the user. Centralised control system often cause annoyance and complaints and dissatisfied users will sabotage such disturbing control systems. They monitored two years for systems that control the lighting individually for each luminaire, dependent on the luminance level under the luminaire. The results show energy savings between 20% and 50% and very high user satisfaction. [7]

In another study, on a clear day with direct sunlight the luminaires near the window and in the central of the room were dimmed to the minimum level between 7 o'clock and 18. Also on the rear wall the luminaires were dimmed to minimum from 9 o'clock till 17. [8]

A control system based on daylight makes great demands on lamps and ballasts. For instance, on a semi-cloudy day the daylight levels inside can vary very rapidly. If an artificial lighting system is adjusted to keep the lighting level constant, it has to dim the lamps continuously and quite quickly.

2 Lamp life test

The effect of cathode heating on fluorescent lamps was studied with a lamp life test. Lamps were burned in open test racks. The

supply voltage to the test racks was fed through voltage stabilisers. The supply voltage was 230 V and the frequency was 50 Hz. The rated voltage and frequency declared by the ballast manufacturer were 230-240 V and 50-60 Hz, respectively. The temperature of the test room was +22 °C ± 5 °C. The lamps were checked five times a week.

There were eight test groups and in each test group there were 15 lamps. The lamps were from 5 different manufacturers, three lamps from each. Lamp wattage was 36 W, the correlated colour temperature was 3000 K and the general colour rendering index was between 80 and 90 (group 1B). Lamps were T8-lamps, so the diameter of the lamp was 26 mm and length 1200 mm. The phosphor coating was triphosphor. The burning cycle was 3 hours, which included a 15-minute break.

The lamps were burned on four different luminous flux dimming levels. Two test groups were burned undimmed, one with conventional magnetic ballast and the other with electronic ballast. In the dimmed test groups, the luminous flux of an individual lamp with electronic ballast was dimmed either to 1%, 5% or 15% of the full output value measured with the reference ballast. In addition of the statically dimmed test groups, there were three test groups in which the luminous flux was dimmed dynamically.

The objective of dynamic dimming was to find the lamp life when lamps are continuously dimmed. This simulates dimming according to daylight levels. Figure 2 shows the luminous flux levels of the dynamic test groups. For instance, in Dynamic 1 the whole cycle was 2 hours 55 minutes. The dimming levels were 100%, 75%, 50%, 25%, 15% and 5%. Dimming from one level to another was done slowly. It took two and a half minutes to move from one level to another. After the dimming period, the lamps were burned for 10 minutes at each level. There were two 10-minute off-periods

during one cycle. The off-periods were after 5% level and after 100% level.

Ballasts were supplied from one manufacturer only. The electronic ballasts provided pre-heating current through the electrodes before starting.

is, after 100, 1000, 2000, 4000, 8000 and 12000 burning hours. The luminous flux was measured using a reference ballast. Before the first measurement, lamps were seasoned 100 hours. Before the measurement in an integrating sphere, the lamps were first burned in a pre-warming rack at a minimum of 28 minutes and then moved into the integrating sphere. An additional warming

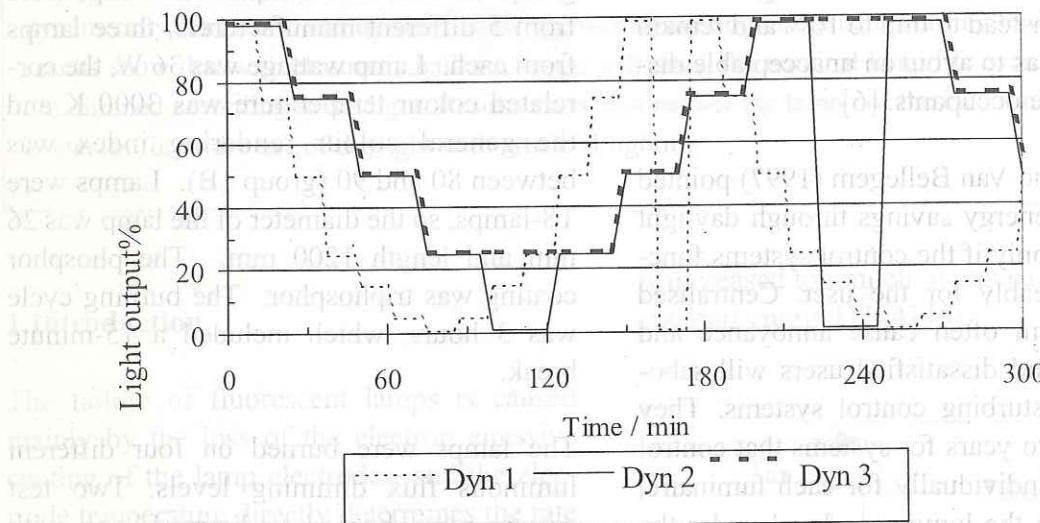


Figure 2 The dynamic burning cycles in the lamp life test.

The relative number of breaks (switch-offs) during burning hours has been marked as one in a 3-hour burning cycle. In Dynamic 1 there are 2.1 times more switch-offs and in Dynamic 2 1.6 times more than in the 3-hour burning cycle. In Dynamic 3 there are no switch-offs.

Photometric and electrical measurements were made after specific burning hours, that

period was 7 minutes in the integrating sphere. The reference ballast was on at least one hour before the first measurement. The luminous flux was measured with a spectrometer. Thus, the colour parameters, correlated colour temperature and general colour rendering index could be measured simultaneously.


	Groups 1..5	Dyn 1	Dyn 2	Dyn 3
Duration of one cycle	3 h	2h 55'	4h 10'	4h 10'
Number of breaks during one cycle	1	2	2	0
Length of a break	15'	10'	20'	
Relative number of breaks during burning hours	1	2.1	1.6	

Table 1 Burning cycles in different test groups.

3 Results

When lamps were burned undimmed the lumen maintenance factor was 92.1% with an electronic ballast and 92.3% with a magnetic ballast calculated from the measured 100 h value. The lumen maintenance factor of one test group was an average of fifteen lamps. When lamps were dimmed statically to 1%, 5% and 15%, the maintenance factors were 97.8%, 96.4% and 94.3%, respectively. With dynamic dimming the maintenance factors were 94.0% (Dyn 1), 93.4% (Dyn 2) and 96.1% (Dyn 3).

After 100 burning hours, the correlated colour temperatures (CCT) of test groups 1 to 8 were between 3030 K and 3050 K. The CCT of one test group was an average of fifteen lamps. After 12 000 burning hours the CCTs of eight test groups were between 2970 K and 3020 K. CCTs of different test

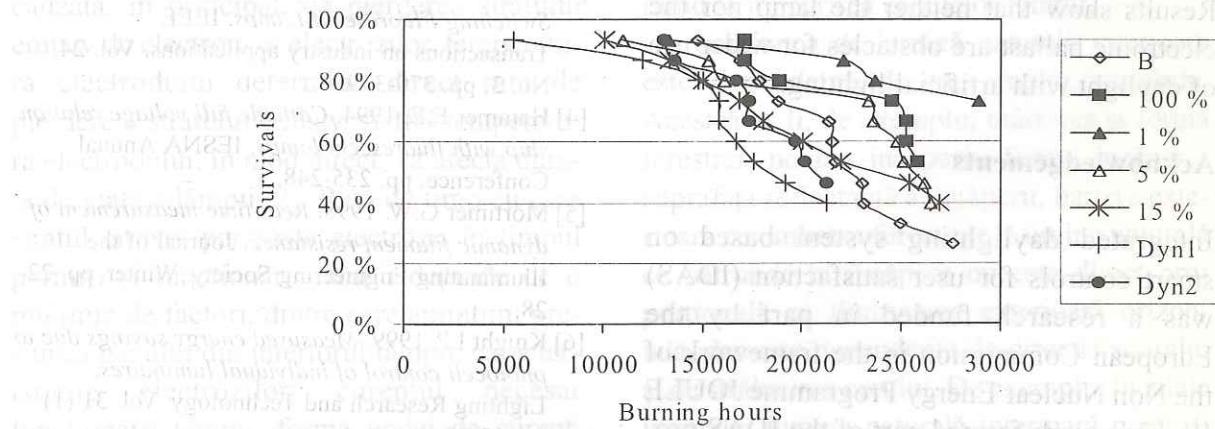

groups decreased by 14 K to 75 K during burning hours. The variations between different manufacturers were larger than were the variations due to the burning of lamps. The standard deviations of the CCTs of fifteen lamps in eight different test groups were about 50 K both after 100 and 12 000 burning hours. For example, in test group 2, the CCT of manufacturer A was 3030 K and manufacturer B 2910 K after 100 burning hours.

The general colour rendering index (Ra) of test groups 1 to 8 was between 84.8 and 85.1

after 100 burning hours. The Ra of one test group was an average of fifteen lamps. The variations in colour rendering indices between individual lamps and the variations caused by burning were insignificant.

Figure 3 shows the mortality of different test groups. With electronic ballasts the lamp life was longer than with magnetic ballasts, even if the lamps were burned dimmed to low light levels. In Dynamic 1 and 2 the lamp lives were shorter than with magnetic ballast, but in these test groups, the burning cycles were shorter than the 3-hour used in other test groups. In Dynamic 3, lamps were dimmed dynamically without breaks, and in that test group there were no dead lamps after 18 000 burning hours. Therefore, one can conclude that the switching cycle had stronger influence on the lamp life than the dynamic dimming.

Figure 3 Mortality curves of different test groups. All lamps in Dynamic 3 were alive after 18 000 burning hours.

4 Conclusions

The lumen reduction did not shorten the economical lamp life. When lamps were dimmed at low light levels (1% and 5%) statically, the lumen maintenance was higher than if lamps were burned undimmed. The effect of breaks on the lumen maintenance

was greater than the effect of dynamic dimming. To conclude, lamps can be burned continuously at low light levels and dimmed dynamically without the lumen reduction causing lamp replacement.

The shifts in colour temperatures between different manufacturers were larger than the variations due to the burning of lamps. The variations in colour rendering indices were insignificant.

Mortality was higher in the dimmed test groups than in the undimmed test groups. Mortality was lower on the 1% and 5% dimming levels than on the 15% dimming level. Of the dynamic dimming test groups, the mortality was lowest in Dynamic 3, where there were no breaks. With electronic ballasts, lamps will reach their nominal lamp life, even if lamps are dimmed statically or dynamically.

Results show that neither the lamp nor the electronic ballast are obstacles for wider use of daylight with artificial lighting.

Acknowledgements

Integrated daylighting system based on smart controls for user satisfaction (IDAS) was a research funded in part by the European Commission in the framework of the Non Nuclear Energy Programme JOULE III. This work formed part of the IDAS project coordinated by Helvar.

References

- [1] Ji Y., Davis R., O'Rourke C. & Chui E. 1999. *Compatibility testing of fluorescent lamp and ballast systems*. IEEE Transactions on Industry Applications. Vol. 35 (6), pp 1271-1276.
 - [2] Ji Y. & Davis R. 1996. *Reducing the uncertainty in fluorescent lamp/ballast system compatibility*. Industry Applications Conference. 31st IAS Annual Meeting. Vol. 4. pp. 2189-2193.
 - [3] Carričre L.A. & Rea M. 1988. *Economics of Switching Fluorescent Lamps*. IEEE Transactions on industry applications. Vol. 24, No. 3, pp. 370-379.
 - [4] Hammer E.E. 1994. *Cathode fall voltage relationship with fluorescent lamps*. IESNA Annual Conference. pp. 235-248.
 - [5] Mortimer G.W. 1998. *Real-time measurement of dynamic filament resistance*. Journal of the Illuminating Engineering Society. Winter. pp. 22-28.
 - [6] Knight I.P. 1999. *Measured energy savings due to photocell control of individual luminaires*. Lighting Research and Technology. Vol. 31 (1). pp. 19-22.
 - [7] Embrechts R. & Van Bellegem C. 1997. *Increased energy savings by individual light control*. Right Light 4. Proceedings of the 4th European Conference on Energy-Efficient Lighting. Vol 1. Copenhagen, Denmark pp. 179-182.
 - [8] Christoffersen J., Petersen E. & Johnsen K. 1997. *An experimental evaluation of day light systems and lighting control*. Right Light 4. Proceedings of the 4th European Conference on Energy-Efficient Lighting. Vol 2. Copenhagen, Denmark pp. 245-254.

Paper presented at the International Conference ILU-MINAT 2001, June 28-30, 2001, Cluj-Napoca

EFFECTUL DIMINUĂRII (DIMMING) ASUPRA VIEȚII LĂMPII - REZULTATE TEST

Rezumat

Un test asupra duratei de viață a lămpilor a fost utilizat pentru a studia efectul diminuării nivelului fluxului luminos asupra duratei de viață a lămpii și asupra menținării fluxului luminos a lămpilor fluorescente. S-au utilizat 8 grupuri de test, fiecare fiind format din 15 lămpi. Lămpile au fost împărțite în mai multe categorii. Unele au funcționat fără diminuare a fluxului luminos, iar restul au fost în una din categoriile cu diminuarea nivelului fluxului luminos de 1%, 5% sau 15% sau cu diminuare dinamică. Diminuarea statică și dinamică reprezintă, de fapt, simularea diminuării sau modificării fluxului luminos în funcție de lumina naturală. Rezultatele arată faptul că lămpile cu balast electronic vor atinge durata de viață nominală chiar dacă nivelul fluxului luminos al lămpilor a fost redus în funcție de lumina naturală. Rezultatele arată că nici lampa și nici balastul electronic nu constituie obstacole pentru o mai largă utilizare a luminii naturale în combinație cu cea artificială.

Introducere

Defectarea lămpilor fluorescente este cauzată, în principal, de pierderea stratului emisiv de electroni al electrozilor, temperatură electrodului determină direct rata de pierdere a stratului emisiv. Astfel temperatura electrodului, în mod direct, va afecta durata de viață a lămpii [2]. Rata de timp cu care stratul emisiv părăsește electrozii în timpul pornirii și funcționării lămpii depinde de o mulțime de factori, dintre care amintim: presiunea gazului din interiorul lămpii, caracteristicile electrozilor, curentul necesar funcționării lămpii, forma undei de curent, curentul direct de funcționare, tensiunea de funcționare a lămpii, temperatura aerului înconjurător, tipul starterului (calitatea pornirii), tipul balastului, combinația balast-lampă și funcționarea la înaltă frecvență [3].

Când nivelul fluxului luminos al unei lămpi este diminuat, curentul prin lampă descrește, ceea ce duce la scăderea temperaturii catodului. Temperatura în cazul utilizării diminuării este menținută de un curent de încălzire adițional - Figura 1.

Figura este numai schematică, în practică curentul de încălzire poate fi condus spre catod prin ambele fire. Curentul de încălzire

adițional asigură performanțe bune pentru durata de viață a lămpii. Dacă tensiunea este crescută prea mult atunci poate duce mai rapid la înnegrire capetelor lămpii.

Cantitatea de lumină naturală interioară este dependentă de mai multe variabile. Acestea ar fi, de exemplu, mărimea și forma ferestrei, poziția încăperii, forma încăperii, suprafața reflectantă a încăperii, bariere exterioare ce umbresc ferestrele. Lumina naturală ce pătrunde în încăpere nu este direct proporțională cu iluminarea exterioară orizontală, dar este dependentă de direcția soarelui și de strălucirea cerului. De exemplu, în zilele înnorate, lumina naturală interioară poate fi considerabilă, dacă luminanța norilor este mare comparativ cu cea a ferestrelor, pe când un cer senin poate determina niveluri ceva mai scăzute pentru lumina naturală interioară. Iluminatul reprezintă 20-60% din consumul de energie pentru clădiri. Măsurările lui Knight arată cum consumul anual de putere pentru iluminat descrește de la 5,2 W/m² la 0,6 W/m² într-o încăpere ce nu a fost proiectată special pentru pătrunderea luminii. El a utilizat controlul cu fotocelulă individual al lămpilor fluorescente. Economia de energie a fost între 74% și 89% comparativ cu un sistem ce folosește doar intreruptoare.

Când s-au folosit corpurile de iluminat de înaltă frecvență, economia a fost între 44% și 76%. Corpurile de iluminat au fost dispuse astfel încât să nu fie necesară stingerea lor, dar să aibă posibilitatea de-a diminua fluxul luminos cu 10%, valoare la care să rămână în continuare, pentru a evita apariția disconfortului ocupanților.

Embrechts și Van Bellegem (1997) au indicat faptul că economii de energie prin folosirea luminii naturale sunt posibile numai dacă sistemul de control are o funcționare imperceptibilă pentru utilizator. Sistemul de control cauzează deseori supărare și nemulțumire, iar utilizatorii nemulțumiți vor sabota sistemul de control. Timp de doi ani au fost monitorizate sisteme care controlează iluminatul individual pentru fiecare corp de iluminat în funcție de nivelul luminanței sub fiecare corp de iluminat. Rezultatele arată economii de energie între 20% și 50% și un foarte mare grad de satisfacție pentru utilizatori.

Într-un alt studiu se arată faptul că într-o zi cu cer senin și cu lumină solară directă, corpurile de iluminat de lângă fereastră și din centrul încăperii au prezentat o diminuare maximă a nivelului fluxului de lumină între orele 7 și 18, iar pentru corpurile de iluminat de pe peretele opus, diminuarea a fost maximă între orele 9 și 17.

Un sistem de control funcție de lumina naturală cere mult de la lămpi și balasturi. De exemplu, într-o zi parțial înnorată, nivelurile interioare ale luminii naturale pot varia rapid. Dacă un sistem de iluminat a fost proiectat să păstreze nivelul de luminare constant, atunci va trebui să diminueze sau să mărească nivelul fluxului luminos continuu și foarte rapid.

Testul asupra duratei de viață a lămpilor

Efectul încălzirii catodului lămpilor fluorescente a fost studiat în cadrul testului asupra duratei de viață a lămpilor. Lămpile au fost aprinse în rack-uri de test. Tensiunea de alimentare pentru aceste rack-uri a fost obținută de la un stabilizator de tensiune.

Tensiunea de alimentare a avut valoarea de 250 V, iar frecvența de 50 Hz. Valorile date de fabricantul balastului pentru tensiune și frecvență sunt de 230-240 V și respectiv 50-60 Hz. Temperatura din încăperea de test a fost de $22^{\circ}\text{C} \pm 5^{\circ}\text{C}$. Lămpile au fost verificate de 5 ori pe săptămână.

S-au folosit 8 grupe de test iar fiecare grup conținea 15 lămpi. Lămpile folosite au fost achiziționate de la 5 producători diferiți, câte trei de la fiecare producător pentru fiecare grup. Puterea unei lămpi a fost de 36 W. Culoare de temperatură corelată a fost de 3000K și indicele general de redare al culorii a fost între 80 și 90 (grupul 1B). Lămpile utilizate au fost de tipul T8, astfel diametrul unei lămpi a fost de 26 mm și lungimea de 1200 mm. Stratul emisiv a fost realizat din trifosfor. Ciclul de funcționare al lămpilor a fost de 3 h în funcție 15 min pauză.

Lămpile au fost testate pentru 4 niveluri de diminuare a fluxului luminos. Două grupe test au fost fără diminuarea fluxului luminos. Un grup fiind prevăzut cu balast magnetic convențional, iar celălalt cu balast electronic. În cazul grupelor de test cu diminuare, fluxul luminos pentru o lampă cu balast electronic a fost redus la 1%, 5% sau 15% din valoare măsurată în cazul lămpilor cu balast de referință. Pe lângă grupele de test cu diminuare statică au fost folosite și trei grupe în care fluxul luminos a fost diminuat mecanic. Obiectivul diminuării dinamice a fost de a determina durata de viață a lămpilor când fluxul luminos al acestora este continuu modificat. Acestea simulează modificarea fluxului luminos în funcție de nivelul luminii naturale.

Figura 2 prezintă nivelurile de flux luminos ale grupelor de test cu modificare dinamică a fluxului luminos. De exemplu în Dynamic 1 întregul ciclu a fost de 2 h și 55 min. Nivelurile de diminuare au fost de 100%, 75%, 50%, 25%, 15% și 5%. Modificarea de la un nivel la altul s-a făcut lent (două minute și jumătate). După fiecare perioadă de modificare a fluxului luminos lămpile au fost lăsate să funcționeze câte 10 min pentru noul nivel al fluxului luminos, iar

de-a lungul unui ciclu de test s-au făcut 2 pauze de câte 10 min. Pauzele s-au făcut după nivelele de 5% și de 100%.

Balasturile utilizate au fost achiziționate numai de la un singur producător. Balasturile electronice au furnizat curent de preîncălzire prin electrozii lămpilor înainte de punerea în funcțiune a acestora.

Numărul relativ de întreruperi de-a lungul orelor de funcționare au fost considerate ca una la 3 h de funcționare. În cazul Dynamic 3 nu au existat întreruperi.

Măsurătorile fotometrice și electrice au fost făcute după orele specifice de funcționare și anume după 100, 1000, 2000, 4000, 8000 și 12.000 de ore de funcționare. Fluxul luminos a fost măsurat utilizând un balast de referință. Înainte de prima măsurătoare, lămpile au fost în funcțiune timp de 100 h. Înainte de a măsura în sferă integratoare, lămpile au fost mai întâi puse într-un rack de preîncălzire minim 28 de minute și apoi au fost mutate în interiorul sferei integratoare. O perioadă suplimentară de încălzire de 7 min s-a impus și în sferă integratoare. Balastul de referință a fost în funcțiune cel puțin o oră înaintea primei măsurători. Fluxul luminos a fost măsurat cu un spectometru. Astfel, parametrii de culoare, temperatura de culoare corelată și indicele general de redare a culorii pot fi măsurați simultan.

Rezultate

În cazul lămpilor care nu prezintau posibilitatea de modificare a fluxului luminos factorul de menenanță a fost de 92,1% la cele cu balast electronic și 92,3% la cele cu balast magnetic, calculat la 100 h de funcționare. Factorul de menenanță a fluxului a unui grup de test este o medie a factorilor de menenanță corespunzător celor 15 lămpi. Când lămpile au fost prevăzute cu diminuare statică a fluxului luminos la 1%, 5% și 15% factorul de menenanță a fost de 97,8%, 96,4% și respectiv 94,3%, iar în cazul celor cu modificarea dinamică a fluxului luminos, factorul de menenanță a fost 94,0%

(Dyn1), 93,4% (Dyn2) și 96,1% (Dyn3).

După 100 h de funcționare, temperatura de culoare corelată (TCC) a celor 8 grupe a fost între 3030 K și 3050 K. TCC a unui grup este o medie pentru cele 15 lămpi ale grupului. După 12.000 h de funcționare, TCC a celor 8 grupe a fost între 2970 K și 3020 K. TCC a diferitelor grupe de test descrește cu 14K până la 75K de-a lungul orelor de funcționare. Variațiile TCC datorate producătorului lămpilor au fost mult mai mari decât variațiile datorate orelor de funcționare ale lămpilor. Deviația standard a temperaturilor de culoare corelate a lămpilor celor 8 grupe de test a depășit 50 K atât după 100, cât și după 12.000 h de funcționare. De exemplu, în grupul de test 2, TCC are valoarea pentru producătorul A de 3030K iar pentru producătorul B de 2910K după 100 h de funcționare. Indicele general de redare al culorii (Ra) pentru cele 8 grupe de test a fost între 84,8 și 85,1 după 100 h de funcționare. Indicele Ra al unui grup de test reprezintă o medie a indicilor corespunzători celor 15 lămpi ale grupului. Variațiile între lămpi a indicilor de redare a culorii precum și variațiile datorate orelor de funcționare sunt nesemnificative.

Figura 3 arată mortalitatea diferitelor grupe de test. Cu balast electronic durata de viață a lămpilor este mai lungă decât în cazul lămpilor cu balast magnetic chiar dacă lămpile au funcționat pentru nivele scăzute ale fluxului de lumină. În grupele Dynamic 1 și 2 durata de viață a fost mai scurtă decât în cazul lămpilor cu balast magnetic, dar în aceste grupe de test ciclul de funcționare a fost mai scurt de 3 h ca cele utilizate în alte grupe de test. În Dynamic 3 fluxul luminos al lămpilor a fost modificat dinamic fără a face pauze și în acest grup de test nu au existat lămpi defecte după 18.000 h de funcționare. Așadar, în concluzie, ciclul cu comutare are o influență mai puternică asupra duratei de viață a lămpilor decât în cazul lămpilor cu diminuare dinamică.

Concluzii


Reducerea fluxului luminos nu scurtează durata de viață economică a lămpilor. Când fluxul luminos a fost redus static la niveluri joase (1% și 5%), mențenanța fluxului luminos a fost mai mare decât în cazul lămpilor cu funcționare nediminuată. Efectul intreruperii asupra menținerii fluxului luminos este mai mare decât efectul dat de modificarea dinamică a nivelului fluxului luminos. Pentru a concluziona, lămpile pot funcționa continuu pentru niveluri scăzute ale luminii și diminuate dinamic fără ca reducerea fluxului luminos să cauzeze înlocuirea lămpii. Deplasările de temperatură de culoare între diferiți producători au fost mai mari decât variațiile datorate orelor de funcționare a lămpilor. Variația indicilor de redare a culorii au fost nesemnificative.

Mortalitatea a fost mai mare în cazul grupurilor de test cu diminuare de flux decât în cazul grupurilor fără diminuare de flux. Mortalitatea a fost mai scăzută în cazul grupurilor cu niveluri de diminuare de 1% și 5% decât în cazul grupului cu nivel de diminuare de 15%. În cazul grupurilor cu diminuare dinamică, mortalitatea a fost mai scăzută în cazul Dynamic 3 unde nu au fost îintreruperi. Cu balasturi electronice, lămpile vor atinge durata de viață nominală chiar dacă acestea au fost prevăzute cu diminuare statică sau dinamică a nivelului fluxului luminos.

Rezultatele arată că nici lampa și nici bălastul electronic nu sunt obstacole pentru larga utilizare a luminii naturale combinate cu cea artificială.

Multumiri

Sistemele integrate pentru controlul iluminatului funcție de lumina naturală bazate pe controlul intelligent pentru satisfacția utilizatorilor (IDAS) este o cercetare propusă, în parte, de Comisia Europeană în cadrul Programului Non Nuclear Energy Programme JOULE III. Această activitate a format o parte a proiectului IDAS coordonat de Helvar.

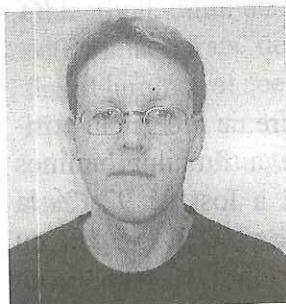

P.O.Box 3000, FIN-02015 HUT
Finland
e-mail:eino.tetri@hut.fi

Research Scientist at the Lighting Laboratory of Helsinki University of Technology. Author of more than 40 national and international articles in the field of lighting. Research area light sources

CIE

COMMISSION INTERNATIONALE DE L'ECLAIRAGE
COMITETUL NATIONAL ROMÂN DE ILUMINAT

CNRI

Sesiunea de Deschidere

LÖFBERG Hans Allan, Președintele CIE - Comisia Internațională de Iluminat

ORGANIZATORI




UNIVERSITATEA TEHNICĂ DIN CLUJ-NAPOCA
CENTRUL DE INGINERIA ILUMINATULUI



ELECTRICA S.A.
SUCURSALA DE DISTRIBUȚIE CLUJ



ENERGOBIT SCHRÉDER LIGHTING S.R.L.



Conferința
internățională
ILUMINAT
2 0 0 1

28-30 iunie, Cluj-Napoca

PROGRAMUL CONFERINȚEI

Miercuri, 27 iunie 2001

20,00 Cocktail de primire la Restaurantul Hotel Sport

Joi, 28 iunie 2001

9,00 Înregistrarea participanților

Sesiunea de Deschidere

9,30 Discursuri oficiale

10,00 LÖFBERG Hans Allan, Președintele CIE - Comisia Internațională de Iluminat
CIE in the world

10,15 BIANCHI Cornel, Președintele CNRI - Comitetul Național Român de Iluminat
Conceptia modernă a sistemelor de iluminat interior: "O necesitate actuală"

10,35 van BOMMEL Wout, Vice-președinte al PHILIPS Lighting Eindhoven
History of road.lighting research as a guide for future research

11,15-11,45 Pauză de cafea, răcoritoare, discuții

11,45 STOCKMAR Axel, Președintele Comitetului Național German de Iluminat
Proposal for a European Utilization Factor method

12,10 POP Florin, Vice-președinte al CNRI - Comitetul Național Român de Iluminat
Învățământul luminotehnic în România (Lighting education in Romania)

12,25 PÉTER Pal, Director General al ENERGOBIT SCHRÉDER Lighting
Iluminatul arhitectural al instalațiilor industriale (Architectural lighting of industrial installations)

12,40 Deschiderea expoziției
Pauză de cafea, răcoritoare, discuții

13,30 MOROLDO Dan, șeful Catedrei de Luminotehnică și Instalații electrice, Facultatea de
Instalații, Universitatea Tehnică de Construcții București
O nouă concepție în realizarea sistemelor de iluminat interior

13,50 BEU Dorin, Universitatea Tehnică din Cluj-Napoca
Iluminatul sălilor de conferință (Lighting of the conference rooms)

Vineri, 29 iunie 2001

9,00 - 10,45 *Sesiunea 1 - Mediu Interior și Proiectarea Iluminatului*

10,45 - 11,00 Pauză de cafea, răcoritoare, discuții

11,00 - 12,45 *Sesiunea 2 - Iuminat Exterior*

12,45 - 13,00 Pauză de cafea, răcoritoare, discuții

13,00 - 14,45 *Sesiunea 3 - Vedere și Culoare. Aspekte Generale ale Iluminatului*

15,00 - 16,00 Masa de prânz la Restaurantul Hotel Sport

16,00 - 17,45 *Sesiunea 4 - Alte Aplicații*

17,45 - 18,30 Închiderea Conferinței

Sponsorii Conferinței

ENERGOBIT Schréder Lighting

Osram România

PRAGMATIC Comprest

Participanții la Expoziție

(în ordine alfabetică)

ARTECNO

DEMCO

ENERGOBIT Schréder Lighting

ENERGOLUX

LUXTEN Lighting

NEDAL Aluminium BV, Utrecht

NEON Lighting

ORION Electrics

PRAGMATIC Comprest

Locul de desfășurare a Conferinței

Baza Electrică - Str. Ilie Măcelaru Nr. 28 Cluj-Napoca

Cazarea

Hotel Sport - Str. Coșbuc Nr. 15 Cluj-Napoca

Conturile bancare ale Conferinței

Banca Comercială Română, Sucursala Cluj,
"Conferința ILUMINAT 2001"

În LEI: 2511.31-539.42/ROL

În EURO: 2511.31-539.41/EURO

Persoanele de contact

- secretar - dr.ing. Dorin BEU,

093.661536; e-mail:

Dorin_Beu@mail.dntcj.ro

- pentru expoziție - ing. Gelu MUREȘAN,

tel.: (064) 195721/int. 122,

fax (064) 198409

- pentru cazare - ing. Florian PAGU,

tel.: (064) 195721/int. 259,

fax (064) 198409

Comitetul de Organizare

POP Florin

RUGA Gabriel

PÉTER Pal

Comitetul de Avizare Tehnică

BIANCHI Cornel

COSTEA Dorin

PÉTER Pal

POP Florin

Secretariatul Conferinței

BEU Dorin

MĂIEREAN Marilena

PAGU Florian

Președintele Comitetului de Organizare

Florin POP, tel. 095.516276

e-mail: Florin.Pop@insta.utcluj.ro

Lista lucrărilor

Lista lucrărilor

Sesiunea de Deschidere

1. LÖFBERG Hans Allan, Președintele CIE - Comisia Internațională de Iluminat
CIE in the world
2. BIANCHI Cornel, Președintele CNRI - Comitetul Național Român de Iluminat
Concepția modernă a sistemelor de iluminat interior: "O necesitate actuală" (The modern conception on the interior lighting systems: A present necessity)
3. van BOMMEL Wout, Vice-președinte al PHILIPS Lighting Eindhoven
History of road lighting research as a guide for future research
4. STOCKMAR Axel, Președintele Comitetului Național German de Iluminat
Proposal for a European Utilization Factor Method
5. POP Florin, Vice-președinte al CNRI - Comitetul Național Român de Iluminat
Învățământul luminotehnic în România (Lighting education in Romania)
6. PÉTER Pal, Director general al ENERGOBIT SCHRÉDER Lighting
Iluminatul arhitectural al instalațiilor industriale (Architectural lighting of industrial installations)
7. MOROLDO Dan, Șeful Catedrei de Luminotehnică și Instalații electrice, Facultatea de Instalații, Universitatea Tehnică de Construcții București
O nouă concepție în realizarea sistemelor de iluminat interior (A new conception on the execution of the interior lighting systems)
8. BEU Dorin, Universitatea Tehnică din Cluj-Napoca
Iluminatul sălilor de conferințe (Lighting of the conference rooms)

Sesiunea 1 Mediu Interior și Proiectarea Iluminatului

9. BAENZIGER Thomas D., Merloni Progetti spa Energy Saving, Milano
Energy management in lighting systems
10. van den BELD Gerrit, van BOMMEL Wout, Philips Lighting Eindhoven
Industrial lighting, productivity, health and well-being
11. DINCULES CU Paul, Universitatea "Politehnica" București
Quick, rational and accurate Lumen Method using minimum available data
12. IOACHIM Dan, NEMESCU Mircea, LUCACHE Dorin Dumitru, Universitatea Tehnică "Gh. Asachi" Iași
Contribuții la calculul iluminării prin metoda punct cu punct (Contributions to illuminance calculus using Point-by-Point Method)
13. MAIER Virgil, PAVEL Sorin, RAFIROIU Corina, Universitatea Tehnică din Cluj-Napoca
Soluționarea prin proiectare a economicității instalațiilor de iluminat interior (Economic efficiency design solution of the interior lighting installations)
14. SFETCU Cornel, Philips Romania SRL
Sistem TL5 (TL5 System)
15. ȘUVĂGĂU Cristian Viorel, BC Hydro, Vancouver, Canada
Control me - lighting efficiency in modern offices
16. TETRI Eino, Helsinki University of Technology
Effect of dimming on lamp life - Results of a lamp life test

Sesiunea 2 Iuminat Exterior

17. BIANCHI Cornel*, BURLACU Camelia**, *Universitatea Tehnică de Construcții București, **ELECTRICA S.A. București
Concepția/proiectarea sistemelor de iluminat destinate căilor de circulație urbană (Lighting system conception/design for urban traffic roads)
18. MOROLDO Hrisia Elena, Universitatea Tehnică de Construcții București
Poluarea luminoasă - efect negativ al unor soluții luminotehnice necorespunzătoare (Lighting pollution - negative effect of unsatisfactory lighting solutions)
19. NEIJENHUIS Jan, NEDAL Aluminium BV, Utrecht, Olanda
Standardisation of street-lighting poles under CEN regulations
20. ORBAN Sandor, Van Leer România S.R.L.
Parameters of achitectural lighting integration on the environment

Conferințe și simpozioane

21. POPOVIC Grozdana, City Planning Institute Belgrad
Decorative illumination of Belgrade bridges (urbanistic aspects)
22. ȘERBĂNESCU Silvian, LUXTEN Lighting București
Realizarea unui iluminat ambiental optim în zonele rezidențiale și cartierele de locuințe (Optimal amenity lighting for residential areas)
23. TOSIC Danica Marinkovic, City Planning Institute Belgrad
Contemporary Belgrade - Some thoughts on its lighting
- Sesiunea 3 Vedere și Culoare. Aspecte Generale ale Iluminatului**
24. DRNDAREVIC Ana, Minel-Schréder d.o.
Mesopic vision theory application in road lighting design
25. GĂLĂȚANU Cătălin Daniel, Universitatea Tehnică "Gh. Asachi" Iași
Evaluarea obiectivă a fenomenului de orbire fiziologică în conducerea auto pe timp de noapte (Objective evaluation of physiological glare in night auto driving)
26. POSTOLACHE Petru*, TOADER Cornel*, GOLOVANOV Nicolae*, SURDU Constantin*, BRĂNESCU Valentin**, ALBU Mihaela*, SCUTARIU Mircea***, CONSTANTIN Marius Dănuț*, *Universitatea "POLITEHNICA" București, Facultatea Energetică, **Universitatea "VALAHIA" Târgoviște, *** Sucursala de Distribuție a Energiei Electrice București
Probleme specifice de calitate a energiei electrice (CEE) în cazul surselor de lumină (Specifical problems of electric energy quality for lighting sources)
27. POP Mihaela, RAJAC Cluj-Napoca
O abordare calitativă a sistemelor de iluminat interior (A quality approach of the interior lighting systems)
- Sesiunea 4 Alte Aplicații**
28. CHINDRIȘ Mircea, ȘTEFĂNESCU Silviu, CZIKER Andrei, MÎCU Dan, Universitatea Tehnică din Cluj-Napoca
Electric power quality monitoring results of office buildings with large lighting systems
29. GĂLĂȚANU Cătălin Daniel, Universitatea Tehnică "Gh. Asachi" Iași
Analiza câmpului de luminanțe pentru zone de interes arhitectural în orașul Iași (Analysis of luminances field for architectural areas for Iassy city)
30. GRIF Horațiu ștefan, GLIGOR Adrian, BICĂ Dorin, Universitatea "Petru Maior" din Tg. Mureș
Controlul iluminatului și economia de energie (Lighting control and energy saving)
31. LAZĂR Șerban, Universitatea Tehnică de Construcții București
Analiză a deformațiilor semnalului sinusoidal datorate balastului lămpilor electrice (Analysis of sinusoidal signal deformations due to electric lamps balasts)
32. IOACHIM Dan, NEMESCU Mircea, Universitatea Tehnică "Gh. Asachi" Iași
Balast pentru montaje duo (Ballast for duo montage)
33. KINALI Necdet, TRIDONIC-Austria
A new digital era for the dimming of luminaires with digital ballasts and components
34. NICOARĂ Dan*, ȘORA Ioan*, ENACHE Corina**, SAVII Cecilia**, SOCOLIUC V.***, *Universitatea "Politehnica" - Timișoara, ** Academia Română - Filiala Timișoara, *** Institutul Național de Cercetări Electrochimice și Materiale Condensante
The benefic influence of the ultraacoustical field in the technology of some luminophores
35. POSTOLACHE Petru *, TOADER Cornel*, GOLOVANOV Nicolae*, SURDU Constantin*, BRĂNESCU Valentin**, ALBU Mihaela*, SCUTARIU Mircea***, CONSTANTIN Marius Dănuț*, *Universitatea "POLITEHNICA" București, Facultatea Energetică, ** Universitatea "VALAHIA" Târgoviște, *** Sucursala de Distribuție a Energiei Electrice București
Evaluarea pierдерilor de putere și energie electrică ale rețelelor electrice destinate iluminatului public exterior (Power losses and electric energy evaluation for public lighting electric network)
36. STOJKOVIC Aleksandra, R-Tech, Ličge
Visibility and visual comfort in the COINTE Tunnel
37. SZABO Elisabeta, BETEGH Katalin, PIEME S.R.L. Cluj-Napoca
Aspecte conceptuale ale iluminatului la restaurarea Castelului Banffy din Bonțida (Lighting conceptual aspects of Bonțida Banffy Castle rehabilitation)

Florin POP
Universitatea Tehnică
din Cluj-Napoca

CENTRUL DE INGINERIA ILUMINATULUI - UTC-N
LIGHTING ENGINEERING CENTER - LEC

Activitatea Centrului de Ingineria Iluminatului UTC-N - Lighting Engineering Center (LEC) a fost prezentată în numărul anterior al revistei începând cu înființarea acestuia în 25 aprilie 2000 prin decizie a Biroului Senatului Universității Tehnice, până în data de 6-8 martie 2001 când a avut loc ROAD SHOW 2001 - Cluj-Napoca, prezentarea firmei S.C. Philips Romania S.R.L., Divizia Lighting. Centrul de Ingineria Iluminatului UTC-N a luat ființă ca urmare a programului Tempus-Phare CME-03551-97 "Centrul de Ingineria Iluminatului, un centru de excelență pentru consultanță și educație continuă în domeniul iluminatului pentru necesități ale pieței de muncă - Lighting Engineering Center - LEC - an excellence center for consultancy and continuing education in the lighting field in direct link with the needs of the labour market" [programul derulat în perioada 15 decembrie 1998 - 14 martie 2000 este prezentat în pagina web

[**15 mai 2001** - Seminarul *SOLUȚII SCHNEIDER ÎN DOMENIUL INSTALAȚIILOR ELECTRICE INDUSTRIALE*, organizat în colaborare cu
S.C. PRAGMATIC Comprest S.R.L. și SCHNEIDER Electric România S.R.L.](http://bavaria.utcluj.ro/~lec].</p>
</div>
<div data-bbox=)



Cei 45 participanți, proiectanți, antreprenori, ingineri de exploatare, studenți și cadre didactice, au urmărit prezentările: Centrul de Ingineria Iluminatului - UTC-N - realizări și perspective (Prof. Dr. Florin POP, directorul Centrului de Ingineria Iluminatului); S.C. PRAGMATIC Comprest S.R.L. Cluj-Napoca, o prezență activă pe piața echipamentelor electrice (ing. Vasile RUSU, director general); Prezentarea generală a SCHNEIDER Electric ROMÂNIA S.R.L. și Distribuție electrică prefabricată CANALIS (ing. Petre BUTU, responsabil național sector industrie); Studiu de caz - aplicatie Canalis pentru o secție industrială (ing. Ioan JURCĂ - foto, director tehnic Pragmatic); Softstartere și Variatoare de viteză (ing. Petre BUTU); Norme interne și internaționale (ing. Mihai BRANA și ing. Petre BUTU)



28-30 iunie 2001 - Conferința Internațională *ILUMINAT 2001*, în colaborare cu S.C. Electrica S.A. prin Sucursala de Distribuție Cluj și S.C. Energobit Schréder Lighting S.R.L. Conferința reunește un important număr de participanți din țară și străinătate, personalități din lumea universitară, reprezentanți de firme de profil, ingineri și proiectanți, personal din administrația publică În perioada Conferinței se organizează o expoziție cu produse și echipamente specifice.

1 iunie 2001 - Tehnica Iluminatului în Spații Industriale, Birouri și Locuințe, curs ce se va susține în cadrul Programul LEONARDO DA VINCI, Proiect Pilot No.: RO/98/1/83544/PI /I.1.1.e/FPC "Centru de Reversie Profesională a Personalului Tehnic" coordonator Dr. Dumitru POP, profesor la Facultatea de Construcții de Mașini, Universitatea Tehnică din Cluj-Napoca. Materialul de studiu (notele de curs) realizat pe CD a fost elaborat de Dr. Florin POP, profesor și Dr. Dorin BEU, șef de lucrări.

6-19 iunie 2001 - Light and Lighting - Management, Ambiance and Systems, curs de vară organizat în colaborare cu BEST - UTC-N. Vor participa 20 studenți de la universități din Europa în care activează grupuri locale BEST.

Editarea revistei **Ingineria Iluminatului** cu o apariție semestrială, în colaborare cu S.C. Electrica S.A. prin Sucursala de Distribuție Cluj și editura MEDIAMIRA Cluj-Napoca. Numărul următor - anul 3, nr.

8 - decembrie 2001 va fi dedicat temei Sisteme de Control al Iluminatului.

Elaborarea de **studii privind optimizarea anumitor sisteme de iluminat**, la solicitarea unor parteneri.

În conexiune cu activitatea desfășurată pe linie universitară, este de menționat continuarea colaborării internaționale în cadrul programului european ERASMUS, în baza Contractului Instituțional SOCRATES-ERASMUS 2001-2002 al UTC-N. Între Universitatea Tehnică din Cluj-Napoca și Helsinki University of Technology este încheiat un Acord Bilateral de colaborare în domeniul ingineriei iluminatului, la care participă Dr. Florin POP și Dr. Dorin BEU. Se continuă astfel parteneriatul cu Profesor Liisa HALONEN, HUT - Lighting Laboratory (foto) - început prin programul Tempus-Phare amintit anterior. În cadrul programului de schimburi academice, Dr. Florin POP a efectuat o vizită la HUT - Lighting Laboratory în intervalul 24-31 mai 2001, susținând trei prelegeri cu teme: Lighting Quality Evaluation; Lighting Engineering Center - a Tempus project developed at the Technical University of

Cluj-Napoca - Objectives, Results, and Expectations; LSD - Lighting System Design - a computer program for didactic purposes.



Centrul de Ingineria Iluminatului UTC-N își desfășoară activitatea în cadrul Laboratorului de Instalații electrice și Iluminat, Catedra de Instalații pentru Construcții, Universitatea Tehnică din Cluj-Napoca. Amenajarea spațiului și modernizarea tehnică a fost și este posibilă pe baza finanțării obținute prin programul Tempus-Phare, a sprijinului acordat de conducerea Universității Tehnice, a resurselor financiare extrabugetare atrase prin câștigarea unor granturi de cercetare, prin organizarea unor cursuri postuniversitare și a sponsorizărilor oferite cu generozitate de diferite firme de specialitate și de absolvenți ai secției de Instalații pentru Construcții:

PHILIPS România / FLASH Transilvania
TOTAL Quality/ACI Antrepriza Construcții Instalații
LEGRAND România /Electro Daniella
PRAGMATIC Comprest
ABB România
RH Trust
SOCLU
ROMINSTAL Construct
TIM Trustul Instalații Montaj
DALKIA România - Alba Iulia
MEGAVOX Confort - Petrești
BURIDAVA 2000 Serv - Bistrița
LIDER ProdCarn - Alba Iulia
ARGOS - Sebeș

Cristian Viorel ȘUVĂGĂU
BC Hydro, Vancouver

LIGHTING IN THE NEW WORLD

This may be shocking, but despite globalization, Europe and the Americas are two different worlds, little changed in mentalities since Coulomb discovered the new continent, or if you like better, since Edison patented the electrical bulb.

Let me explain. While Europe's historical, multi-national political and social complex background may slow the implementation (at the continent scale) of the technological progress (see the introduction of the fluorescent lamp), the Americans' (by that I will refer mostly to North America: USA and Canada) simplicity and efficiency in doing things can lead to super fast technology implementations (in less than 5 years, the T8 (16 mm) fluorescent lamp was providing light in over 60% of all existing commercial applications in North America).

On the other side, Europe is well exploiting its rich cultural background and leads the market in luminaire design and lamps research and technologies, while the same simplicity of the Americans is a double edged sword, slowing the acceptance of a large number of products and technologies (it took more than 5 years to technically accept on the market the MR16 low voltage lamp or the same T8 fluorescent lamp). In a nutshell, the lighting market on both continents reflects the very economical and cultural differences between Europe and (North) America.

In addition, the difference in the energy potential and costs dictate the pace and directions the two lighting markets evolve towards efficiency. Europe on one side has depleted most of its fossil fuel resources (coal and oil), has limited hydro potential and after restricting the development of the atomic powered plants is aggressively developing sustainable alternate energy technologies, such as solar, wind and

biogas technologies. America has plenty of coal and oil resources, vast hydro potential and although the use of atomic power plants has been restricted, the drive to use alternate technology is not that powerful. Cities like Las Vegas, Los Angeles and New York consume in a day more electricity on lighting than many European countries in a week. To say the least, electricity is so cheap that in many houses and commercial and industrial buildings lights are seldom switched off...However, with current electricity crisis in California for example, there is an acute interest towards efficiency, energy savings and sustainability. In that direction ASHRAE and IES have issued in 1990 a common energy efficiency act/standard (last revision in 1999), which became law for many states and provinces.

There are many stories that can tell the tale of lighting on two continents, but I will insert them in the next episodes of this serial.

Now, let's see who are the players on the American market. Contrary to the American reality, where annually hundreds of thousands of companies raise and close and a 10 year old company is a respectable one, the lighting industry has very many veterans, companies that have been around for more than 50-70 years: General Electric (started by Edison in the last century), Holophane, Sylvania (now merged with Osram), Lightolier, Thomas Lighting, etc. Some multinational well known lighting companies like Philips, although a strong presence on the American market, sell only parts of the line of products they are known for (here Philips sell only lamps and ballasts). Many luminaire companies are merging today in a tendency to dominate the market, such as Lithonia, Genlyte who have dozen of smaller lines. More stable are the lamp manufacturers, so the American lamp market consists mostly of

Philips, Osram-Sylvania and General Electric. Control companies are the newest on the market, with Lutron, Leviton, Watt Stopper and Mytech leading it. Some European lighting companies such as Zumtobel-Staff, Louis Poulsen, Artemide, Se'lux, Iguzzini are making a strong impact on the market mostly grace to the outstanding and stylist design of their products.

Generally, the American lighting market is driven by the marketing not the design or energy efficiency. This may explain the resistance to new technologies and design formats mostly coming from Europe. On the other side, many compact fluorescent lamps available for the residential market are "no name" cheap products from China, sold at corner stores without proper certification.

The imperial measurement system makes often impossible for some of the standard European products to be used in North America. For example, the T5 fluorescent lamps (11 mm) although largely used in pendant luminaires, can't be used in recessed applications due to their extended length. Other differences, such as voltages (120/ 277/ 347V) and frequency (60Hz) require special adjustments and certification for European lamps and ballasts to operate in American luminaires. Recently, due to globalization trends, one can observe a welcomed relaxation in the American certification procedures.

Another important differences are the regulating bodies, the lighting authorities. For Europe and almost the rest of the world (except for North America) CIE, through the national committees and the lighting engineering associations, establishes the lighting standards and guide lines. When it comes to North America, IESNA (Illuminating Engineering Society of North America) is the lighting authority, to a point where most of the lighting professionals never heard of CIE.

However, despite all these differences, for the general public, lighting systems in Europe and

North America look the same, room luminaire layouts are similar and light levels suitable for the task being performed. Modern offices and hospitals, upscale retail boutiques and universities would have similar fixture types and familiar lighting systems, whether they are in New York, Toronto, Atlanta, San Francisco, Rome, Paris, London or Frankfurt.

We intend to keep you informed, through this "correspondence from the New World", with the American lighting realities in technology, design, awarded projects, education, urban integration and other interesting trivia facts.

Next episode:

What's new at the Lightfair 2001!

Iluminatul în Lumea Nouă

Probabil că acest fapt este şocant, dar, în pofida globalizării, Europa și America sunt două lumi diferite, puțin schimbate în mentalitate de când Coulomb a descoperit noul continent, sau, dacă preferați acest fapt, de când Edison a patentat bulbul electric.

Dăți-mi voie să mă explic. În timp ce Europa istorică, bazată pe un complex politic și social multi-national este lentă în implementarea (la nivel continental) a progresului tehnologic (vezi introducerea lămpii fluorescente), simplicitatea și eficiența americană (prin acest termen mă refer în special la America de Nord: SUA și Canada) în acțiune poate să conduce la implementări extrem de rapide (în mai puțin de 5 ani lămpile fluorescente T8 - de 16 mm - au asigurat iluminatul în peste 60% din aplicațiile comerciale existente în America de Nord).

Pe de altă parte, în aceeași măsură în care Europa folosește bine fundamnetul său cultural și conduce pe piața de proiectare a corpuriilor de iluminat și a cercetării și tehnologiei lămpilor, simplicitatea americană este o sabie

cu două capete, încetinind acceptarea unui mare număr de produse și tehnologii (au fost necesari mai mult de 5 ani pentru acceptarea tehnică pe piață a lămpii de joasă tensiune MR16 și chiar a aceleiași lămpi fluorescente T8). Într-un cuvânt, piața de iluminat a ambelor continente reflectă diferențele puternice economice și culturale între Europa și America (de Nord).

În plus, diferența între potențialul energetic și costuri dictează ritmul și direcțiile în care cele două piețe de iluminat evoluează către eficiență. Europa, pe de o parte, a epuizat multe din resursele sale fosile (cărbune și petrol), are un potențial hidro limitat și după restricționarea dezvoltării centralelor atomice de putere este agresivă în a dezvolta tehnologii energetice alternative de sprijin, cum sunt tehnologiile solare, ale vântului și biologice. America are multe resurse de cărbune și petrol, un mare potențial hidro și, chiar dacă utilizarea centralelor atomice de putere a fost restricționată, interesul pentru dezvoltarea tehnologiilor alternative nu este atât de puternic. Orașe precum Las Vegas, Los Angeles și New York consumă într-o zi mai multă electricitate în iluminat decât multe țări europene într-o săptămână. Pentru a concluziona, electricitatea este atât de ieftină încât în multe case și clădiri comerciale și industriale ea este rareori deconectată... Cu toate acestea, având criza electrică din California ca exemplu, există un acut interes către eficiență, economiei de energie și suport. În această direcție ASHRAE și IES au realizat în 1990 un standard/act comun de eficiență energetică (ultima revizie în 1999), care a devenit lege pentru multe state și provincii.

Sunt multe întâmplări care pot să vă spună povestea iluminatului celor două continente, dar eu le voi insera în viitoarele episoade ale acestui serial.

Acum, să vedem cine sunt jucătorii de pe piața americană. Contra realității americane, unde anual sute de mii de companii se nasc și mor și unde o companie bătrâna de 10 ani este

una respectabilă, industria iluminatului are mulți veterani, companii care ființează de peste 50-70 ani: General Electric (pornită de Edison în secolul trecut), Holophane, Sylvania (care acum se unește cu Osram), Lightolier, Thomas Lighting etc. Unele companii multinaționale binecunoscute precum Philips, de altfel o puternică prezență pe piața americană, vând doar părți din serile de produse cunoscute (de exemplu Philips vinde doar lămpi și balasturi). Multe companii de corpuri de iluminat se unesc azi în tendință de a domina piața, cum sunt Lithonia, Genlyte care au o duzină de linii mai mici. Mai stabile sunt producătorii de lămpi, astfel că piața americană de lămpi constă în special din Philips, Osram-Sylvania și General Electric. Companiile de echipamente de control sunt cele mai noi pe piață, cu Lutron, Leviton, Watt Stopper și Mytech ca lideri. Unele companii de iluminat europene cum sunt Zumtobel-Staff, Louis Poulsen, Artemide, Se'lux, Iguzzini sunt de așteptat să determine un puternic impact pe piață, în principal datorită designului excepțional și de elegant al produselor acestora.

În general, piața de iluminat americană este condusă de marketing, nu de proiectare sau eficiență energetică. Aceasta poate explica rezistența la noile tehnologii și formate de proiectare care, cele mai multe, vin din Europa. Pe de altă parte, multe lămpi fluorescente compacte existente pe piața rezidențială sunt produse ieftine "fără nume" din China, vândute la colțul magazinelor, fără certificate corespunzătoare.

Sistemul imperial de măsură face adesea imposibilă utilizarea în America de Nord a unor produse standard europene. De exemplu, lămpile fluorescente T5 (11 mm), de altfel larg utilizate în corpurile de iluminat suspendate, nu pot fi utilizate în aplicații cu tavan fals datorită lungimii lor mari. Alte diferențe, cum este tensiunea (120/277/347V) și frecvența (60Hz) impun adaptări și certificări speciale pentru ca lămpile și balasturile europene să poată opera în corpurile de

iluminat americane. Recent, datorită tendințelor de globalizare, se poate observa o binevenită relaxare în procedurile de certificare americane.

Alte diferențe importante sunt legate de structurile de reglementare, de autoritatele în iluminat. Pentru Europa și aproape întregul rest al lumii (cu excepția Americii de Nord) CIE, prin comitetele naționale și asociațiile de ingineria iluminatului stabilește standardele în iluminat și liniile directoare. Cât privește America de Nord, IESNA (Illuminating Engineering Society of North America) este autoritatea în iluminat, cu mențiunea că cei mai mulți profesioniști nu au ăuzit niciodată de CIE.

Cu toate acestea, pentru publicul larg, sistemele de iluminat în Europa și America de Nord par a fi asemănătoare în pofida tuturor diferențelor, amplasarea corpurilor de iluminat în încăpere este similară și nivelurile de


lumină sunt corespunzătoare cu sarcina ce trebuie desfășurată. Birourile moderne și spătalele, buticurile și universitățile au aceleași tipuri de corperi de iluminat și sisteme de iluminare sunt familiare, fie că te află în New York, Toronto, Atlanta, San Francisco, Rome, Paris, London sau Frankfurt.

Intenționăm să vă informăm, prin această "Correspondență din Lumea Nouă", cu realitățile luminotehnice în tehnologie, proiectare, premii acordate, învățământ, integrarea urbană și alte detalii interesante.

În continuare, vom aduce la cunoștință un alt aspect important din lumea nouă: integrarea urbană. În următorul episod, vom discuta despre ce este integrarea urbană și cum poate fi realizată.

Vizualizări și interviuri cu profesioniști din domeniul iluminatului și arhitecturii.

Ce este nou la Lightfair 2001?



Cristian ȘUVĂGĂU

PhD, Peng, LC, BC Hydro,
6911 Southpoint Drive,
Burnaby, BC, Canada
Fax. + 604-528-1552

e-Mail: cristian.suvagau@bchydro.bc.ca

Lighting engineer at BC Hydro, in Vancouver, Canada. Member of CIE and IESNA Board of Directors for BC. Numerous lighting research, technical articles and project designs for institutional, commercial and industrial indoor and outdoor facilities in North America. Received his doctorate from the Technical University of Construction Bucharest in 1995. Assistant Professor at the Lighting and Electrical Installations Chair, Faculty of Installations, UTCB until 1995.

Lighting Research & Technology

TECHNICAL EDITOR: R H Simons, Lighting Projects Consultant, Essex, UK

In March 2001 Arnold and The Chartered Institution of Building Service Engineers relaunched **Lighting Research & Technology**.

Lighting Research & Technology is an international journal publishing original material and promoting research in the field of lighting technology. The journal includes original theoretical and practical work, reviews on particular aspects of lighting or vision, case studies of new installations with design concepts and review case studies of innovative installation providing operating results and user reaction.

New and improved features in **Lighting Research & Technology** include:

Online! Plus archive facility available from Volume 33

Redesigned format - easier to use and store
Peer reviewed by cutting edge researchers

International advisory boards - ensures worldwide relevance

Includes reviews of ground breaking research and topical literature

Contains critical book reviews of the latest literature in the field

Lighting Research & Technology is now available. To request your relaunch issue please contact

arnoldjournals@hodder.co.uk

Quarterly, Approx 288 pages per volume

ISSN 1365-7828

2001 Cost (Volume 33)

Institutional:	(EC) £99.00	(US) \$204.00	(ROW) £120.00
Individual:	(EC) £54.00	(US) \$ 94.00	(ROW) £ 56.00

Kathryn COUSINS

Product Manager

tel: +44 (0) 20 7873 6358

fax: +44 (0) 20 7873 6325

e-mail: kathryn.cousins@hodder.co.uk

web: www.arnoldpublishers.com

În martie 2001, **Arnold** și **CIBSE - The Chartered Institution of Building Service Engineers** - au relansat revista **Lighting Research & Technology**.

Lighting Research & Technology este o revistă inter-națională ce publică materiale originale și promovează cercetarea în domeniul tehnologiei iluminatului. Revista include lucrări teoretice și practice originale, prezintă unele aspecte particulare ale iluminatului sau vederii, studii de caz ale unor instalații noi cu concepțele de proiectare și analizează studii de caz ale unor instalații inovative, cu evidențierea rezultatelor funcționale și reacției utilizatorilor.

Componentele noi și îmbunătățite ale **Lighting Research & Technology** includ:

Online! Facilități suplimentare de arhivă disponibile începând cu Volumul 33
Format redimensionat - mai ușor de folosit și de păstrat

Articolele sunt recenzate de cercetători recunoscuți

Un colegiu de avizare internațional - asigură o relevanță mondială

Include analize ale cercetării fundamentale și ale literaturii specifice

Conține recenzie critice ale cărților celor mai recente din domeniu

Lighting Research & Technology este acum disponibilă pentru fiecare. Pentru a cere exemplarul dumneavoastră vă rugăm să contactați arnoldjournals@hodder.co.uk
Trimestrial, Aproximativ 288 pagini per volum

Arnold

338 Euston Road

London

NW1 3BH

UNITED KINGDOM

**Cuprinsul ultimelor numere
ale revistei
Lighting Research & Technology**

Volume 33, Number 1, 2001

Peter Tregenza, *Editorial*

KA Painter and DP Farrington, *The cost benefits of improved street lighting, based on crime reduction*

IG Iliadis, *The natural lighting of the mosaics in the rotunda at Thessaloniki*

DHW Li and JC Lam, *Predicting vertical luminous efficacy using horizontal solar data*

PJ Littlefair, *Photoelectric control: the effectiveness of techniques to reduce switching frequency*

PJ Littlefair and A Motin, *Lighting controls in areas with innovative daylighting systems: a study of sensor type*

Recenziile articolelor prezentate și răspunsurile autorilor

Volume 33, Number 2, 2001

E Rowlands, *Editorial*

S Escuyer and M Fontoyon, *Lighting controls: a field study of office workers' reactions*

GR Newsham and JA Veitch, *Lighting quality recommendations for CDT offices: a new method of derivation*

J Mardaljevic, *The BRE-IDMP dataset: a new benchmark for the validation of illuminance prediction technique*

Recenziile articolelor prezentate și răspunsurile autorilor

**Recommendations for the printing form of your papers for the LEC review
INGINERIA ILUMINATULUI**

Please use MS-Word for editing the article. The article could have any number of pages (preferably even). It will be printed in its English original version + Romanian translation (provided by LEC).

Settings for A4 size

Top 1.5

Bottom 2.5

Left 1.5 (Inside)

Right 2 (Outside)

Header 1

Footer 1.5

Mirror margins (yes)

Page Number Outside

Page framing. Two free lines of 12 on first page, before the title

TITLE (use 14 Caps Bold)
(one free line of 12)

Author/authors (use 12 Bold), Name, First name (use CAPS), Affiliation (work place) (use 12 without bold), without academics titles (three free lines of 12)

Text will be written on two columns, with the exception of tables or figures that require the full width of the page.

2 columns, Equal column width, Default settings: Width 8.11 cm, Spacing 1.27 cm

First line tab 0.6 (on paragraphs)

Font: Style Times New Roman, Size 12

Line spacing: Single

The explanation of the figures and tables must be written with smaller letters (use 11). For the content (data) of the tables should be use the same letters (11). Write: **Figure 5** Explanation (without point after the number of the figure). Write: **Table 2** Title of the table (without point after the number of that table)

References should be cited in brackets in text.

Abstract bold

(one free line)

Abstract text (maximum 125 words)

(one free line)

1 Title of the chapter - (bold but not CAPS)

2 Title of the chapter ... and so on

Acknowledgements

References

References will be written with font size 10.

Finally write the data of reference for the author/authors: academic title, position, and work

place address, contact address and other data.

Following this you have to present yourself on maximum 50 words (font size 10) the personality of the author/authors along with photo/photos.

Send a printed copy by surface mail, and the original article as an attached file by e-mail.

A Referee Committee will analyze the articles.

The copyright for all materials published in Ingineria Iluminatului review are the property of the Technical University of Cluj-Napoca - Lighting Engineering Center UTC-N - LEC and the Publishing Company MEDIAMIRA S.R.L. Cluj-Napoca, Romania.

Contact address:

Dr. Florin POP, Professor
UTC-N - Universitatea Tehnica
15, C. Daicoviciu Street
RO - 3400-Cluj-Napoca, ROMANIA
Fax: +40.64.192055;
Phone (home): +40.64.197254
e-Mail: *Florin.Pop@insta.utcluj.ro*

Recomandări de redactare a lucrărilor
pentru revista
INGINERIA ILUMINATULUI

Redactarea se face în Word 97, cu caracterele românești implicate ale Word-ului, pentru a se putea face prelucrarea textului. Articolul să aibă un număr par de pagini.

Setare pagina A4

Top 1.5
Bottom 2.5
Left 1.5 (Inside)
Right 2 (Outside)
Header 1
Footer 1.5
Mirror margins (yes)
Page Number Outside

Încadrarea în pagină. Pe prima pagină, înaintea titlului se lasă două rânduri size 12 libere

TITLUL (cu 14 Caps Bold)
(Un rând size 12 liber)

Autorul/autorii (cu 12 Bold), Prenume, Nume de familie (cu CAPS), Afilierea (locul de muncă) (cu 12 fără bold), fără titluri academice (Trei rânduri size 12 libere)

Redactarea

Textul lucrării va fi scris în continuare pe două coloane (excepție tabelele sau figurile care necesită întreaga lățime disponibilă a paginii) 2 columns, Equal column width, Setarea implicită: Width 8.11 cm, Spacing 1.27 cm

Tabs 0.6 (pentru aliniat nou)

Font: Style Times New Roman, Size 12

Line spacing: Single (la 1 rând)

Legendele figurilor, tabelele și conținutul (datele) din tabele se scriu cu litere mai mici, Size 11. Se scrie **Figura 5** Legenda (fără punct după numărul figurii). Se scrie **Tabelul 2** Titlul tabelului (fără punct după numărul tabelului) Figurile scanate să fie clare (format JPEG).

Mențiunile bibliografice se fac în paranteze drepte în cadrul lucrării.

Titlurile subcapitolelor se scriu fără bold.

Rezumat bold

(Un rând liber)

Textul rezumatului (maximum 125 cuvinte)

(Un rând liber)

1 Titlul capitolului - (bold dar nu CAPS)

(Un rând liber)

2 Titlul capitolului ... și aşa mai departe

Multumiri

Bibliografia. Bibliografia se scrie cu font size 10, menționând în ordine autorii, titlul lucrării, revista sau carte, pagina și anul.

După textul lucrării în limba română, se introduce TITLE în limba engleză (cu 14 Caps Bold), un rând size 12 liber și Abstract în limba engleză (maximum 250 cuvinte)

În final se trece (font size 10) adresa de contact (poștală, telefon, fax și e-Mail), iar apoi se face prezentarea personalității autorului /autorilor (maximum 50 de cuvinte) împreună cu fotografia personală.

Articolul se trimite pe Internet prin fișier atașat (fără virusi), iar prin poștă - două copii listate și, eventual, originalul pe dischetă.

Autorii sunt responsabili de forma de prezentare a articolelor și de conținutul lor științific. Imaginele se vor încadra în Text Box, pentru putea fi trase la pozițiile necesare.

Lucrările sunt analizate de Comisia de Referenți.

Drepturile de reproducere ale materialelor publicate în revista Ingineria Iluminatului aparțin Universității Tehnice din Cluj-Napoca, Centrul de Ingineria Iluminatului UTC-N și Editurii MEDIAMIRA S.R.L. Cluj-Napoca.

Adresa de contact:

Dr. Florin POP, Profesor

UTCN - Universitatea Tehnică

Str. C. Daicoviciu Nr. 15, 3400- Cluj-Napoca

Fax: (064) 192055; Tel. acasă: (064) 197254

e-Mail: *Florin.Pop@insta.utcluj.ro*



Editura MEDIAMIRA
ISSN 1454-5837

Imprimat: TipoSoft Turda, tel./fax 064-316257